

CITY OF SEATTLE-
PUBLIC UTILITIES
CONSTRUCTION
MANAGEMENT

VOLUME 1911

STANDARD PLANS
& SPECIFICATIONS

APRIL 18, 1911

File

1911

*To be returned
Vault City &*

*733-16
30657*

STANDARD PLANS

AND

SPECIFICATIONS

OF THE

CITY *of* SEATTLE



Approved by the Board of Public
Works April 18, 1911



R. H. THOMSON
CITY ENGINEER

SEATTLE - - WASHINGTON

MICROFILMED - JUNE 1979

ROLL #463

ENGINEERING DEPT.
CENTRAL FILES

STANDARD PLANS AND SPECIFICATIONS

The general plans for any improvement, showing the location and the method of construction of the several parts thereof, together with the standard specifications and standard plans, the proposal blank and such special specifications as may be attached thereto, shall form the complete plans and specifications for any particular improvement, and shall be considered as a whole. The special specifications and detailed plans accompanying the proposal are intended to modify, and shall take precedence over the standard specifications and standard plans. All work shall be done in conformity with the plans and specifications or as may be directed by the City Engineer from time to time. During the progress of the work, the City Engineer may furnish additional plans and may make such alterations of the original plans as he may deem necessary, and the contractor shall, upon receiving notice of such additional plans or alterations, obtain a copy of the same and cause the work to be prosecuted in conformity therewith.

SUPERINTENDENCE

All improvements shall be made under the superintendence of the City Engineer, and any orders or directions given by him shall be respected and immediately and strictly obeyed by the contractor or any overseer or foreman in charge of the work. It is hereby understood that wherever the term "Engineer" or "City Engineer" is mentioned in these specifications, it shall mean himself or any representative duly appointed by him.

PAYMENT.

Payment for all work specified herein will be made at the respective rates bid for the items listed on the proposal, and such payment shall be in full compensation for all labor and material necessary or incidental to the completed work.

GRADING

CLEARING AND GRUBBING




The district to be cleared and grubbed will include: 1st: The area covered by the improvement under contract; 2nd: The area of any approaches to be made to the improvement; and 3rd: All areas where waste material is to be deposited. All roots, stumps, trees, logs, brush, old sidewalks, planking, sills, cross-walks, curbs, gutters, box drains, bulkheads and any other lumber; all material subject to shrinkage or decay; and any other debris encountered on any portion of the work, shall be piled and burned or otherwise disposed of as the City Engineer may direct; provided, that no debris of any kind whatever shall be deposited in any waters surrounding the City, or in any street or alley, or upon any private property except by written consent of the owner of the same. All boulders encountered during the progress of the work shall be removed and disposed of to the satisfaction of the City Engineer.

Where wood sidewalks have been constructed by order of

the Board of Public Works within one (1) year prior to the date of the resolution declaring the intention of the City Council to order the improvement under contract, such walks shall be carefully taken up and neatly piled by the contractor, and the lumber therein shall become the property of the owner of the abutting property.

Any wood cross-walks, curbs, gutters and other lumber which may be of use for planking streets and other lumber in such manner as to sustain as little damage as possible, and carefully piled and guarded until used. Any old lumber not used in connection with the improvement under contract, and which in the judgment of the Superintendent of Streets shall be deemed to be of use to the Street Department of The City of Seattle, shall be set aside by the contractor in suitable piles and removed by said Department.

In removing any bulkheads or retaining walls, special care

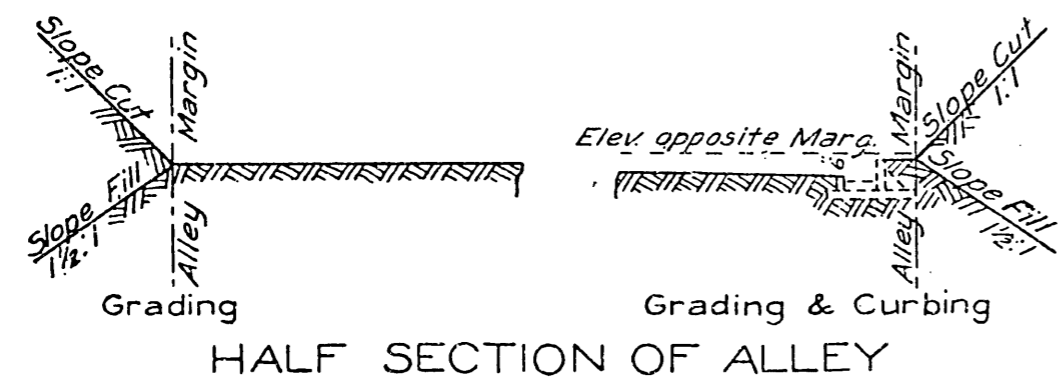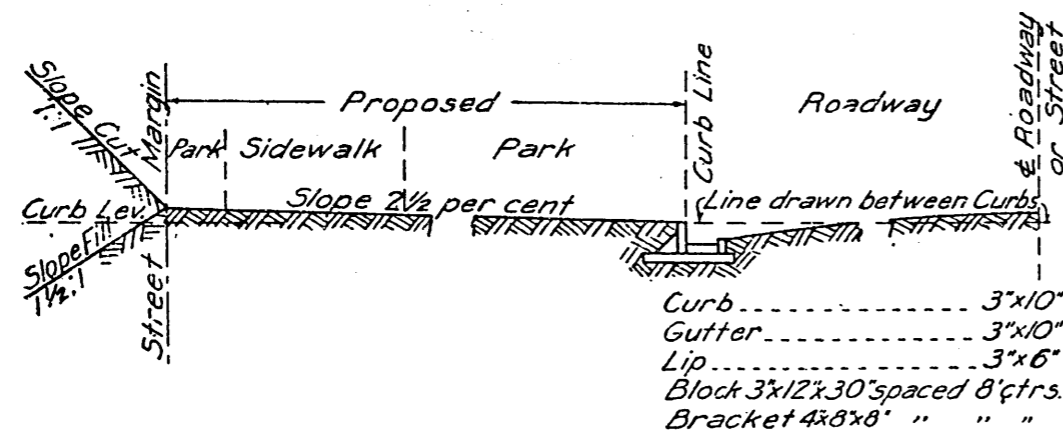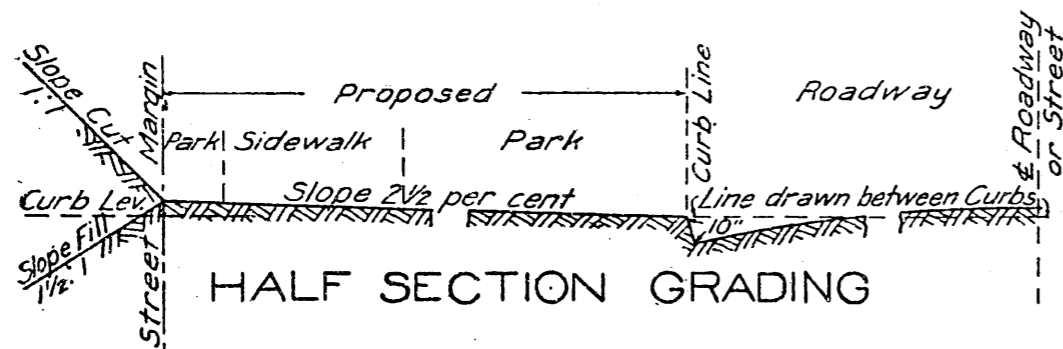

Width of Roadways in feet	18	25	36	44	58	68
Center Height in feet above line joining opposite curbs	0.1	0.25	0.4	0.6	0.7	1.3

CROWN OF ROADWAY

shall be taken to sustain any existing sidewalks or other structures. Where necessary to adjust any existing improvement, such as wood or concrete sidewalks, planking or paving, to the new improvement, such work shall be taken up as directed by the City Engineer and relaid. In such cases, however, the cost of taking up such existing improvement shall be included in the prices bid for relaying or replacing the same.

The work of clearing and grubbing shall be commenced only at such place or places as the City Engineer may direct, and shall be extended only over such area at one time as the City Engineer may designate.

On grading contracts, the district to be cleared and grubbed shall include also the area covered by all slopes, whether in excavation or embankment, extending beyond the margins of the streets. All stumps that stand on the line of the street or on the line of the slope of any excavation or embankment, shall be entirely removed. All fences adjoining any excavation or embankment, which will be liable to fall or be buried, shall be carefully removed and placed upon the adjoining property. After the excavation or embankment has been completed, these fences shall be re-built by the contractor, upon the property lines.

On paving contracts, any lumber or other debris which may be found within one (1) foot of the sub-grade or of the present surface of the street where such surface is below sub-grade, shall be removed and burned or otherwise disposed of.

EARTHWORK

Under this head is included all excavations and embankments required for the formation of the sub-grade, making approaches to abutting streets and alleys, and all other excavation or embankment connected with or incident to the completion of the work. The preparation, surfacing and seeding of all slopes and parks is included as grading.

Excavation.—All material shall be removed from the excavations by some method to be approved by the City Engineer, and shall be deposited in the embankments. In case any material shall slide into the excavations during the progress of the work, the same must be removed at the contract price. No extra payment will be allowed therefor. All side slopes shall be made at the inclination shown on the plans or as may be directed by the City Engineer. They shall be dressed to straight lines and plane surfaces, except where otherwise directed. All material from excavations in excess of the amount required to complete the embankments within the local improvement district under contract, shall be deposited in adjoining streets and alleys or upon other public property, as may be directed by the City Engineer. The remaining waste material shall be deposited upon such private property as may be assessed for the cost of the improvement under contract, the owners of which have filed with the City Engineer an application for such waste material. All such applications made prior to the opening of bids, have been attached to the plans for the improvement. In addition to the applications made prior to the opening of bids, the contractor will be required to comply with all requests made subsequently, provided the earth has not been already removed from the excavation. The contractor must not remove any material from the district until he has ascertained that no more material is required by the property owners within the local improvement district. In all cases where material is wasted, whether on public or private property, the contractor shall not be required to haul material a greater distance than 600 feet.

All solid or loose rock or boulders encountered in the pro-

GRADING—Continued

gress of the work, shall be removed and disposed of by the contractor to the satisfaction of the City Engineer.

All material remaining after the requirements set forth herein have been met, shall be disposed of by the contractor.

Embankment.—The contractor shall furnish all material required for embankments not found on the improvement. All borrow pits shall be cleared and grubbed in such manner as to prevent any material specified under "Clearing and Grubbing" from being deposited in the embankment. No payment will be made for the clearing and grubbing of borrow pits, nor for any loose or solid rock found therein. The clearing and grubbing shall be kept at least 200 feet in advance of the embankments, and no embankment shall be commenced until the clearing and grubbing has been inspected and approved by the City Engineer. All embankments shall be made of such width and with such side slopes as may be shown on the plans or as may, in the judgment of the City Engineer, be required to maintain solid and permanent sidewalks and roadways. The contractor must use his own judgment as to the amount of shrinkage or settlement of the underlying ground to be provided for. Where required by the City Engineer, the slopes of all embankments shall be dressed as specified above for excavations.

Whenever, in the judgment of the City Engineer, the original ground under any embankment is too soft or otherwise unsuitable to remain in the street, the contractor shall excavate the same to such a depth as may be directed, and dispose of such material outside of the limits of any public streets or alleys. All material so removed will be classified and paid for as "Earthwork."

Grading for Concrete Sidewalks.—All excavation for concrete sidewalks shall be made in accordance with the foregoing specifications. All fills under such walks shall be made of suitable material, spread in layers not exceeding one foot in thickness. Each layer shall be thoroughly flushed with water and tamped and rolled until a hard, unyielding surface is obtained.

Sub-Grading for Paving.—After the surface of the street has been cleared and grubbed as specified herein, any lumber, drains, dead pipes or other material not suitable for the foundation and which may be found more than one foot below the sub-grade of the street, shall be removed by the contractor by trenching or otherwise, as may be directed by the City Engineer.

The City Engineer shall be the sole judge as to what shall constitute unsuitable or improper materials to remain in the sub-foundation, and in order to ascertain the presence of unsuitable materials he may cause to be dug, holes or trenches of such dimensions and lengths and in such directions and to such depths as he may deem necessary. If sinking spots develop, the City Engineer may require the same to be excavated to such depth as may be necessary to investigate and determine the cause of such sinking and the necessary remedy therefor, and such remedy they may require to be used. Such excavations, unless otherwise ordered, shall be refilled with suitable earth or material, the same to be done in layers and thoroughly tamped or water settled. The amount of earth so removed shall be paid for at the rate bid for sub-grading. No other payments whatsoever will be made on the above work.

After the ground has been cleared as specified above, it shall be excavated or filled, as may be required. All embankments shall be made of suitable material, spread in layers not exceeding one foot in thickness. The contractor shall furnish all material for embankment not found within the

GRADING—Continued

district covered by this contract. Embankment slopes shall be dressed to a uniform line and shall have such inclinations as the City Engineer may direct. The ground shall be water settled where directed, and when in suitable condition, each layer shall be thoroughly rolled and compacted by the use of a steam roller weighing not less than ten tons. The rolling shall continue until all settlement ceases. As it proceeds, all spots or sections settling below sub-grade, shall be brought up by filling in of suitable material. This material shall then be water settled and re-rolled. This process shall be continued until a hard and uniform surface has been obtained, conforming to the grade and cross-section required.

Any portion of the surface of the sub-grade which may be inaccessible with the steam roller shall be thoroughly tamped, to the satisfaction of the City Engineer, with a rammer ten (10) inches in diameter, weighing not less than forty (40) pounds. When rolling, as herein specified, is done with the steam roller belonging to the City of Seattle, the contractor will be required to pay for its use on this work at the following rates to-wit: One dollar and fifty cents (\$1.50) per hour for each and every hour the roller is in use, and in no case will less than four (4) hours in succession be charged at one time to the contractor for its use. The engineer's salary will be paid by the city, the cost of the fuel will be paid by the Local Improvement District. The engineer in charge of said steam roller will be at all times under the direction of the City Engineer. The number of hours the roller has been in use will be charged to the contractor, as returned by the City Engineer.

Sub-Grading for Planking.—Under this head is included all the excavation or embankment necessary to bring the portion of the roadway required to be planked to the necessary subgrade, also such excavation or embankment as may be necessary for approaches or to make the proper grade upon which to construct any sidewalks included in the contract. The contractor will be required to find his own borrow pits for all earth required to be furnished in excess of the excavation within reasonable limits of the improvement. No objectionable earth will be permitted.

Payment for "Sub-Grading for Planking" will be included in the price bid for "Lumber".

Surfacing.—All earth roadways shall be dressed to a smooth and uniform surface, curving uniformly from gutter to gutter. All rock or stones greater than two inches in diameter shall be removed from the street. Whenever the material found in cuttings is unsuitable to form a good roadbed, or where deemed necessary by the City Engineer, the same shall be excavated to such a depth as the City Engineer may direct, and the same shall be refilled with such material as the City Engineer may designate, to a true grade and surface, and all material removed from such excavations shall be classified and paid for as that in other cuttings, for this improvement.

All parking strips shall be filled in with suitable soil carefully raked to a smooth and uniform surface. All slopes and parking strips shall be sowed with white clover seed of good quality, using one pound of seed to every 300 square feet.

Resurfacing Streets.—Where curbs and gutters or sidewalks are constructed on a street which has been previously graded, the contractor shall resurface the roadway, slopes and parking strips in accordance with the foregoing specifications for "Surfacing". Before any street is accepted as completed, it must be left as specified herein.


GRADING—Continued

All slopes between the sidewalks and the property shall be carefully re-dressed to smooth and even surfaces.

Maintenance.—The contractor will be required to maintain the improvement in good condition for the period of thirty (30) days from the date of acceptance, and will receive no compensation therefor beyond the amount of the final estimate.


Measurement.—All excavations and embankments required will be carefully and accurately cross-sectioned, and the cubical contents computed by the method of averaging end areas. In special cases the prismatic formula may be used.

Payment.—All earthwork will be paid for at the rate bid per cubic yard. The price paid per cubic yard shall include the cost of excavating and removing all material from excavations and depositing the same in embankments, whether on the street or on private property. It shall also include the shaping and dressing of slopes, whether in excavation or embankment, the raking and dressing of all parking strips and slopes, the removal of all solid or loose rock or boulders

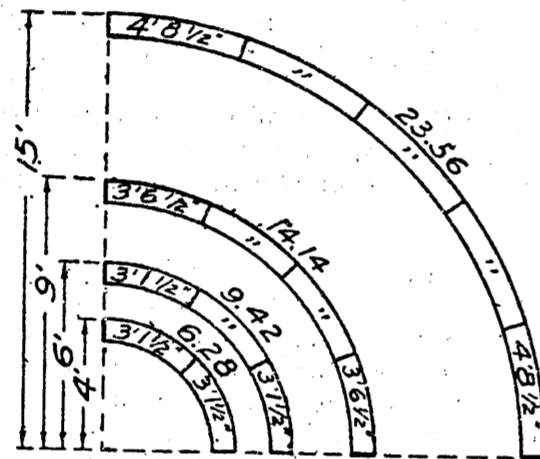


NOTE: For radii longer than 15' and shorter than 50' Gutter Boards shall be cut approximately in six foot (6') lengths. For radii longer than 50' they shall be cut in approximately eight foot (8') lengths.

METHOD OF CUTTING GUTTER BOARDS

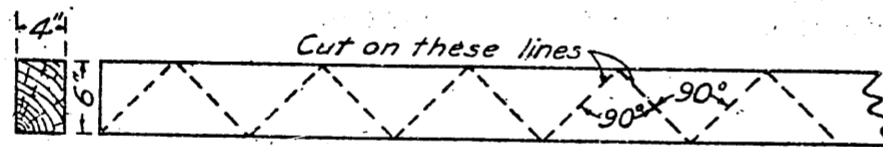

METHOD OF CUTTING BRACKETS

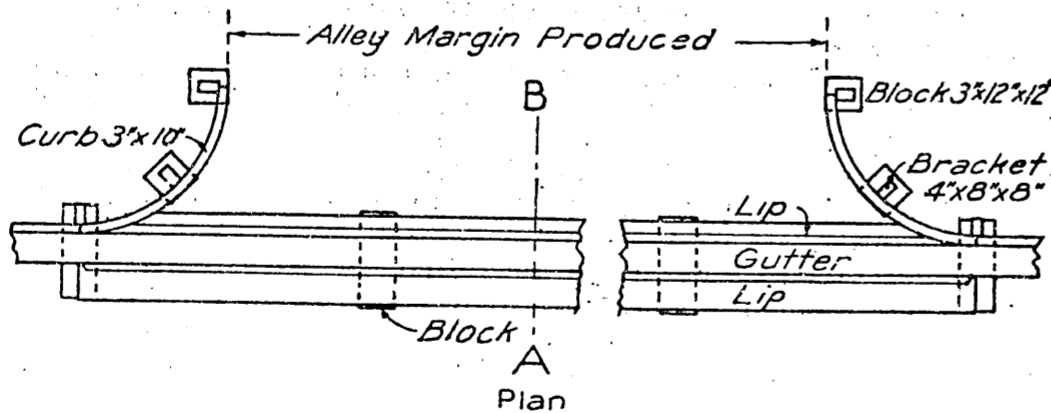

Gutter.....3'x10"
Lips.....5'x6" & 5'x12"
Block 3'x12'x30"-B.C.to C.

(3'x10" Curb 4'x8'x8" Bracket

Section A-B

ALLEY GUTTER AND RETURNS

GRADING—Continued

encountered during the progress of the work, all water settling, rolling and tamping of embankments or sub-grades, and all other labor or material necessary for the completed work. Where the excavation exceeds the embankment, payment will be made for excavation only. Where the embankment exceeds the excavation, payment will be made for embankment only, and no allowance will be made for shrinkage.


WOOD CURBS AND GUTTERS

Curbs, gutters and lips shall be of lengths 16, 24 and 32 feet, and they shall rest on sound fir blocks of the dimensions shown, placed not more than eight feet center to center, and under every joint, and solidly bedded in the ground. They shall be sized one side and both edges. The gutters shall be spiked to each block with two 60-penny wire nails. Curbs and lips shall be spiked to the gutters with 60-penny wire nails, every two feet, driven horizontally. Curbs, gutters and lips shall be laid breaking joints. Angle blocks shall be nailed with two 16-penny wire nails at each end. All breaks in grades shall be carefully rounded by vertical curves.


Measurement.—The length of all curbs and gutters will be measured on the face of the curb.

Wood Curbs and Gutters Adjusted.—Where directed, existing curbs and gutters shall be adjusted to grade by blocking up or by taking up and relaying, using such old lumber as may be suitable.


Payment will be made for any lumber relaid at rate bid for old lumber.

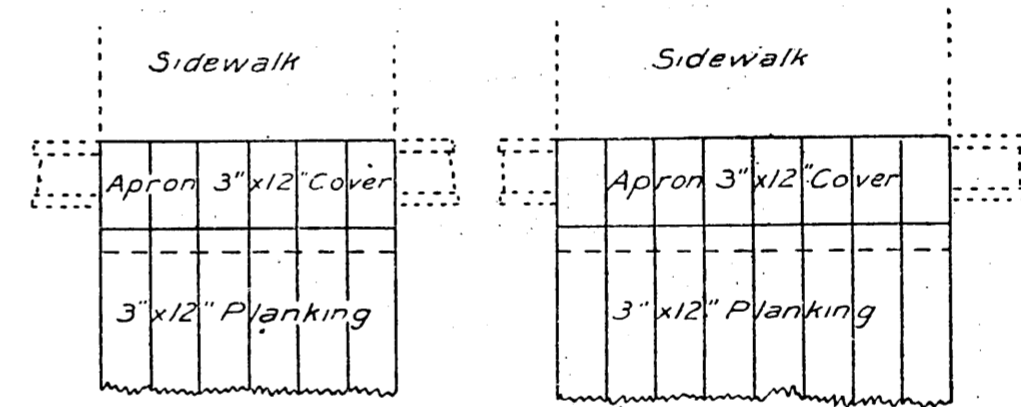


NOTE - Apron to be let into Curb so that tops of Curb and Apron will be flush



Section 6' ft Crosswalk



Section 8' ft. Crosswalk

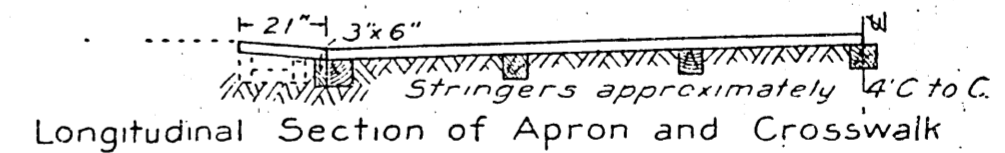

Width of Roadway	18	22	25	28	32	36	40	44	48	52	58
Length of Crosswalk	15	19	22	25	29	33	37	41	45	49	55
No of Stringers	5	5	7	7	9	9	11	11	13	13	15
Feet BM	6' width	360	432	522	576	684	756	864	936	1044	1116
	8' width	480	576	696	768	912	1008	1152	1248	1392	1488

Crosswalks Bill of Material
WOOD APRON AND CROSSWALK

GRADING—Continued

CROSS-WALKS

Covering planks of cross-walks shall be uniformly three inches thick and twelve inches wide, and shall be spiked to the stringers with two 60-penny wire nails in each plank at each stringer. The stringers shall be shaped accurately to the dimensions shown on the plans, and shall be solidly bedded in the ground. Aprons shall be made from planks three inches by eight inches wide, unless otherwise shown on the plan. The lumber shall correspond to that specified for Lumber under Miscellaneous Items.


Payment for cross-walks will include all excavation for stringers.

REBUILDING CROSS-WALKS

In rebuilding cross-walks only such of the old lumber shall be used as is, in the opinion of the City Engineer, suitable. Any new lumber required will be paid for as new cross-walk lumber. The method of construction shall be the same as for new cross-walks.

SHEAR BOARDS

Shear boards shall be well fitted and securely spiked to the gutter lip and shall be well bedded in the ground.

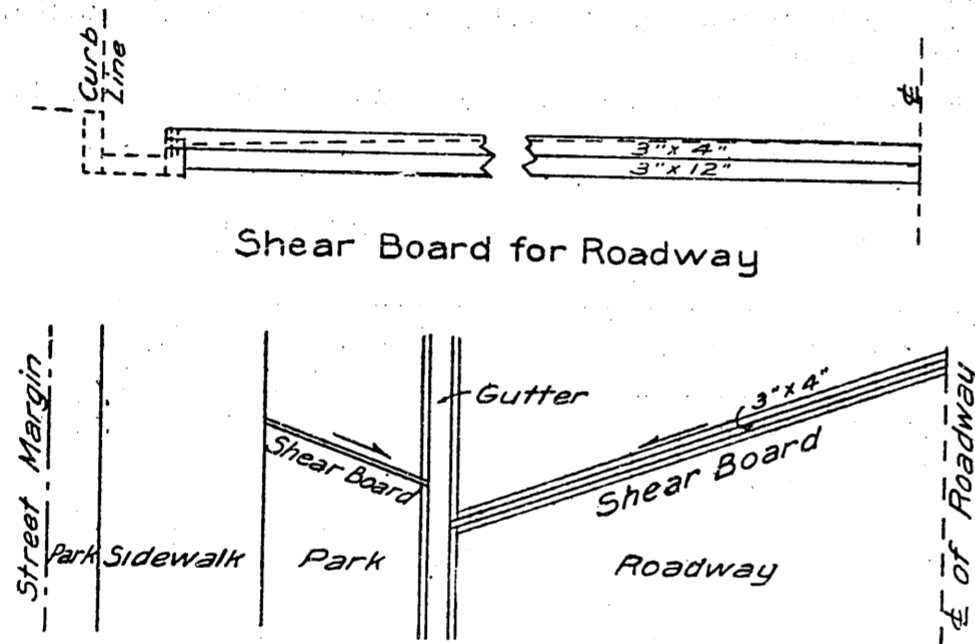

SHEAR BOARDS




SAND BOXES

They shall be well and strongly built, as shown on the detail plans, and shall be well nailed together with 60-penny wire nails. The outlet pipe shall consist of a quarter bend special of the same inside diameter required for connection to main sewer, neatly fitted into the box with the spigot end inside, proper connection between hubs outside being made by a short section of pipe. Inlet boxes and ditches leading thereto shall be constructed for each box as shown in the detail plan. Connection to the main sewer shall be made with eight (8) inch sewer pipe, unless otherwise shown. The lumber shall be sized on two edges.




Payment.—Sand boxes will be paid for at the price bid respectively for Single Sand Box and Double Sand Box, as listed on the proposal, which shall include all labor and ma-

GRADING—Continued

aterials for the box, inlets, ditches and connection to the main sewer, provided, said connection to be not over forty (40) feet in length; 50 cents per foot will be allowed for all extra pipe used beyond the 40-foot connection.

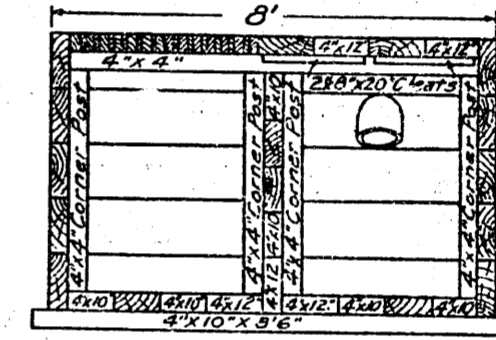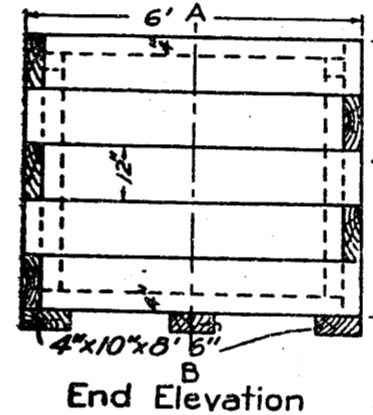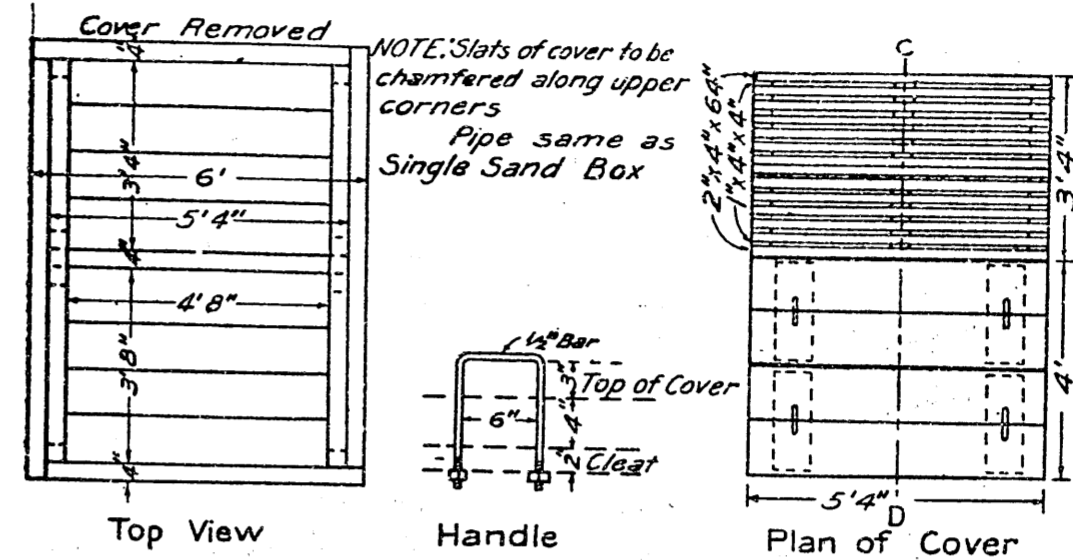


1074 ft. B.M. for 5 ft. depth
117 " " " per foot
DOUBLE SAND BOX

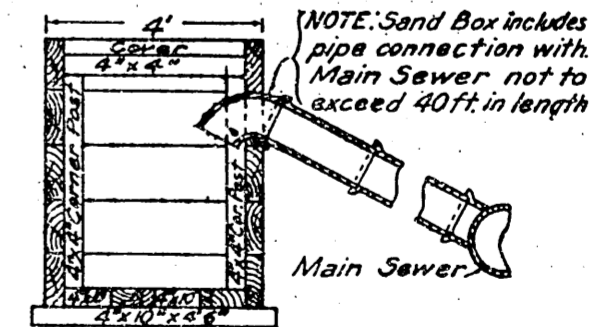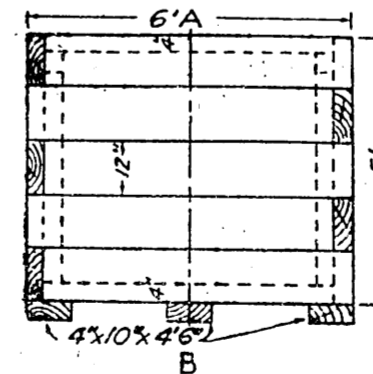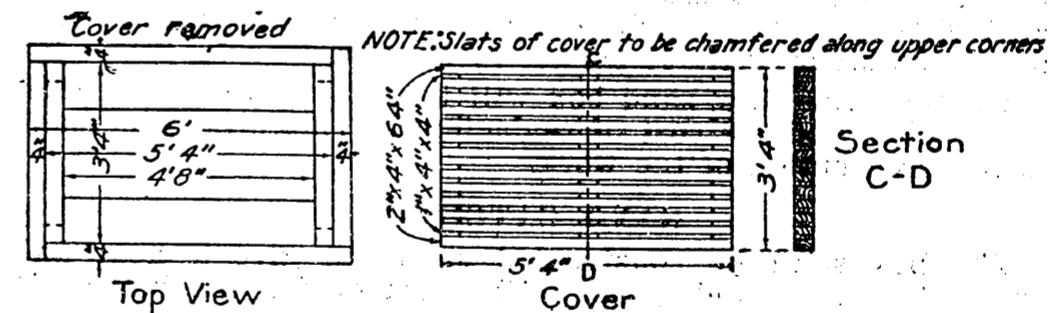


574 ft. B.M. for 5 ft. depth
80 " " " per foot
SINGLE SAND BOX

SINGLE SAND BOX

GRADING—Continued

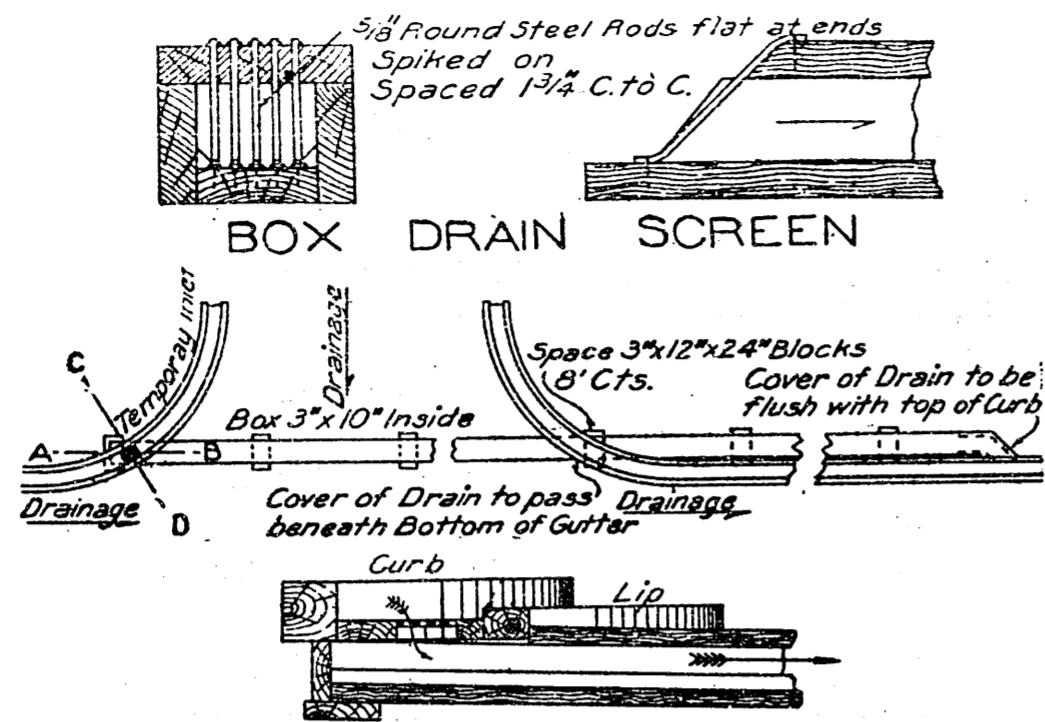

Section
SPECIAL BOX DRAIN

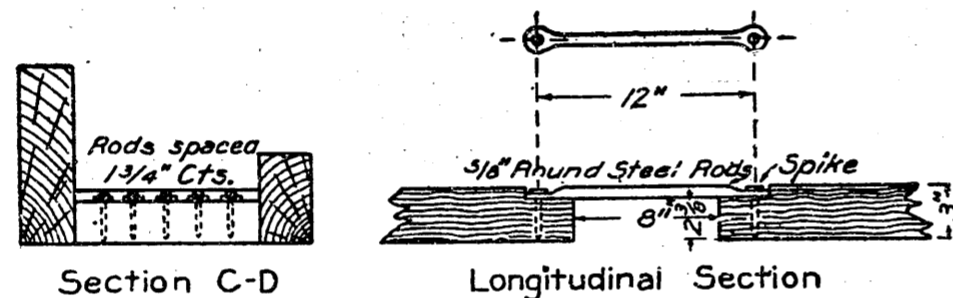


TEMPORARY INLET


Size Inside	Cover	Sides	Bottom	Blocks	Ft. B.M. per lin. ft.
5"x10"	3"x16"	3"x8"	3"x10"	3"x12"x24"	11.58
7"x10"	3"x16"	3"x8"	3"x10"	3"x12"x24"	12.58
9"x10"	3"x16"	3"x12"	3"x10"	3"x12"x24"	13.58
9"x12"	3"x18"	3"x12"	3"x12"	3"x12"x24"	14.58
11"x12"	3"x18"	3"x14"	3"x12"	3"x12"x24"	15.58

Battens 2"x2" Sawed diagonally. Blocks spaced 8' C. to C.

BOX DRAIN SECTION & BILL OF MATERIAL

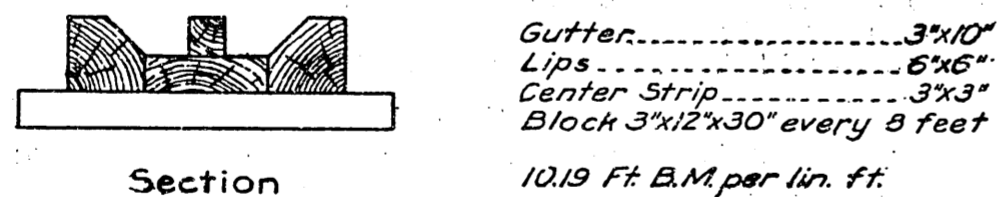

OPEN DRAIN

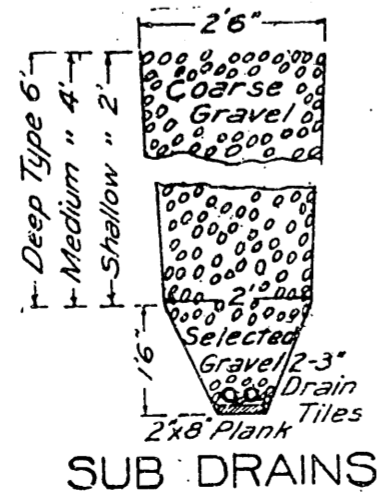

SIDEWALKS


SIDEWALKS

TEMPORARY WOOD WALKS

Where directed by the City Engineer, temporary wood walks shall be constructed of 2"x12" fir planks laid lengthwise and firmly nailed with 20-penny wire nails to 2"x12" blocks laid crosswise every eight (8) feet and properly bedded in the ground. On steep grades, as required by the City Engineer, cross pieces of 1"x2" shall be nailed to the planks every fifteen (15) inches apart with four 10-penny wire nails to each slat.

WOOD SIDEWALKS


The covering planks of sidewalks shall be of fir, surfaced on one side, two (2) inches thick and uniformly eight (8) inches wide. They shall be sawed square at both ends and placed on a true line, both on inner and outer edges of walk.

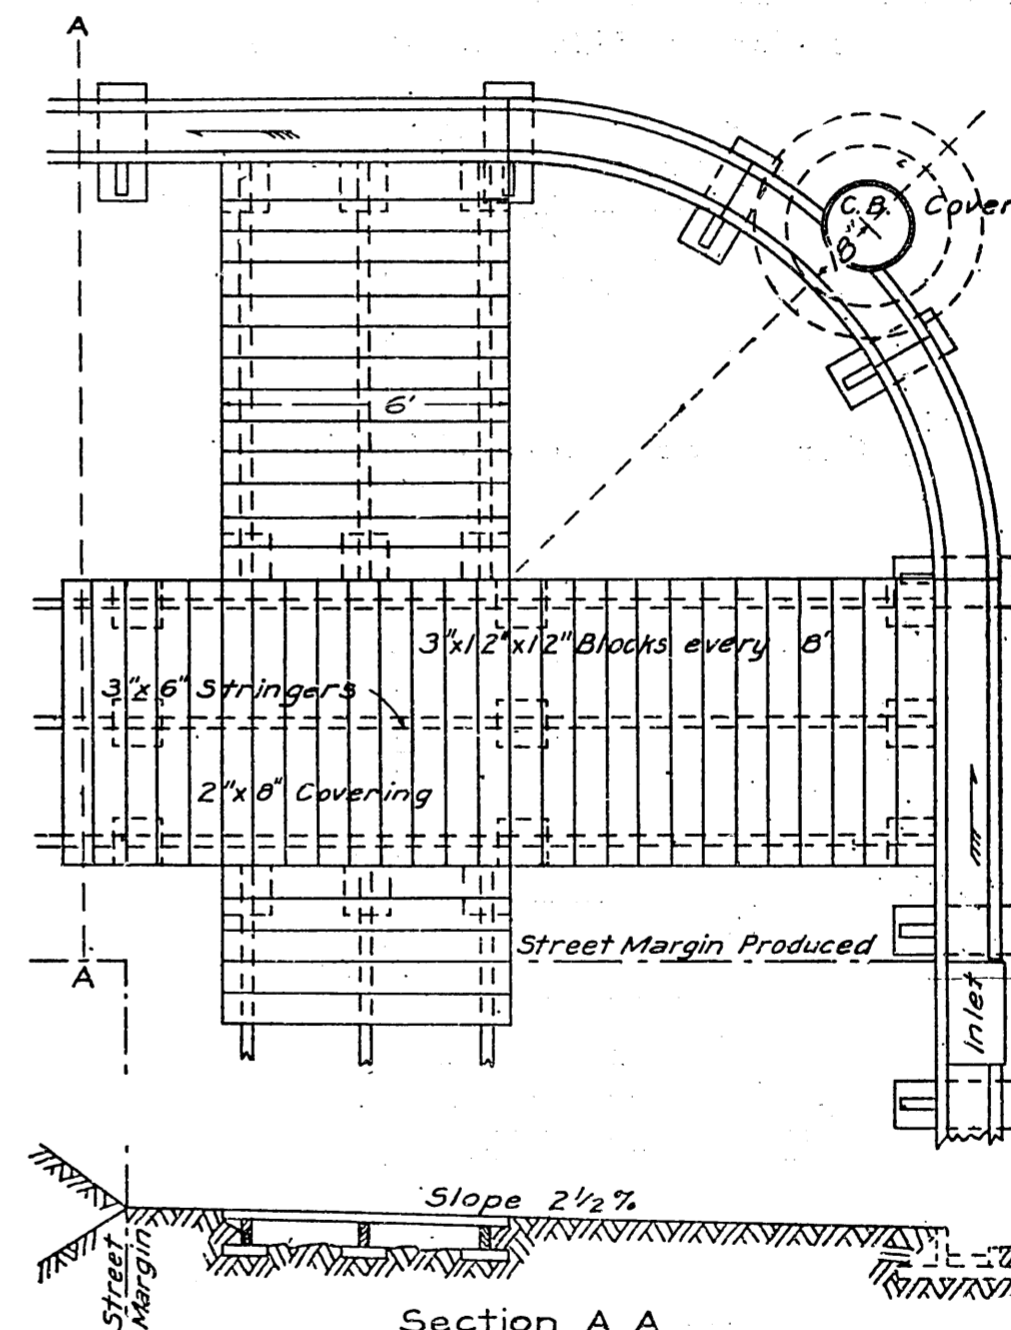


Section A A
6 Ft. Sidewalk, Curb and Gutter
WOOD WALKS

They shall be spiked to the stringers by two (2) 20-penny wire nails to each plank at each stringer. Stringers shall be in lengths of 16, 24 or 32 feet, and shall rest on solid fir blocks, placed not more than eight feet center to center, and under every joint and solidly bedded in the ground. The


SIDEWALKS—Continued

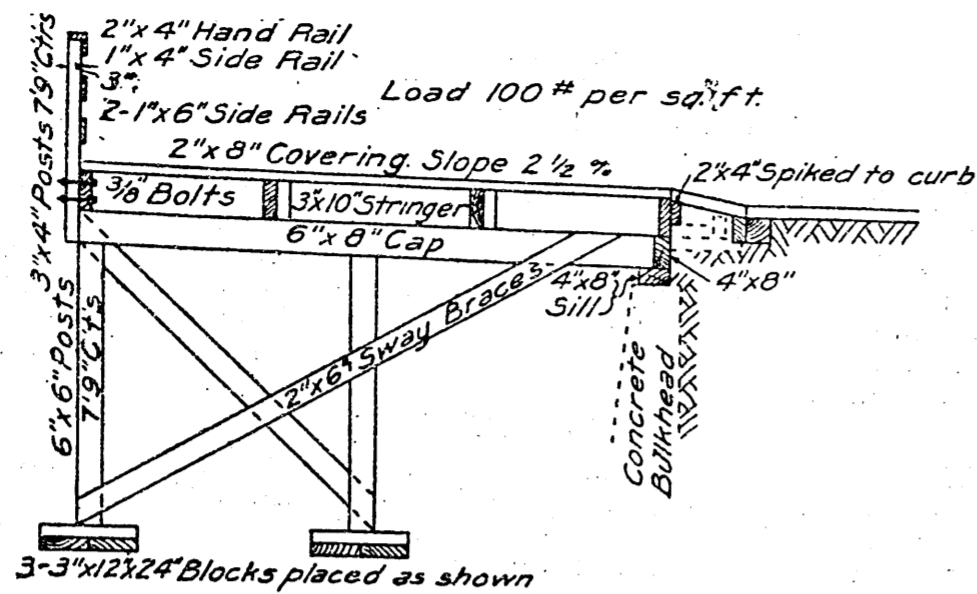

Section of Sidewalk on Posts

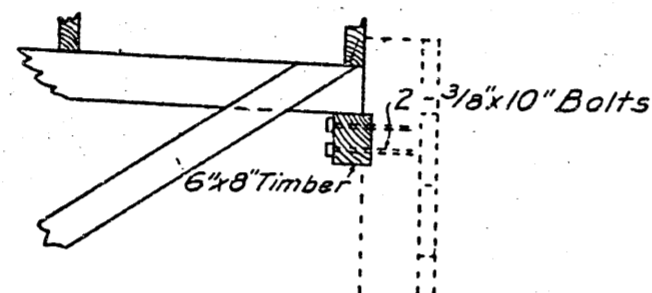

Cap Support on Wood Bulkhead

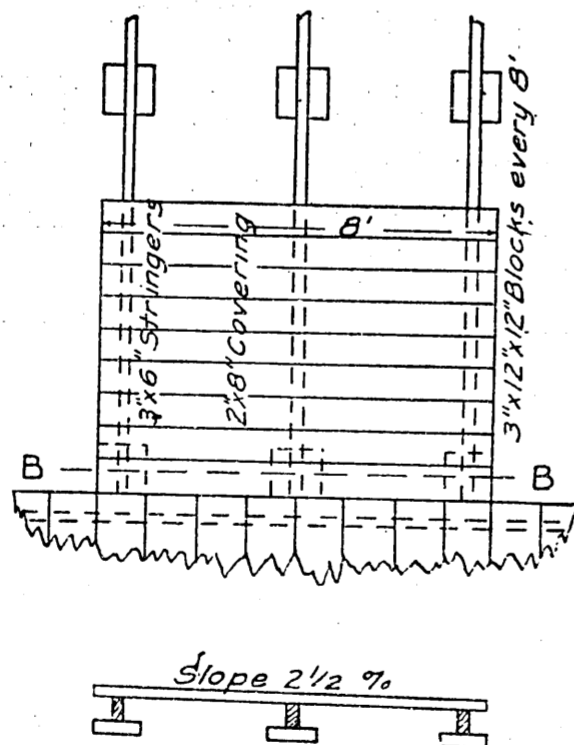

Section B-B
8 Ft. Sidewalk

*Indicates sidewalks when laid on curb

Width of Walk in feet	6	8	10	*10	12	*12
Feet B.M. per linear foot	17.6	21.6	27.5	25.6	31.5	29.6

Bill of Material
WOOD WALKS

SIDEWALKS—Continued

stringers shall be toenailed to each block with two 30-penny wire nails. The lumber shall correspond to that specified for Lumber under Miscellaneous Items.



WOOD SIDEWALKS RELAID

The existing wood walks shall be relaid in accordance with the standard plans and specifications for wood walks, using such of the old lumber as in the opinion of the City Engineer is suitable. The contractor shall pile up and protect all lumber to be relaid and will be held responsible for the safe keeping of the same until it is ready for use. The remaining part of the old walks shall be piled and burned or disposed of as directed by the City Engineer. Any new lumber required will be paid for as such.

Payment will include the handling of all lumber as above specified.

WOOD STAIRWAY

The blocks shall be well bedded in the ground to the proper elevation so that the finished structure will be on grade. The stringers shall be toenailed to the sills with

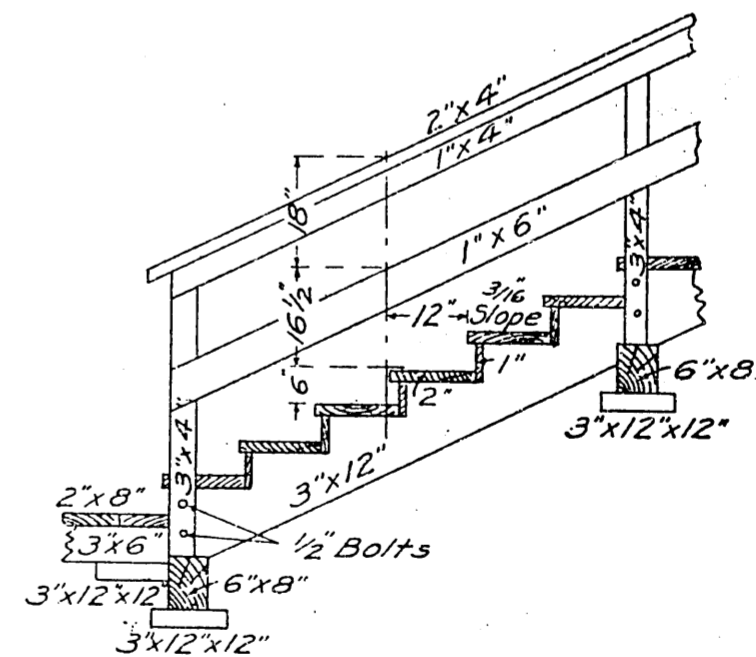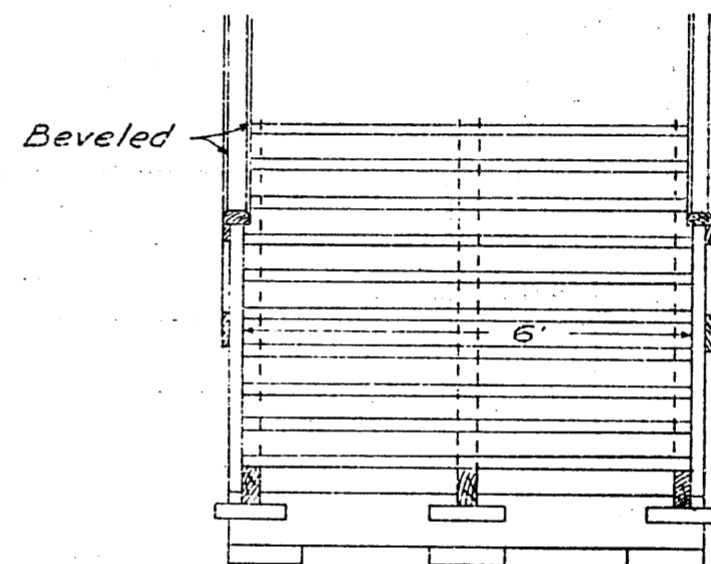

WOOD STAIRWAY

four 30-penny wire nails at each bearing. The stepping shall be nailed with three 20-penny wire nails to each stringer. The riser shall be nailed with two 10-penny wire nails to each stringer. The railing when in position shall


SIDEWALKS—Continued

be painted with two coats of mineral paint mixed with linseed oil, of a color approved by the City Engineer.

CONCRETE SIDEWALKS

Concrete sidewalks shall conform accurately to the lines and grades given, and shall be constructed as follows:

The sub-soil shall be excavated to a depth of about four (4) inches below the finished grade and thoroughly settled and compressed by wetting and tamping. If any filling in

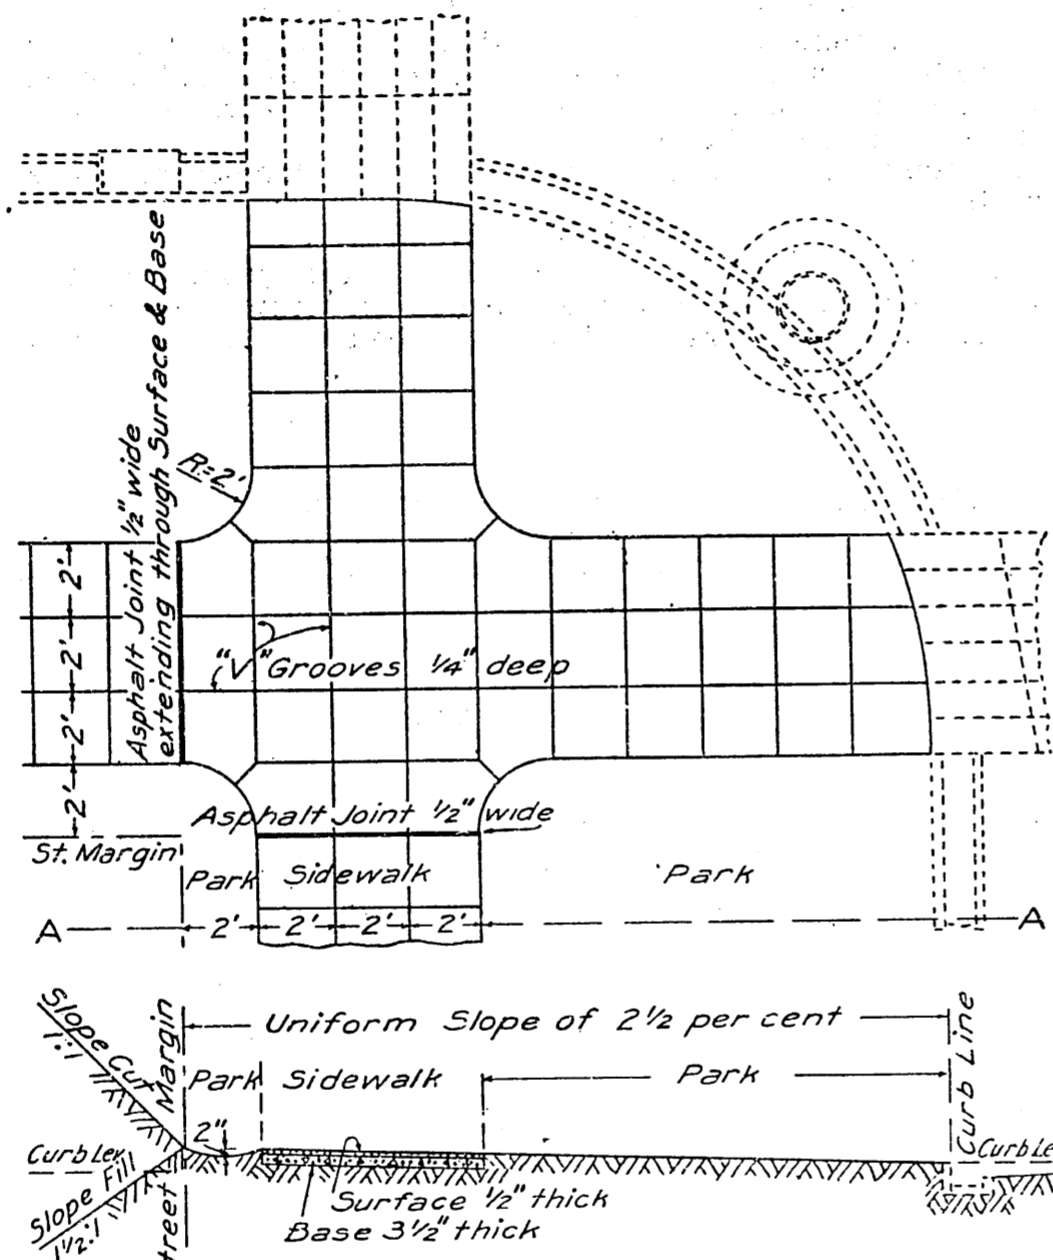

Section A-A
Concrete Sidewalk Intersection

Section of Gutter with Concrete Walk

CONCRETE WALKS

is necessary, it shall be done in the manner hereinbefore specified for embankment under grading.

The contractor shall provide forms of such shape and dimensions as may be required. They shall be made of surfaced lumber, and shall be thoroughly wetted before plac-

W
Fee

SIDEWALKS—Continued

ing the mortar. The cost of furnishing and setting the forms must be included in the price bid for concrete sidewalks. After the forms are set accurately to the grades and slopes given, the foundation shall be brought to the exact sub-grade required and well wetted and smoothed down just before placing the concrete.

Concrete sidewalks shall consist of two courses: First, a bottom course of concrete three and one-half (3½) inches thick, composed of one part Portland cement, three parts sand and six parts gravel or broken stone; second, a finishing or wearing course of cement mortar one-half (½) inch thick, composed of one part cement to one and one-half parts sand.

Cement Specifications.—The cement shall be a true Portland cement, of the best quality, dry and free from lumps and all foreign material. It shall be a cement which usage has proven to possess the proper qualifications and uniformity for the work intended. It shall be delivered on the work in the original packages, in good condition, properly labeled, and must be well protected from rain and dampness. It shall be delivered on the work in advance, in such quantity as to afford the Engineer an opportunity of making tests before the cement shall be used. Each package shall be subject to the following tests:

At least eighty-five (85) per cent. shall pass a No. 200 sieve (40,000 meshes to the square inch) and not less than ninety-two (92) per cent. shall pass a No. 100 sieve (10,000 meshes to the square inch). Cement shall develop initial set in not less than forty (40) minutes, and must develop hard set in not less than two (2) hours, nor in more than ten (10) hours.

As a mortar, mixed one (1) part cement and three (3) part sand, by weight, after one (1) day in moist air and six (6) days immersion in clear water, briquettes of the same shall not break under a tensile strength of one hundred and eighty (180) pounds per square inch; and after one (1) day in moist air and twenty-seven (27) days immersion, they shall not break under two hundred and seventy-five (275) pounds per square inch.

Cement which shall be found to fall below this standard shall be considered rejected cement. The sand used in testing shall be a local sand, passing a No. 20 screen and retained on a No. 30 screen.

In addition to the tests above specified, all cement used on this work shall be subject to such other tests as may be necessary to determine whether or not the cement possesses the proper qualities for the particular work for which it is intended. Should there be discovered, at any time, any characteristics in any cement being used, that are objectionable in this work, or should the cement fail to make good concrete or mortar, its further use on this work will be prohibited, regardless of the fact that it has satisfactorily withstood the tests hereinbefore specified.

All cement used in this improvement is subject to these specifications.

The sand used shall be clean, coarse and sharp. It shall be thoroughly washed until free from loam, clay or earthy particles. Sand will be rejected if more than five per cent. fails to pass a one-fourth inch screen and not more than thirty-three per cent. shall pass a No. 30 sieve. All sand shall range uniformly from fine to coarse. Special care shall be taken in the selection of sand to be used in the wearing surface.

The gravel used shall be thoroughly washed until free from loam, clay or earthy particles. It shall range in size from one-quarter inch to one and one-half inches in di-

SIDEWALKS—Continued

ometer. Care should be taken that the gravel shall range uniformly between these sizes. All gravel will be rejected which shows an undue proportion of fine gravel on the one hand, or large stones on the other, and of which more than five per cent. shall pass a screen having a mesh of one-quarter inch.

Concrete shall be mixed by a batch mixer of a type approved by the City Engineer and which admits of the accurate measuring of materials; the amount of water per revolution of mixer shall be as directed by the City Engineer, or as follows: Upon a tight platform containing 324 square feet, unless otherwise directed by the City Engineer, of evenly laid plank, a correct proportion of gravel shall be evenly spread, and in no case more than eight inches deep. All materials for concrete shall be accurately measured in suitable sized boxes. No counting by shovels or other approximation will be allowed. To determine the proper proportions, a barrel of cement weighing not less than 376 pounds net shall be taken as measuring three and one-half cubic feet. In a separate box the correct proportion of sand and cement shall be mixed dry until the whole mass is one even color. The gravel shall then be wetted and the mixture of dry sand and cement shall be evenly spread over it. The mass shall be turned with shovels not less than three (3) times, and more if necessary, in the judgment of the City Engineer, to secure a perfect mixture of mortar and gravel. In addition to the thorough wetting of the stones, if, in the judgment of the City Engineer it will be necessary, sufficient water shall be added to the mass to enable the material to become thoroughly incorporated, and the process of mixing shall be continued until the surface of each stone is well covered with mortar. The concrete shall be spread upon the foundation as soon as mixed in a layer of such depth that after having been thoroughly compacted with iron-shod rammers, seven inches square, and weighing not less than twenty pounds, it shall not be in any place less than three and one-half (3½) inches thick, and the upper surface shall be parallel with and not less than one-half (½) inch below the proposed surface of the completed pavement. To insure this the concrete shall be struck with a gauge which shall be shod with a steel plate not less than one-eighth (⅛) inch in thickness. The concrete shall be thoroughly tamped or rammed until water appears on the surface. A batch of concrete made with two barrels of cement shall not make more than 200 square feet of sidewalks, and not less than one barrel of cement shall be used for every 56 square feet of finished sidewalk.

When the bottom course is completed, and before the concrete has begun to set, the finishing or wearing course shall be laid down. The correct proportion of sand and cement shall be thoroughly mixed dry until of one uniform color, and sufficient water added to make a mortar of proper consistency. The mortar shall be colored by mixing lampblack therewith, at the rate of about three-quarters (¾) of a pound of lampblack to one barrel of cement. This quantity may be varied to produce the shade desired. The lampblack shall be thoroughly mixed with the cement mortar in such a manner as to produce a uniform and even shade satisfactory to the City Engineer. Special care must be taken to thoroughly trowel down the mortar in order to secure a perfect bond with the concrete base. It shall then be carefully smoothed to a uniform surface, which must not be disturbed after the first setting takes place.

"V"-shaped grooves one-quarter of an inch in depth shall then be made with a suitable tool, dividing the pavement into blocks two feet square. The thickness of the completed

SIDEWALKS—Continued

wearing surface must not be less than one-half inch at any point. On grades steeper than four per cent. the cement coating shall be roughened by finishing with brush, or in such manner as the City Engineer may direct.

At such points as may be directed by the City Engineer, and which shall be approximately sixty (60) feet apart, all concrete sidewalks shall have a joint, extending entirely through the concrete base and wearing surface. This joint is to be made with an iron bar three-eighths inch in thickness at bottom edge and five-eighths inch in thickness at top edge. After removing joint bar, the open joint shall be covered by a strip of wood 1 in. x 4 in. firmly nailed to the forms. When forms are removed, this joint shall be carefully cleaned and immediately poured to within one-half inch of the surface with hot Grade "D" Asphalt, or with Pavers' Pitch No. 6.

When the sidewalk is completed it shall be covered with such material as may be directed and kept moist by sprinkling for at least one week. The sprinkling shall be done as often as may be necessary to keep the sidewalk constantly moist.

The contractor will be required to stamp his name in letters one and one-half inches high and one-quarter of an inch deep, twice in each block on each side of street.

All concrete shall be laid in short sections and immediately covered with the wearing surface. Retempering of concrete or mortar will not be permitted. All mortar or concrete that has begun to set before ramming is completed shall be removed from the work. Any concrete or mortar that fails to show proper bond, or that fails to set after, in the opinion of the City Engineer, it has been allowed sufficient time, shall be taken up and replaced by the contractor at his own expense with new concrete or mortar of proper quality.

Concrete shall not be mixed nor deposited when the temperature is below forty (40) degrees Fahrenheit, unless special precautions are taken to avoid the use of materials containing frost and the work protected in a manner satisfactory to the City Engineer until the concrete has thoroughly hardened.

All walks or driveways connecting with private entrances, or any extra work connected with or incidental to the complete performance of this contract shall be executed by the contractor in a neat and workmanlike manner, in accordance with these specifications or the special directions of the City Engineer in each case.

After the walks have been completed and the forms removed, the slopes and parks shall be neatly and evenly surfaced and smoothed to conform to the lines indicated on the plan.

All parks shall be sowed with white clover seed of good quality, using one pound of seed for each three hundred (300) square feet.

Before the final release of the work all concrete sidewalks will be carefully inspected and sounded for defects, and any hollow or otherwise defective blocks shall be cut out and replaced by the contractor at his own expense. Relaying of top course only will not be permitted.

No concrete sidewalk shall be constructed upon any embankment unless the City Engineer shall consider the same sufficiently settled to afford a stable foundation.

Measurement of concrete sidewalks will be on the slope.

CONCRETE SIDEWALKS REPLACED


The plans and specifications for new concrete sidewalks shall apply in all respects.

Payment will include the removal of the old concrete walk.

SIDEWALKS—Continued

CORRUGATED CONCRETE SIDEWALKS

Materials and methods of construction shall be the same as specified for concrete sidewalks, except that corrugations in

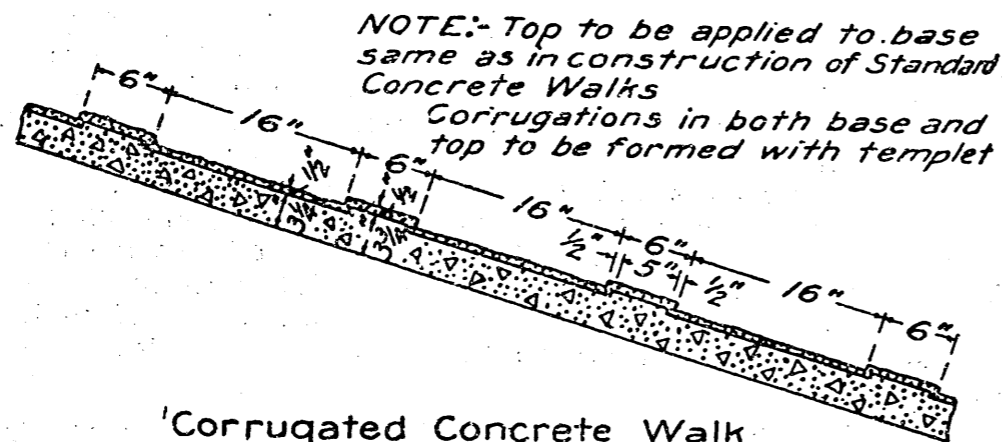

base and top shall be formed with a templet as shown in detail on plans.

CONCRETE STAIRWAYS

The concrete and cement mortar shall be composed of materials of the same quality, mixed in the same proportions and in the same manner as specified for "Concrete Sidewalks." A cement mortar facing, three quarters ($\frac{3}{4}$) inch thick, for the stair risers, treads and coping, shall be composed of one part cement and one and one-half ($1\frac{1}{2}$) parts sand. Special care shall be taken to secure a thorough bond between the cement mortar facing and the concrete base. The contractor will be required to replace, to the satisfaction of the City Engineer, all hollow or otherwise defective steps. The treads of all steps shall have a slope of three-sixteenths ($\frac{3}{16}$) of an inch in order to secure drainage.

On each side of the steps and along the sides of landings, where so indicated on the plans, or where directed by the City Engineer, there shall be constructed a coping or parapet wall and concrete gutter of the dimensions and designs shown on the detail plans. They shall be built in the same manner as specified for concrete steps. Concrete stairways shall be reinforced as shown on plans. The rods extending through the steps shall be hooked or bent around those in the coping. All forms shall be sized lumber.

Concrete landings will be classed as concrete sidewalks, and will be paid for at the rate bid for concrete sidewalks.

Concrete coping and parapet will be paid for as stairs.

Measurement will be taken across the step from outside to outside of coping.

Payment will include the furnishing and placing the steel rods, step armor and forms.


CONCRETE GUTTERS

The materials for the concrete base and the cement wearing surface shall be as specified herein for "Concrete Sidewalks". When the concrete gutter is attached to the concrete stairways the steel rods shall extend into the gutter as shown on the standard plan for concrete stairways.


GALVANIZED IRON RAILING

The upright posts shall be securely set in the concrete so that the entire railing shall be thoroughly rigid and firm. The pipe shall be well galvanized and all fittings of the best

SIDEWALKS—Continued

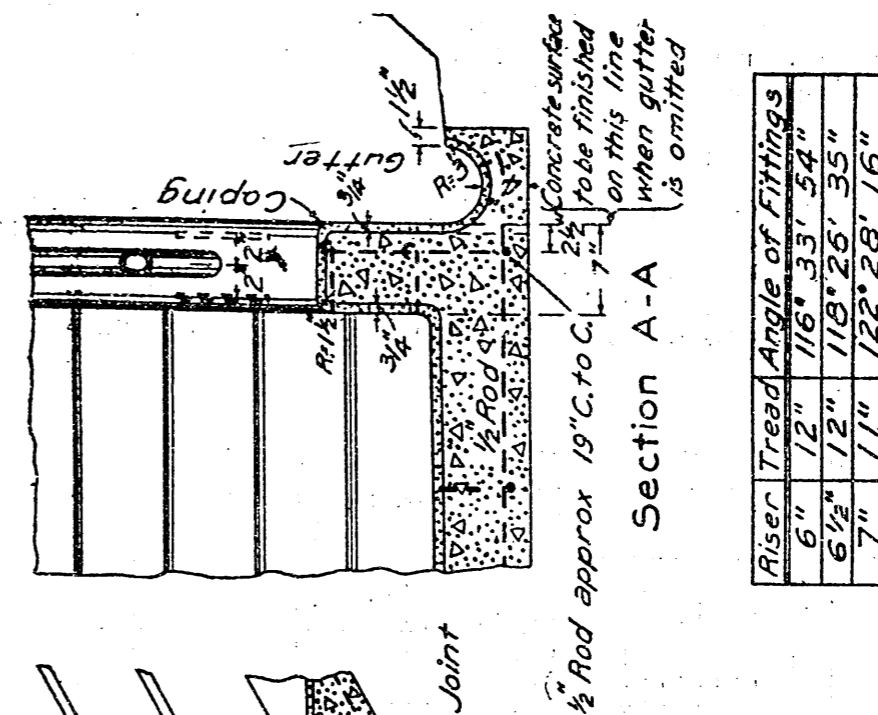

Riser	Tread	Angle of Fittings
6"	12"	116° 33' 54"
6 1/2"	12"	118° 26' 35"
7"	11"	122° 28' 16"

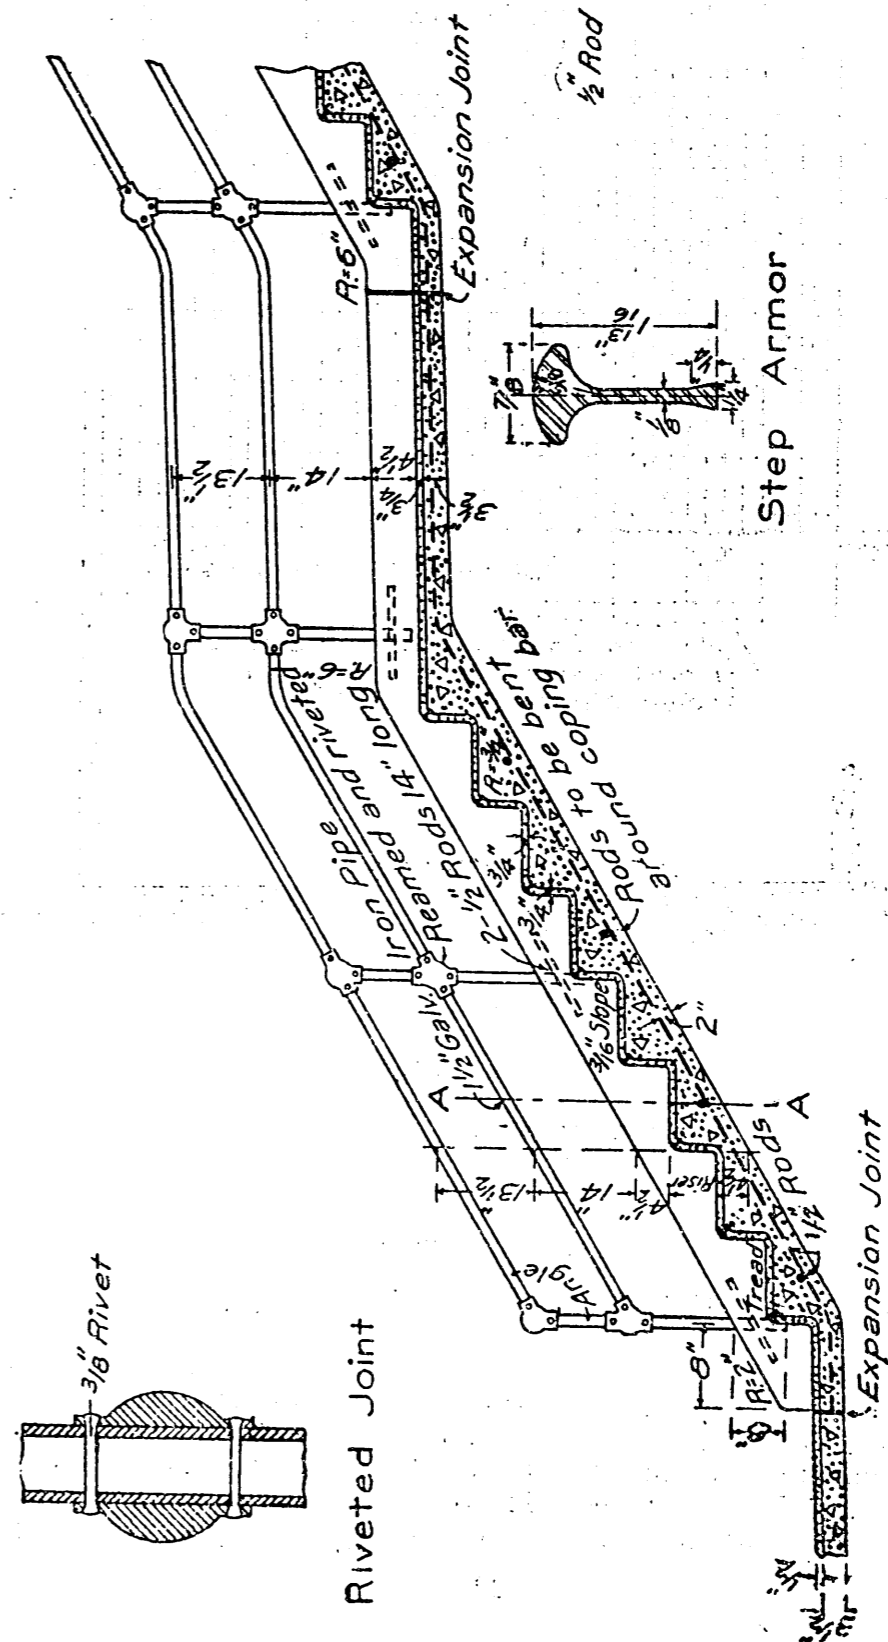

CONCRETE STAIRWAYS


SIDEWALKS—Continued

quality of malleable iron. When in place, the railing shall be painted with two coats of aluminum paint.

Measurement will be on the slope.

CONCRETE ALLEY CROSSINGS

Alley crossings shall be constructed where shown on plan or where directed by the City Engineer. The concrete base shall not be less than four (4) inches thick, and the wearing surface shall not be less than one (1) inch thick. Both concrete and cement shall be composed and laid down as

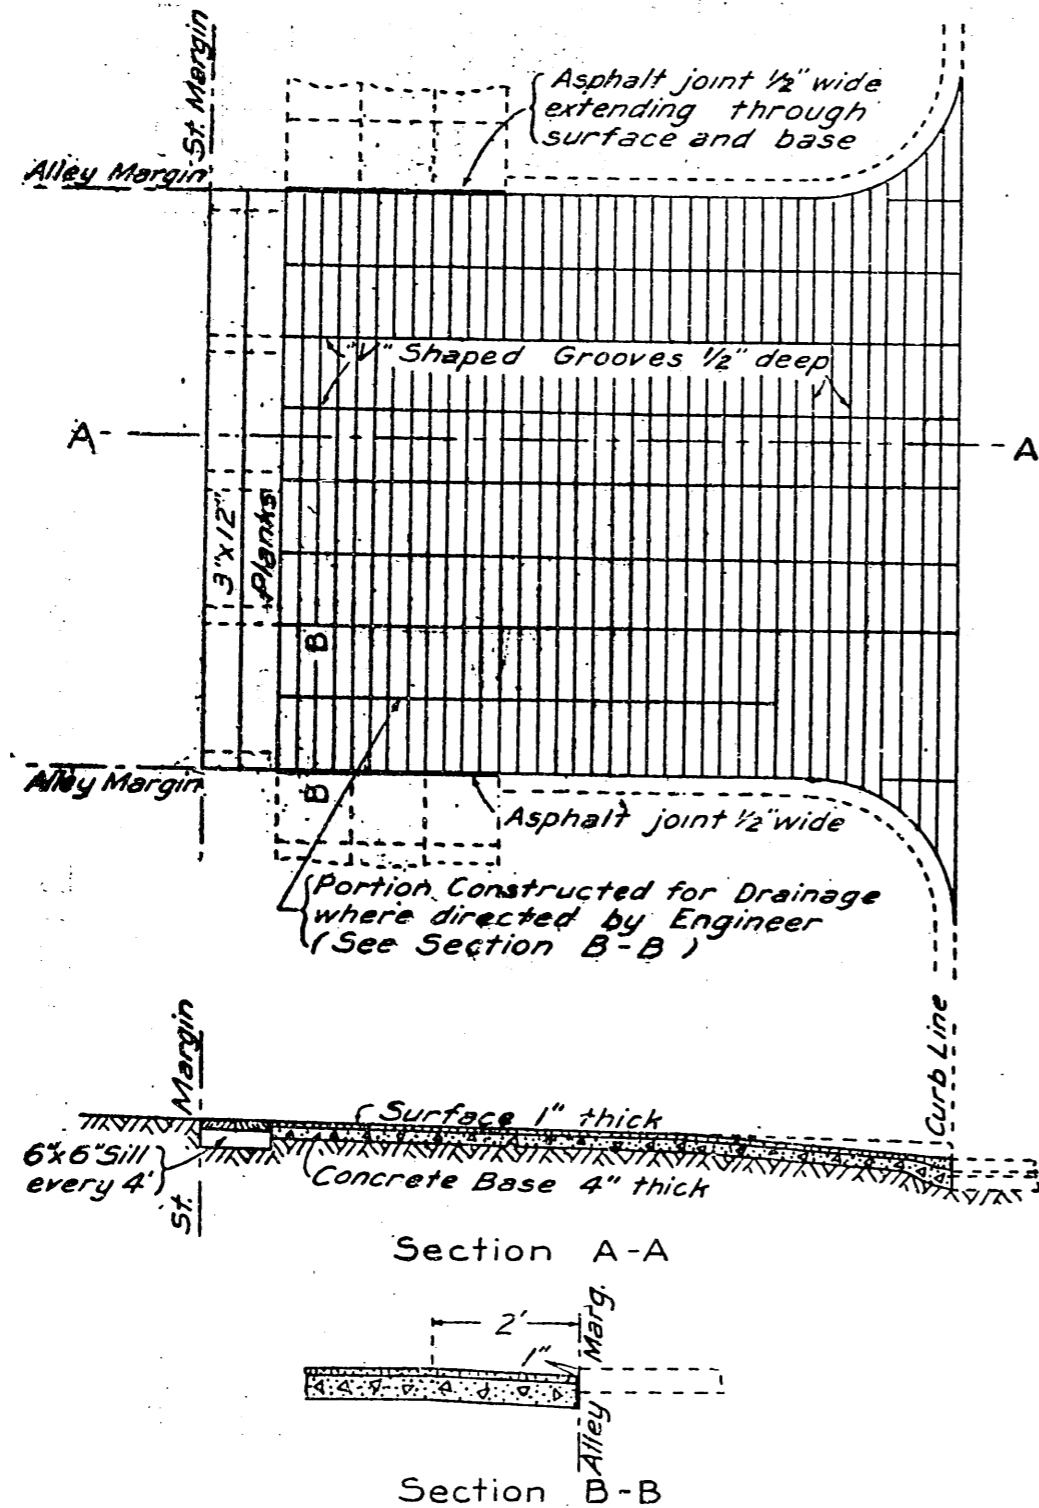


CONCRETE ALLEY CROSSING

specified for concrete walks. The surface shall be roughened as directed by the City Engineer. The lumber placed back of concrete alley crossings shall be classified and paid for as alley crossing lumber whenever there is a bid taken for that item. Whenever there is no bid taken for alley crossing lumber then said lumber back of alley crossing shall be paid

SIDEWALKS—Continued

for as cross-walk lumber. In case there is no bid taken on any lumber then said alley planks shall be paid for at the rate of eighteen (\$18.00) dollars per thousand ft. B. M.

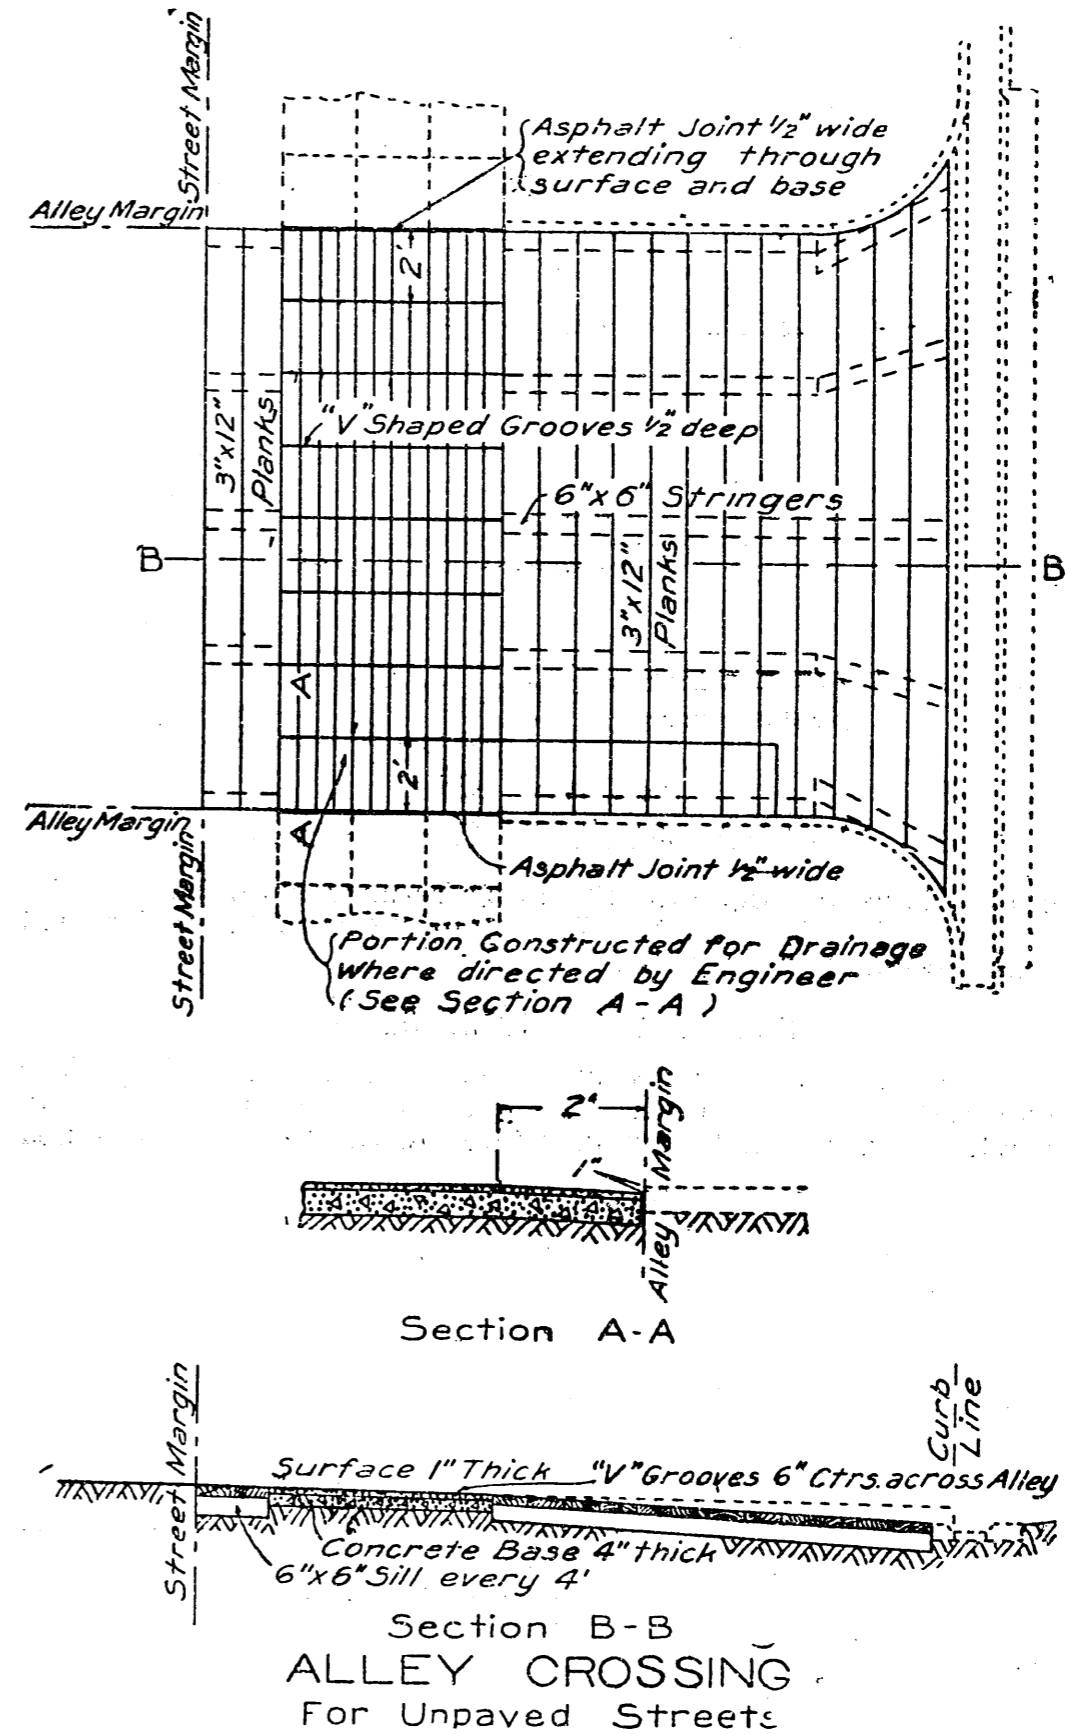


WOOD ALLEY CROSSINGS.

Wood alley crossings shall be constructed in accordance with the specifications for planking.

The ends of planking shall be tightly fitted against the

SIDEWALKS—Continued

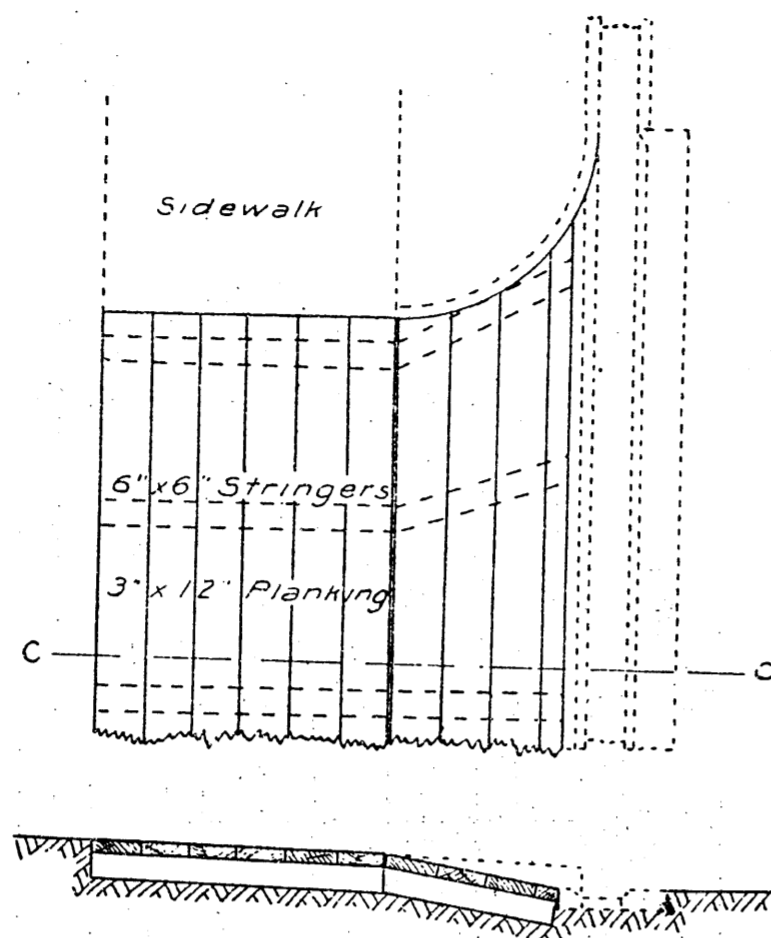


Section C-C
WOOD ALLEY CROSSING


curb. Ends butting into the alley returns shall be cut circular to give tight joints. The planking shall be well nailed with 60-penny wire nails.

THREE INCH TILE DRAINS.

Three inch tile drains shall be constructed back of the sidewalks when directed. The plank shall be laid to a true grade and the trench carefully filled to the top with screened

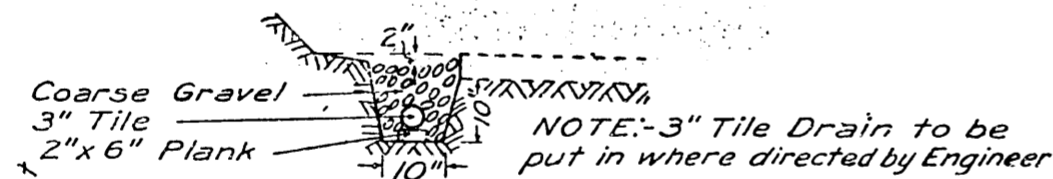

3" TILE DRAIN

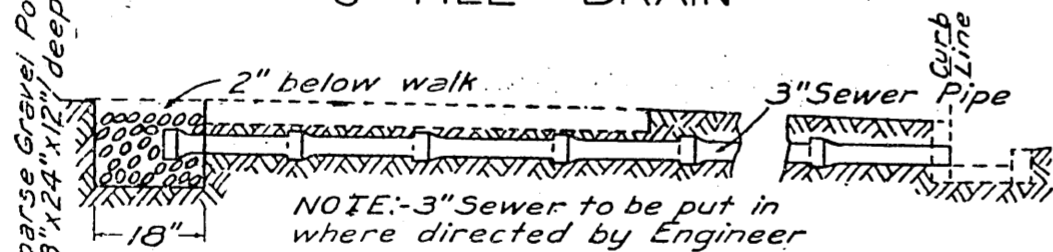

3" SEWER PIPE DRAIN

gravel, small stones or other material approved by the City Engineer.

Payment for three-inch tile drains will include the gravel pocket.

THREE INCH SEWER PIPE

Three (3) inch sewer pipe shall be laid under the concrete sidewalks and extended across the parking strip and through

RETAINING WALLS


the curb. Holes shall be bored through the curb. No cutting of the curb will be allowed. The pipe shall be salt glazed, vitrified sewer pipe, of quality conforming to the standard specifications of the City of Seattle. It shall be laid with cement mortar joints, the mortar to be composed of one part Portland cement to two parts clean sand. It shall be laid close to the concrete and shall be solidly bedded in the ground. The connection to the gutter; the extension of the three (3") inch sewer pipe out through the concrete curb, when necessary; or the construction of a coarse gravel inlet, shall all be done in accordance with the standard plans.

Payment for three-inch sewer pipe will include gravel pocket, boring or extending through curb.

RETAINING WALLS

CONCRETE RETAINING WALLS

Foundation.—The foundation for any retaining wall shall be excavated to the depth called for on the plan, or to such depth as the City Engineer shall determine as necessary to insure a proper footing for the wall. Where the location of the wall comes on soil which, in the opinion of the City Engineer, is not firm enough to insure its safety, piling or

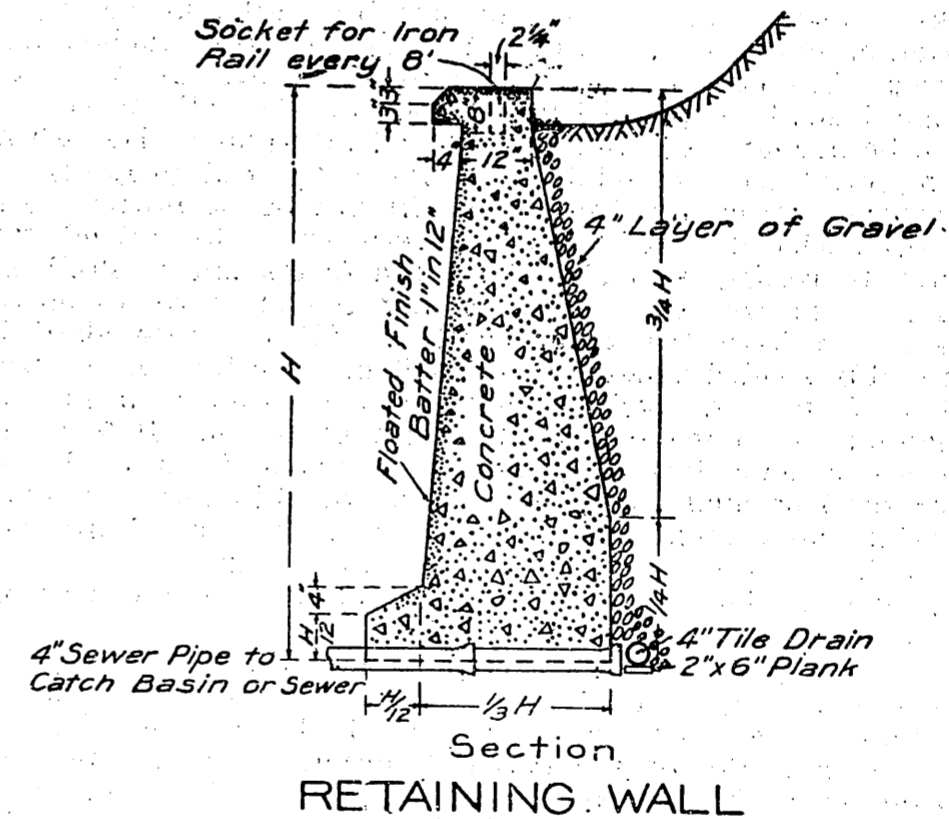

Section
RETAINING WALL

other suitable form of sub-foundation shall be placed, as the City Engineer shall direct. The foundation pits shall at all times be kept dry and free from water by pumping or otherwise as may be directed. Where permanent drainage of the foundation, or other than that shown on the plan is necessary, a suitable tile or sewer pipe drain shall be laid and connected with the sewer or suitable outlet.

Forms.—Forms for retaining walls shall be constructed in accordance with the details given on the plan or, where no details are given, in a manner satisfactory to the City Engineer. They shall be constructed of sound merchantable

lumber thoroughly braced and stayed, so as to produce the finished surfaces true to line and grade, and free from wind or warp or objectionable depressions and projections. Lumber used for forms shall be evenly sized and free from knot holes or other imperfections affecting the finished work. Where monolithic construction is required, particular care shall be taken to construct the forms of sufficient strength to prevent bulging.

All grooves, joints, mouldings, pilasters, panels and copings shall be formed true to line and dimension. Particular care shall be exercised in constructing the forms for copings or other projecting parts of the wall or parapet that the same may be released and allowed to settle slightly after the concrete has partially set in order to prevent the expansion of the form from lifting or cracking the concrete at such projecting portions.

All forms shall be so constructed that in stripping them from the finished work, the edges of mouldings, etc., shall not be defaced.

Concrete.—The concrete used in retaining walls shall be mixed in the proportions of one (1) part Portland Cement, three (3) parts sand and six (6) parts gravel. The proportion of cement to the total aggregate used shall be invariable but the relative proportion of sand to gravel may be varied by the Engineer from time to time.

The materials used shall be of the same quality and mixed in the same manner as herein provided for "Concrete Sidewalks" except that in plain or gravity walls, gravel up to maximum diameter of two and one-half (2½) inches may be used. The concrete shall be deposited uniformly in layers but shall not be deposited in any part of the wall faster than it can be properly handled and spread into place. Depositing the material from a height into place, without proper remixing and spreading the same will not be permitted. Unless otherwise directed, the concrete shall be mixed wet enough to readily spread and fill the forms but it shall not be mixed so wet that there is any tendency to wash the gravel free from the grout coating. All concrete shall be thoroughly spaded as soon as deposited. The face of the wall shall be formed by spading back the gravel therefrom in such a manner as to leave a smooth cement finish. Before any concrete is deposited on top of a previous day's work, the latter shall be made rough by picking or chipping. All loose material and cement scum, or laitance, shall be thoroughly removed, the surface washed clean and then grouted with neat cement. The scum, or laitance, shall be removed before the concrete has set hard.

All walls shall be constructed as monoliths, where practical, that is, any section of a wall shall be deposited in one continuous operation, including the final finish at the top. Where monolithic construction is impractical, for the purpose of keeping each successive step of the work together, a recess six (6) inches deep and of a width equal to one-third the width of the wall shall be left at the end of each day's work for the entire length of such work in all walls where the cross-section is two (2) feet or more in thickness. In thinner walls, the contractor shall furnish and set steel dowel pins not less than three-quarters (¾) of an inch square and two (2) feet long at intervals of not less than three (3) feet for the entire length of each day's work where the same is not brought to the finished height.

In all walls the forms, mouldings, etc., along the finished sides shall be kept cleaned of any dry mortar or concrete which may mar the finished appearance.

Joints.—Joints shall be made in all walls as indicated on

the plan or as directed by the City Engineer. Where joints are required the wall shall be built in alternate sections. In the ends of each completed section shall be formed a recess four (4) inches deep and of a width equal to one-third (1-3) the thickness of the wall, but not exceeding 1 foot, for the purpose of keying the sections of the wall together, or steel dowel pins ¼ of an inch square and two (2) feet long shall be set at intervals of two (2) feet, as may be directed.

Before the intermediate sections are built the ends of the alternate sections shall be coated with one coat of tar pitch or asphalt and four (4) layers of No. 2 tarred roofing felt, each layer of roofing felt being coated with pitch or asphalt as laid.

At the finished face of the wall, the joint shall end in a "V" shaped groove two (2) inches wide and one (1) inch deep unless otherwise shown on the plan.

Finish.—The faces of all retaining walls shall be finished as called for on the plan. Where the kind of finish is not stated it shall be carried out as follows:—As soon as the forms are stripped, the surface of the wall shall be gone over with a chipping hammer and all projections brought down to an even surface. All wires shall be snipped to the surface of the wall and all holes or rough spots pointed up with a mortar of sand and cement of the same proportions used in the concrete.

The wall shall then be floated with a mortar of one part cement to two (2) parts fine sifted sand. The mortar may be applied with a steel trowel but the final finish shall be made with a cork float, all mortar other than just sufficient to fill and true the face of the wall being rubbed off.

The finish shall be an extremely thin coat and uniform in appearance. A plaster finish will not be allowed. The finishing shall be done in a thorough workman like manner giving true lines and edge to all mouldings.

Waterproofing.—The back of the wall shall be coated with tar pitch, asphalt or other approved substance. Unless otherwise directed such waterproofing shall consist of two coats of the substance selected. The waterproofing shall be applied hot and only on a dry surface.

Gravel.—A layer of coarse gravel not less than 4 inches in thickness shall be placed at the back of the wall for its entire height.

Tile Drain.—A tile drain of the size called for on the plan shall be placed at the back of the wall at the bottom and connected to the sewer where shown in the plan.

Backfilling.—The backfilling behind retaining walls shall not be made until the walls have been allowed to set two weeks or longer. The filling shall be made in layers not exceeding one foot in thickness and thoroughly rammed. Filling in with loose earth and puddling the same will not be permitted except by express permission of the City Engineer.

Measurements.—The quantities of materials to be paid for in concrete retaining walls shall be the actual quantities in the completed work. Volumes will be determined by the prismoidal formula.

Payment for plain concrete retaining walls shall include all necessary excavating, concrete, tile drain, dowel pins, joints, backfilling, finishing the surface, mouldings, and the furnishing, placing and removing of all necessary forms.

Piling for sub-foundation work, gravel, waterproofing and extra sewer pipe will be paid for at the rates bid for the same.

RETAINING WALLS—Continued

Reinforcing Steel.—All steel used in reinforced concrete shall be deformed steel bars or rods of the dimensions shown on the plans. They shall be rolled from billets of either open-hearth or Bessemer steel, and shall have an ultimate strength of not less than 80,000 pounds per square inch and a yield point of not less than 50,000 pounds per square inch. The minimum percentage of elongation in eight inches shall be $1,000,000 \div T. S.$ It shall be capable of being bent cold, without fracture, 180° around a diameter equal to three (3) times the thickness of the bar. All steel bars shall be carefully bent to the form required as shown on the plan.

Payment.—Payment for reinforcing steel will be in full for furnishing, bending, fitting and placing the same in the work as called for on the plan. The measurement of steel will be for the length called for on the plan or as the City Engineer may direct to be placed in the completed work.



WOODEN BULKHEADS

Lumber.—All lumber in bulkheads shall be well fitted, bedded and nailed. All posts shall be set on blocks, laid in holes excavated to the depth as shown on the plans, or as directed by the City Engineer. In refilling such holes, the earth shall be thoroughly tamped. "Deadmen" shall be bedded to the depth shown. No excavations, such as trenches for "deadmen" and holes for posts and other unexposed work in bulkheads shall be filled or covered until the same have been fully inspected. All lumber used for bulkheads not exposed, except inspected. All lumber used for bulkheads not exposed, painted with two (2) coats of hot coal tar or some other preparation approved by the City Engineer. The lagging shall be well nailed to the posts using 8" wire nails for four (4) inch lagging and 9" wire nails for five (5) inch lagging. There shall be two (2) nails to each post. Where directed by the City Engineer, concrete of standard mixture shall be placed at the foot of the posts. Payment for concrete will be as listed on the proposal.

Payment for bulkhead lumber will include the cost of digging and refilling of post holes and painting of the lumber.

Iron.—Rods used in bulkheads shall be of good quality of steel and shall be of the dimensions shown on the plans. Threads at each end shall be eight (8) inches in length. All rods shall have welded ends two (2) feet long, three-eighths ($\frac{3}{8}$) inch larger than main rod. Each rod shall be provided with the standard size nuts and six-inch washers. All shall be thoroughly painted with two coats of "P. & B." or other preparation approved by the City Engineer. Blocks of the dimensions shown on the plans shall be used under each washer and will be included in the measurement of lumber used.

RETAINING WALLS—Continued

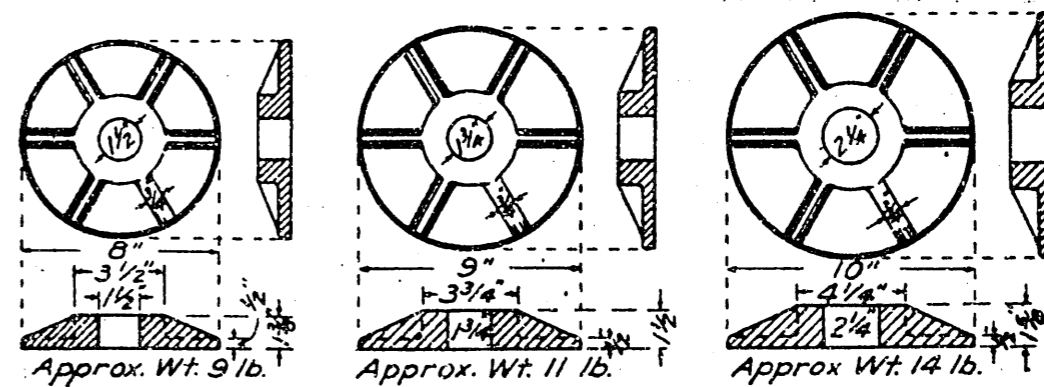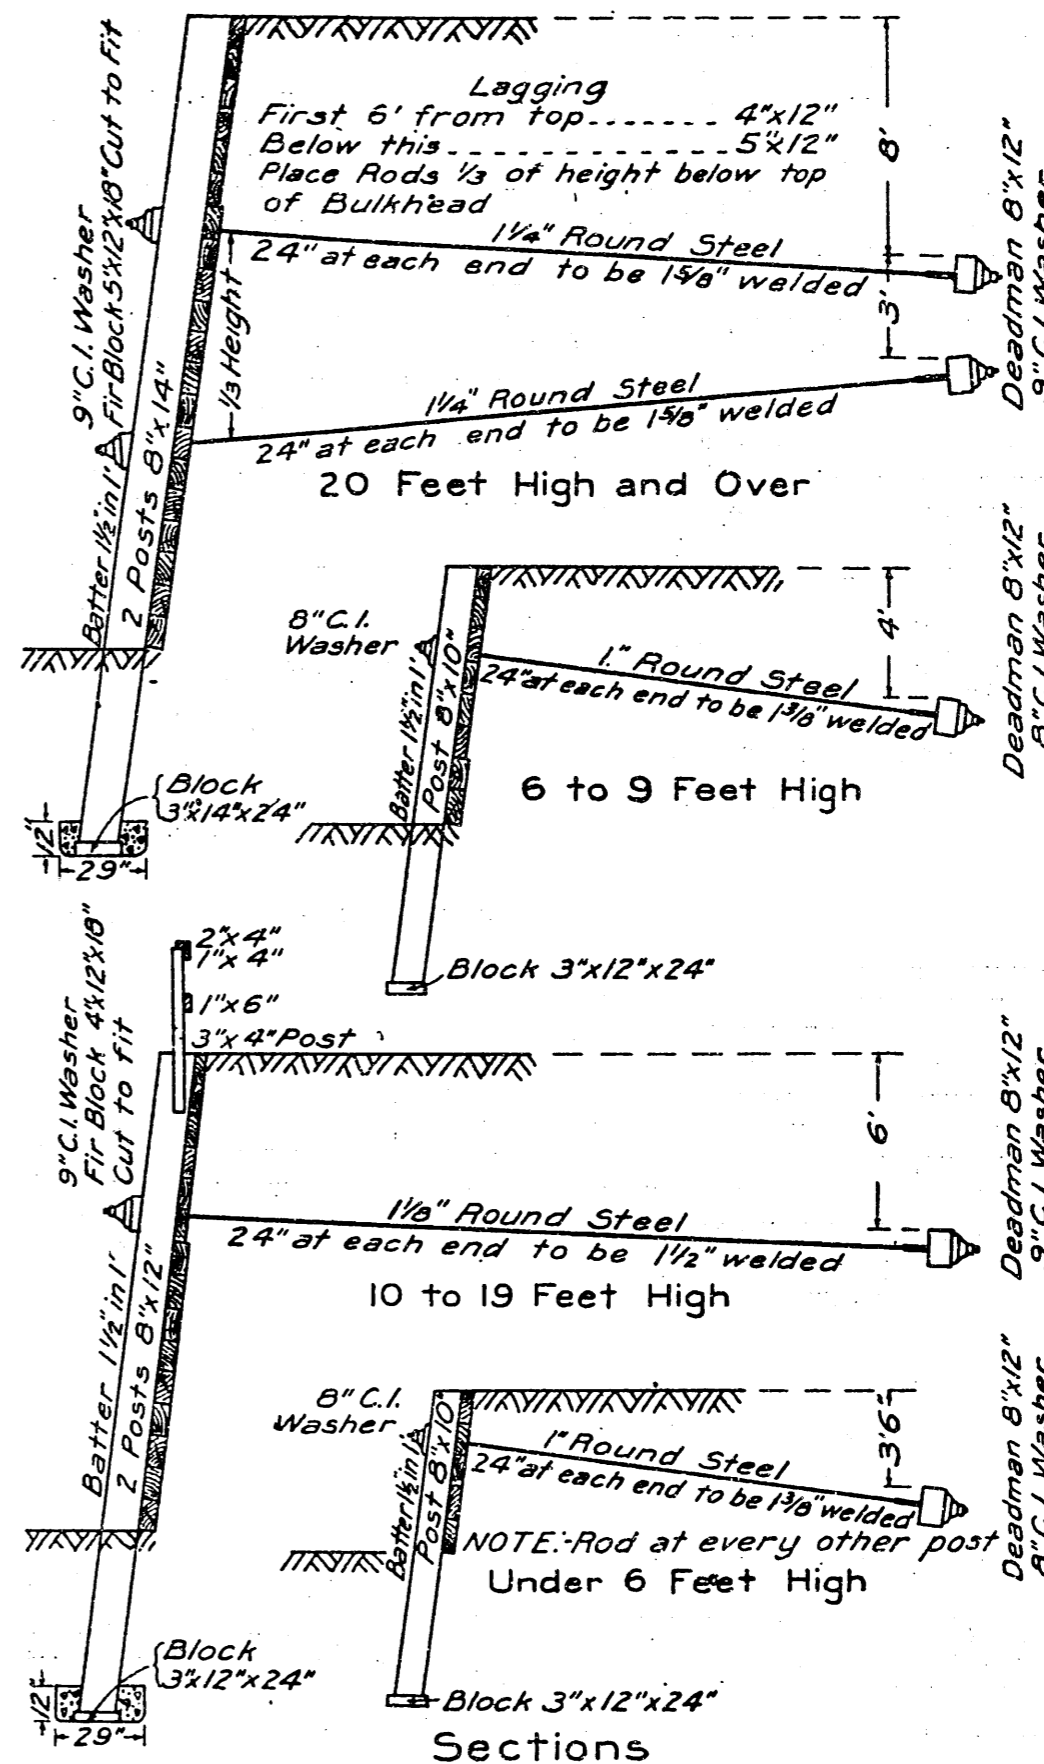

WOOD BULKHEAD

to have an iron shoe projecting accurately at right angles to the rod a distance of about five (5) inches.

Trenching.—The ground shall be excavated to the required depth and width, principally in open trench. The completed trench shall be kept not less than thirty (30) feet ahead of the pipe layers. The trenches shall be at least six (6) inches wider on both sides, or a total width of twelve (12) inches more, than the exterior diameter of the pipe. If rock is excavated it must be removed to a depth of four (4) inches below the bottom of the bell and the trench refilled with sand well tamped.

The contractor shall furnish all necessary machinery for the work, shall pump, bail or otherwise remove any water which may be found or which may accumulate in the trenches, and shall perform all work necessary to keep them clear of water while the foundations and the masonry are being constructed or the pipe laid.

When necessary the sides of the trench shall be braced and rendered secure, and either open or close sheathing used, to the satisfaction of the City Engineer. The cost of all such sheathing must be included in the price bid per linear foot for the completed sewer, and no extra payment beyond such price will be allowed.

Tunneling.—Where the trench is ten (10) feet or more in depth, tunneling may be resorted to. Open trenches between tunnels shall not be less than eight (8) feet in length, and the tunnels shall not be more than two (2) feet longer than the depth of the trench. Tunnels shall be at least two (2) feet higher than the diameter of the sewer, but in no case less than four (4) feet high and two (2) feet wide.

Pipe Laying.—Before being laid the pipe and specials must be carefully inspected for defects, and those not meeting the foregoing specifications shall be rejected. The accepted pipe shall then be fitted together, matched and marked, before being lowered into the trench, and must be laid as marked. The pipe must be so laid in the trench that after the sewer is completed the interior surface thereof shall conform accurately to the grades and alignment given by the City Engineer. All adjustment to line and grade must be done by scraping away or filling in the earth under the body of the pipe and not by blocking or wedging up. Great care must be exercised that the pipe has a full, solid bearing along its entire length. Before laying the interior of the bell shall be carefully wiped clean and the lower part well covered with cement mortar before the insertion of the spigot end. Special care must be taken that the annular space at the sides and bottom, as well as the top of the joint, is well filled with mortar, which must be thoroughly worked in.

The cement mortar for filling the joints shall be composed of one (1) part cement and two (2) parts sand.


Cement Specifications.—See page 17.

All sand shall be clean, sharp, washed sand, free from loam, clay or vegetable matter.

The mortar shall be thoroughly mixed just before being used. Any mortar which has begun to set shall be thrown away and fresh mortar used.

As soon as each join of pipe has been properly placed and jointed, the spaces between the pipe and sides of the trench shall be carefully filled with sand or fine earth and well rammed under and around the pipe. Sufficient filling and tamping must be done to hold the pipe firmly in position. The joint must be checked for line and grade before the next succeeding joint is placed.

Running water shall at all times be kept from the joints

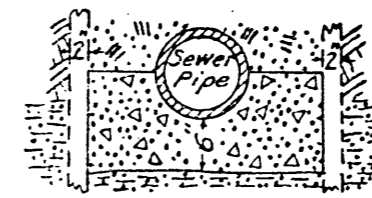

SEWER SUPPORT
IN QUICKSAND

for at least twelve (12) hours after completion, and if at any time it be the judgment of the City Engineer that it is necessary to do so, he may require the joint to be caulked with oakum before being cemented.

Where quicksand is encountered, the pipe shall be bedded in concrete, as shown in detail on the plans. All concrete used will be paid for at the rate bid for the same per cubic yard; such payment to be in full for furnishing and placing in position all material required.

Wyes will be placed at the positions shown upon the plan or as directed by the City Engineer. An earthenware stopper must be used to close the open end of each wye. The inclination given each wye, unless otherwise directed by the City Engineer, will be about thirty (30) degrees above the horizon.

The interior of the pipes shall be carefully cleaned from dirt, cement and superfluous material of every description. Each joint shall be carefully scraped as the work progresses, or, when directed by the City Engineer, a wad made of a sack filled with hay, large enough to fill the pipe and attached to a rod or cord, shall be kept in pipes eighteen (18) inches or less inside diameter, and drawn forward as the work proceeds, care being taken not to loosen the joints.

Back Filling.—Back filling shall follow close after the pipe laying, and in no case more than 200 feet in the rear, unless special permission is obtained from the City Engineer. The earth shall be filled in and well rammed in layers, not exceeding one foot in thickness, up to the surface of the street, and in no case shall the number of men filling exceed the number of men ramming. Special care must be taken, in filling and ramming the first layer, not to disturb the pipe. No walking on the pipe will be allowed until at least nine (9) inches of earth has been placed upon it. In lieu of ramming, the earth may be thoroughly flushed or water settled.

Payment will include furnishing and laying the pipe and specials, the removal of existing sewers, all connections to existing sewers, the adjustment of inverts to existing man-holes, as shown on the plan and as directed by the City Engineer, earth excavation, sheathing, pumping, back filling, restoring the street surface, hauling away surplus earth and material, and all other work and material required by these specifications or necessary to give a finished result.

BRICK SEWERS

Quality of Brick.—Where shown on the plans or as directed by the City Engineer, oviform or circular brick sewers shall be constructed in accordance with the details shown on the plans. The brick used for the inverts shall be selected, perfectly-shaped, straight-edged brick, burned hard entirely through in all respects equal to first-class paving brick. They shall not absorb more than three (3) per cent. by weight of water after being thoroughly dried and immersed in water for forty-eight (48) hours. When broken the fracture shall be uniform throughout, not granular, and free from pebbles. No brick will be accepted which contain lime or other substances which may cause spalling, or pitting of the surface when the brick have been soaked in water for

SEWERS—Continued

three (3) consecutive days and then exposed to the air for the same length of time. Where shown on the plans, the inverts and arches shall be constructed of wedge-shaped brick. The brick for the remaining portions of the sewers shall be a good quality of sound, hard-burned, perfectly-shaped, hard-ringing brick, presenting a smooth and regular surface. They shall be made from well-ground clay, free from lumps or pebbles, and when thoroughly dried and immersed in water for twenty-four (24) hours they shall not absorb more than six (6) per cent. by weight of water.

Brick Laying.—None but sound, whole brick shall be used in the construction of sewers, except as may be specially directed. All brick shall be thoroughly wetted immediately before being laid. They shall be laid in straight courses, parallel with the axis of the sewer, with "push" joints, so as to thoroughly fill every joint with mortar. The mortar shall be composed of one (1) part Portland cement to two (2) parts of sand. The cement and sand and mortar shall conform to the foregoing specifications for pipe laying. All joints shall be as nearly as possible of a uniform thickness and not exceeding three-eighths ($\frac{3}{8}$) of one (1) inch. On the inside of the invert the joints shall not exceed one-eighth ($\frac{1}{8}$) of one (1) inch in thickness. All joints on the sides and on the invert shall be struck when laid. The upper arch shall be built upon strongly made centers. The crown of the arch shall be thoroughly keyed with stretchers and all joints shall be well filled with mortar. The centers shall not be withdrawn until the mortar is well set. The exterior surface of the upper arch shall be covered with a coat of mortar, not less than three-eighths ($\frac{3}{8}$) of one (1) inch in thickness. All brick work shall be thoroughly bonded. The unfinished ends of all sewers shall be racked back in courses. No "toothing" will be allowed. The finished sewer shall conform accurately to the dimensions and shape shown in detail on the plan. Slants, of the diameter shown on the plans, shall be furnished by the contractor and set where directed, in a neat and workmanlike manner, and to the satisfaction of the City Engineer. Each slant shall be provided with an earthenware stopper.

Back Filling.—After the masonry shall have become thoroughly set and hardened, the trenches shall be refilled. Special care shall be taken in filling around the sides of the sewer and to the depth of one (1) foot over the top of the pipe. The earth for this portion of the sewer shall be deposited in layers not exceeding six (6) inches in thickness, and thoroughly rammed. In no case shall the number of men filling exceed the number of men ramming. After the fill has been brought to a depth of not less than one (1) foot over the top of the outside arch, the remainder of the trench may be filled in the ordinary way and thoroughly water settled.

Measurements of each size of pipe or brick sewers constructed will be made on the slope from center to center of manholes.

Payment will include the slants, excavating, sheathing, pumping, back-filling, and all other labor and material necessary for the finished work.

SIDE SEWERS

Side Sewers shall be constructed in accordance with the standard plans and specifications for sewers. The top of side sewer connections at the curb line shall be one (1) foot

SEWERS—Continued

above the top of the main sewer unless otherwise directed by the City Engineer.

Existing side sewers shall be relaid in the manner provided above for side sewers.

WOODEN BOX SEWERS

All lumber for sides and bottom shall be sized on one side and two edges. The box shall be laid to a true and even grade, well nailed together with 60d wire nails and shall be made practically water tight.

Payment for wooden box sewers will include all excavation.

SUB-DRAINS UNDER SEWER.

A sub-drain of size indicated shall be constructed of sewer pipe laid with open joints, and surrounded with gravel. At suitable intervals sumps may be constructed if proper provision be made to prevent sand and other material from run-



SEWER SUB DRAIN

ning and undermining the adjacent masonry. After the completion of the work, these openings shall be filled with concrete or brick work surfaced and finished in the same manner as in the main sewer.

Payment will include all pipe, gravel, and necessary excavation.

BRICK MANHOLES

The excavations for all manholes and flush tanks shall be sufficient to leave six (6) inches in the clear between their outer surfaces and the bank or timber used to support it. Brick shall be of good quality, sound, hard and evenly burned, made of clay, free from large lumps or large pebbles that will not pass between rollers set three-eighths of an inch apart. Unduly warped, clinkered or badly fire checked brick will be rejected. When thoroughly dried and immersed in water for twenty-four hours, brick used in the construction of manholes shall not absorb more than ten (10) per cent. by weight of water. Brick shall be wetted just before being used and shall be laid with shove joints. Mortar used shall be composed of one (1) part Portland cement and three (3) parts sand. The cement and sand conform to the foregoing specifications. Special care shall be taken to see that all joints are well filled with mortar. The covers of manholes shall be brought accurately to the grade given. The channels in manholes shall conform accurately to the sewer grade. In the case of pipe sewers, split pipe shall be used for the inverts to these channels where possible. Where a curve in the channel or some other condition prevents this, the channel shall be formed of bricks on edge, set in mortar. Brick channels shall be lined with cement mortar, one-quarter ($\frac{1}{4}$) inch thick, mixed one part cement to one part sand, and shall be exactly semi-circular and of the diameters of the pipes which they connect. If these be of different diameter, the channel shall taper uniformly from one to the other.

SEWERS—Continued

never less than twenty (20) minutes. When permitted by the City Engineer, castings may be painted with three coats of Smith's Durable Metal Coating, or some other approved composition. Connections to manholes shall be made by reconstructing inverts as shown on the plan or as directed by the City Engineer.


Payment for adjusting inverts will be included in the price bid for manholes.

All manhole, catch basin and flush tank covers shall have an even bearing on the frame.

Concrete for base or footing shall be composed of one (1) part Portland cement, two (2) parts sand and five (5) parts gravel or broken stone.

Where the foundation is in hardpan, the City Engineer may order the modified form of manholes, as indicated by dotted lines on the plan, involving a less amount of excavation and of brick work. A deduction of five dollars (\$5.00) from the price bid will be made for each manhole so modified.

All manholes in ungraded streets shall be built to the street grade shown on the plan, but shall be extended to the surface of the ground as hereinafter provided. (See "Manhole Extensions.")

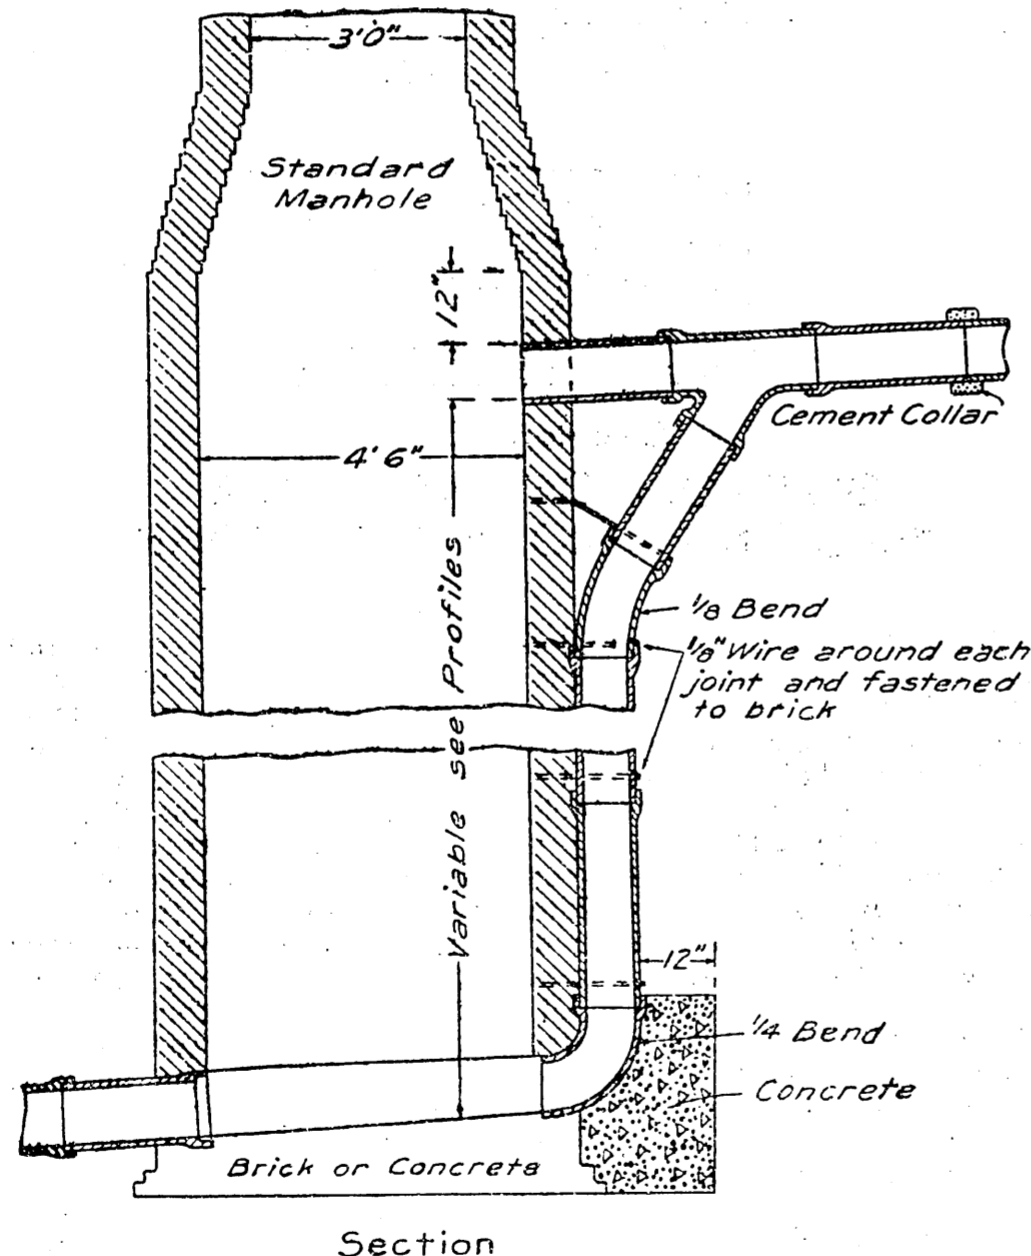

Section
DROP MANHOLE

SEWERS—Continued

Where shown on the plan, existing manholes shall be re-adjusted in such manner as to permit a proper connection for the new sewer, in accordance with the details given. The cost of such work, including all labor and material required, shall be included in the price bid per linear foot for the completed sewer, and no extra payment will be allowed therefor.


DROP MANHOLES

The plans for standard Manhole will apply for drop manholes except as more particularly shown in detail on Standard Plan for drop manholes. The specifications for standard manholes shall apply for drop manholes except as hereinafter provided. The vertical sewer pipe shown on plan shall be supported by concrete surrounding the pipe with a uniform width of twelve inches. This concrete shall be composed of one (1) part Portland cement, three (3) parts sand and six (6) parts gravel or broken stone. The pipe shall be securely bound to the manhole by one-eighth ($\frac{1}{8}$) inch wire fastened around the pipe and carried through the wall of the manhole. Where the two spigot ends of the horizontal sewer pipe meet they shall be united by a cement collar of ample size and strength to firmly hold the pipe.

Payment will include furnishing and placing the vertical sewer pipe above described, concrete blocking, wire, etc. The horizontal pipe will be paid for as pipe sewer.

BRICK FLUSH TANKS

The specifications above for manholes shall apply to flush

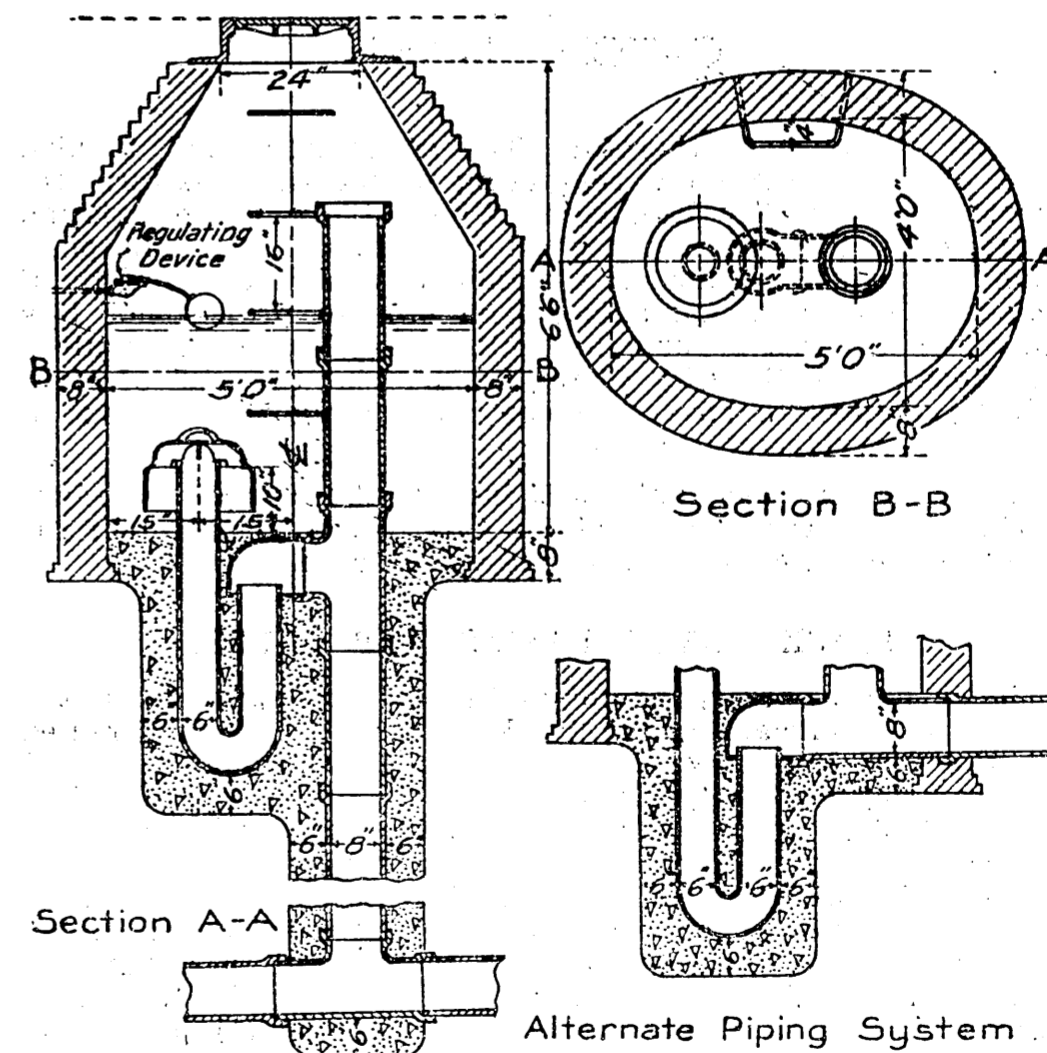


Section A-A
Section B-B
Alternate Piping System
FLUSH TANK

SEWERS—Continued

tanks in regard to brick work and general requirements for castings.

Flush tanks shall be plastered on the inside with a coat of cement mortar one-quarter ($\frac{1}{4}$) inch in thickness, mixed one part cement to one part sand. Flushing apparatus shall conform to the detail plans. Other designs of flush tanks may be used, provided that detail plans thereof shall have been submitted to the City Engineer and approved by him. Flush tanks shall be connected to the nearest watermain by a one-half ($\frac{1}{2}$) inch galvanized iron pipe. The tap shall be furnished by the City Water Department and the contractor shall deposit with said department the sum of eight (\$8.00)

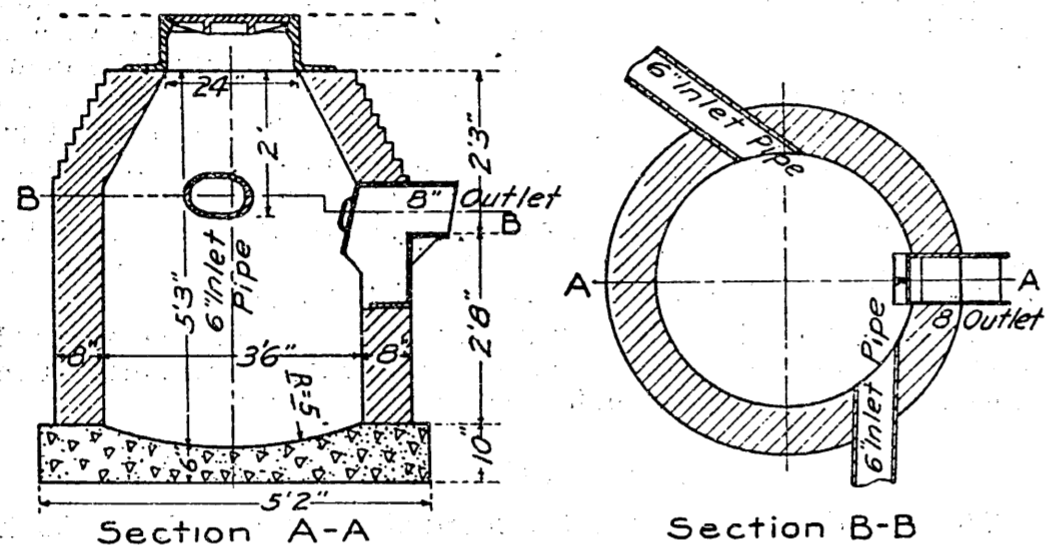

CATCH BASIN


dollars in payment therefor. The contractor shall furnish and place in position a regulating device of a pattern approved by the City Engineer. Where there is no existing watermain, the contractor shall furnish and place in position the regulating device, together with sufficient length of one-half ($\frac{1}{2}$) inch galvanized iron pipe to project not less than two (2) feet beyond the tank. He will also be required to deposit with the City Water Department the sum of eight (\$8.00) dollars to cover the cost of making the connection when the watermain is laid.

Payment for flush tanks will include the cost of the regulating device, the price paid the City Water Department for the tap and the connection to the water main.

BRICK CATCH BASINS AND INLETS


Brick shall correspond in quality to that specified in the standard specifications for brick manholes. When directed by the City Engineer, all brick shall be thoroughly wetted before being used. Special care shall be taken that all joints are well filled with mortar. The mortar used shall be composed of one part Portland cement to three (3) parts sand. It shall be mixed in small quantities and used immediately thereafter. Mortar once set shall be thrown away. Catch basins shall be plastered on the inside with a coating of cement mortar, one quarter ($\frac{1}{4}$) of an inch in thickness, mixed one (1) part Portland cement, and one (1) part sand. All concrete for catch basins shall correspond to that specified for brick manholes.

SEWERS—Continued

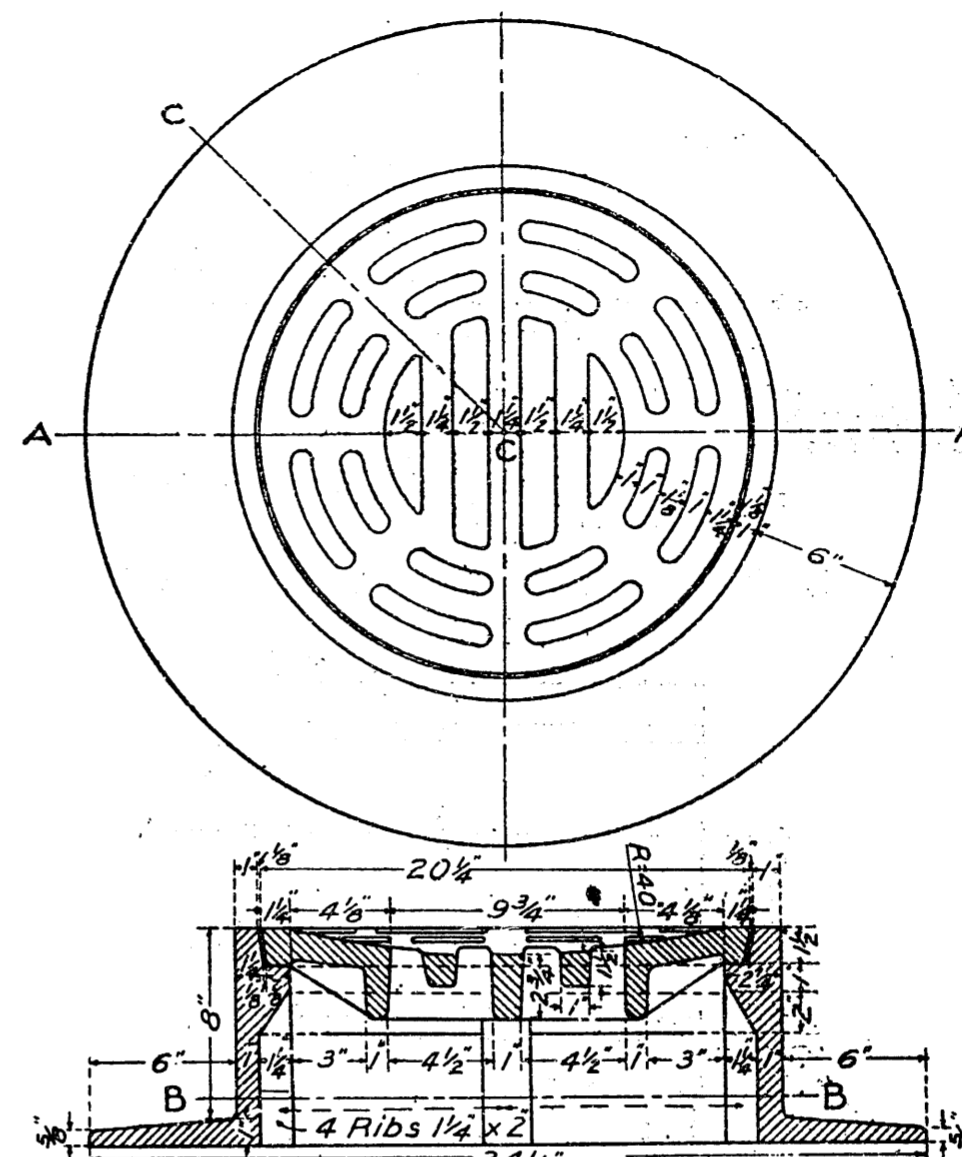


Cover..... 93 lbs
Ring..... 336 "
Total..... 429 "
Approx. Wts.

Section A-A

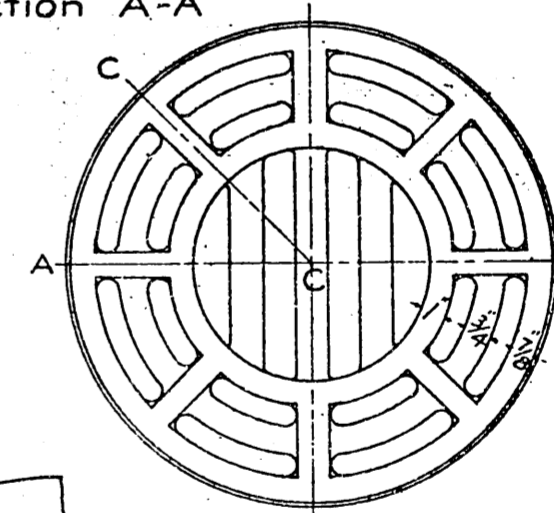


Bottom View

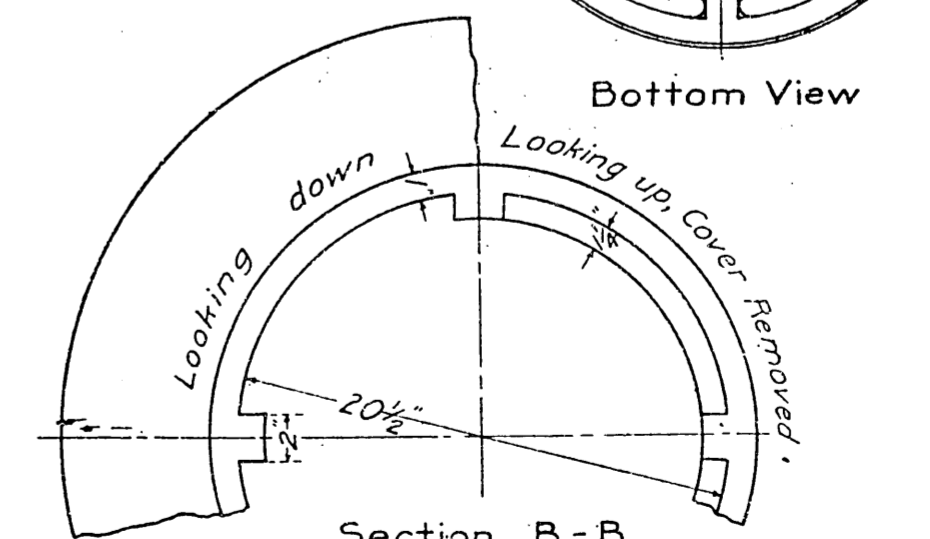


Section B-B

CATCH BASIN COVER-INLET TOP

SEWERS—Continued

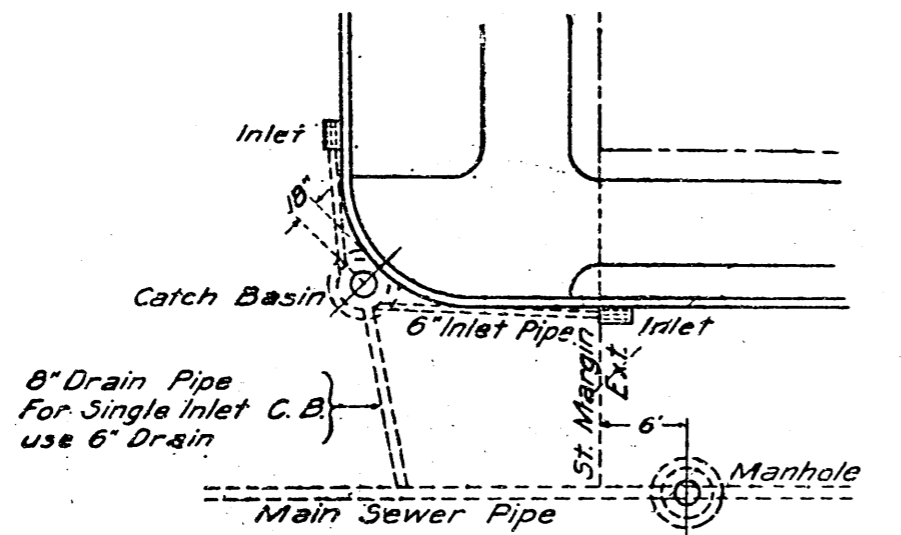


CATCH BASIN LOCATION

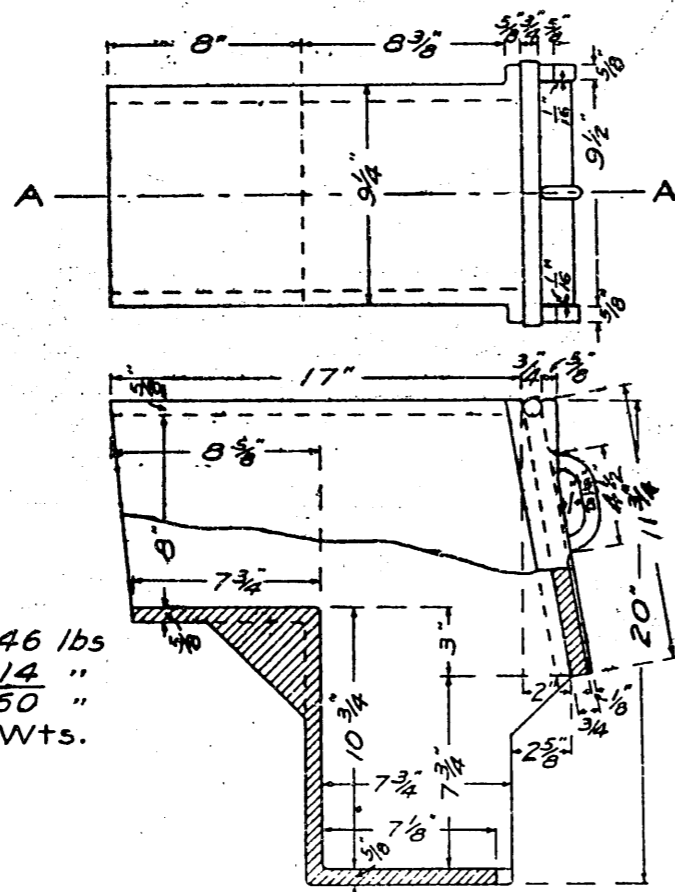



Trap...146 lbs
 Door...14 "
 Total...160 "
 Approx. Wts.

Side View and Section A-A

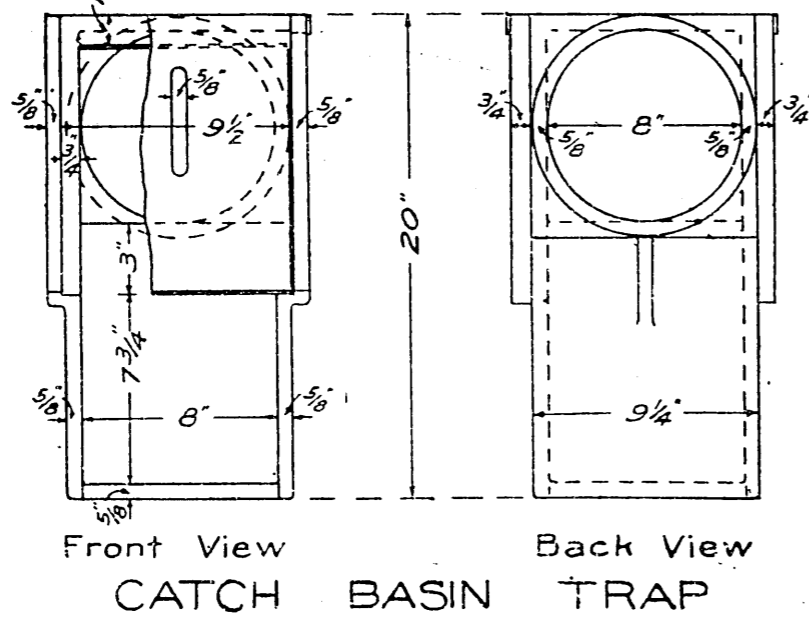


Front View Back View
 CATCH BASIN TRAP

SEWERS—Continued

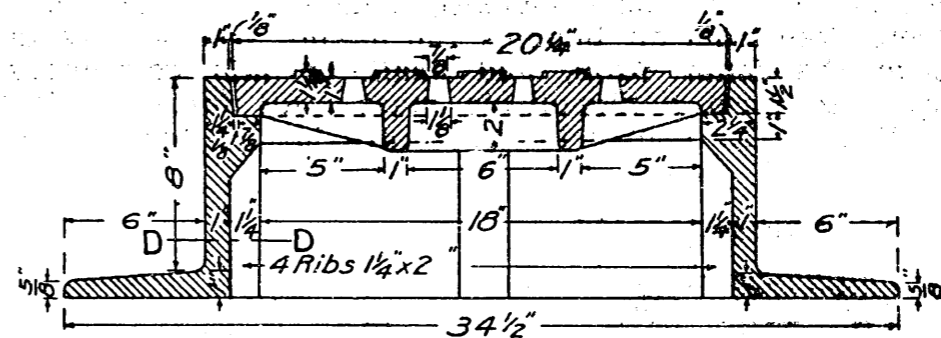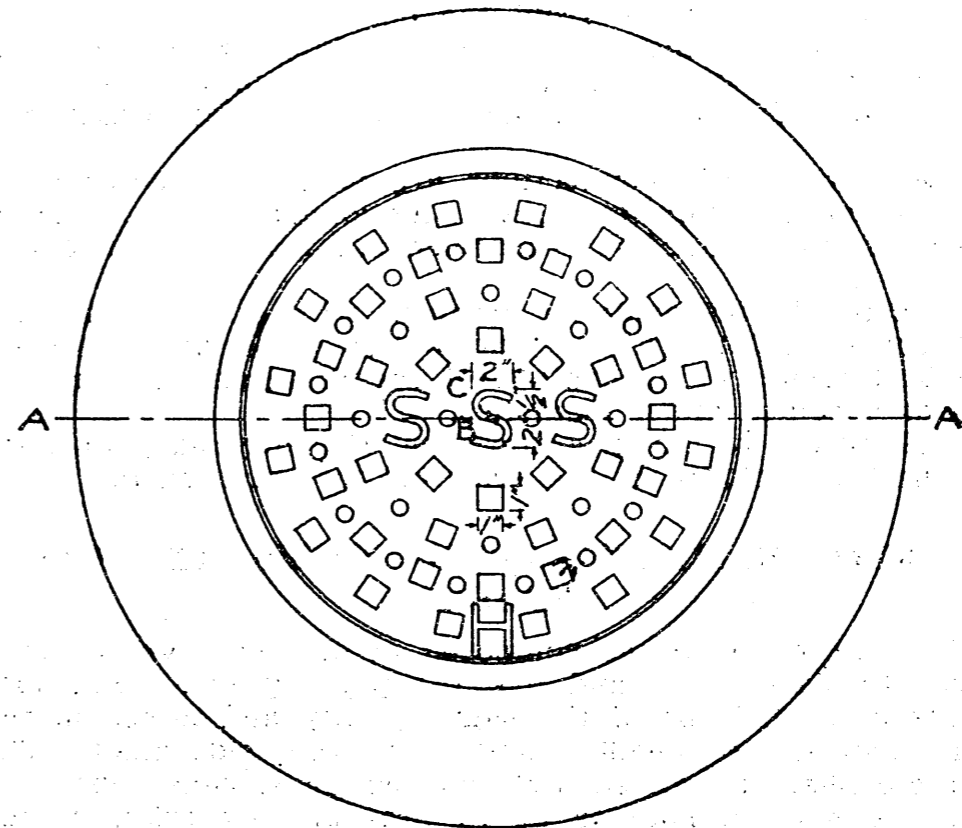


Section A-A

Ring 336 lbs.
 Cover 114 "
 Total 450 "
 Approx. Wts.



Section D-D

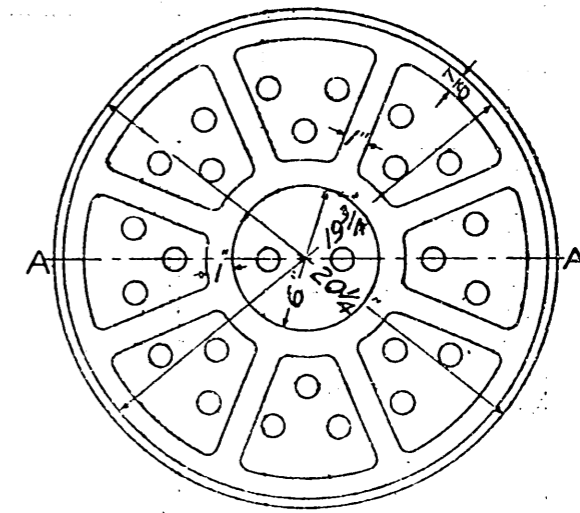

Bottom View

COVER FOR CATCH BASIN
 MANHOLE AND FLUSH TANK

SEWERS—Continued

The connection made from the catch basin to the sewer shall be located to meet the requirements of the Public Utilities Department of Seattle, as shown by the plans adopted by the Board of Public Works, and on file at the City Engineer's Office.


After catch basin connections are made, contractor shall "rod" all inlet and outlet pipes. Any connections that cannot be successfully rodded shall be removed, and new connections made.

All catch basins shall be provided with cast iron frames and covers, inlet gratings and outlet traps as shown on standard plans, which shall meet the requirements for cast iron as specified under manholes.

Small pieces of curbs, gutters and lips necessary to piece out shall be included in the price bid for catch basins.

CONCRETE MANHOLES, FLUSH TANKS AND CATCH BASINS

The concrete shall be composed of one (1) part cement, three (3) parts sand and five (5) parts gravel. The materials used shall be of the same quality and mixed in the same manner as specified under concrete sidewalks. The concrete shall be mixed wet, poured or shoveled into the forms in such a manner as to prevent separation of the materials. It shall be sufficiently spaded to produce dense concrete, free from air bubbles and having a smooth surface next to the inner form, and shall be laid continuously in order to form a monolithic mass. All forms shall be water-tight. The contractor shall provide all forms neces-


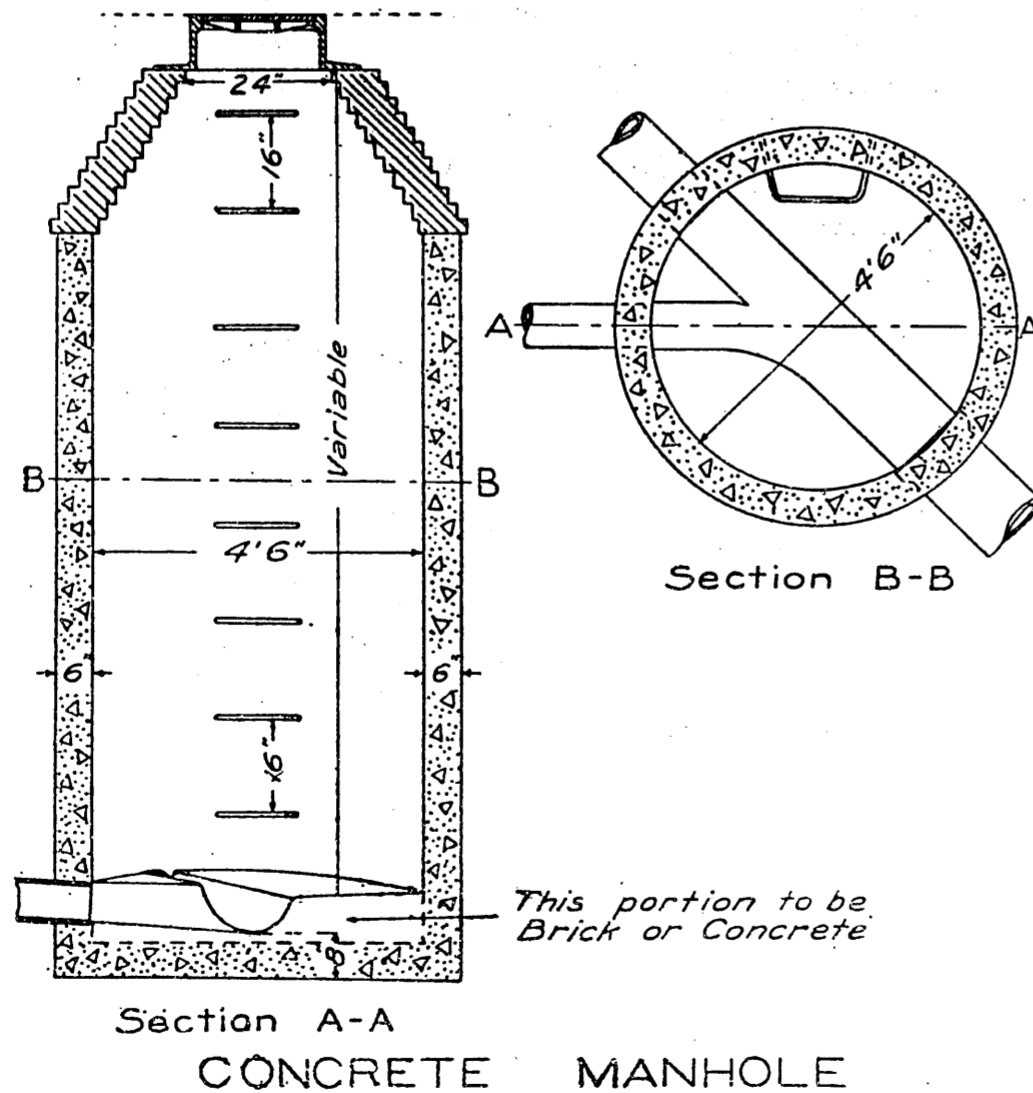


SEWERS—Continued


sary to construct the manhole the shape and dimensions given. No filling in around the work will be allowed until the concrete has thoroughly set. Any additional work necessary to construct concrete manholes, flush tanks or catch basins shall be made in accordance with standard plans and specifications for brick manholes, flush tanks and catch basins. The catch basins and flush tanks shall be water-tight. The necks shall be constructed of brick as shown in detail on the plan.

WOOD MANHOLES


The lumber for the sides and bottom shall be sized on both edges. The box shall be well nailed together with 60d wire nails.

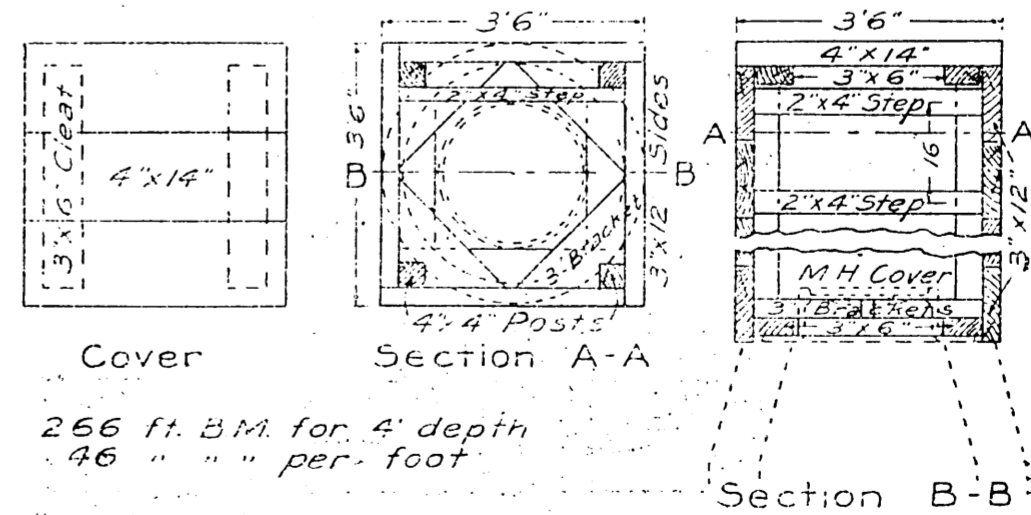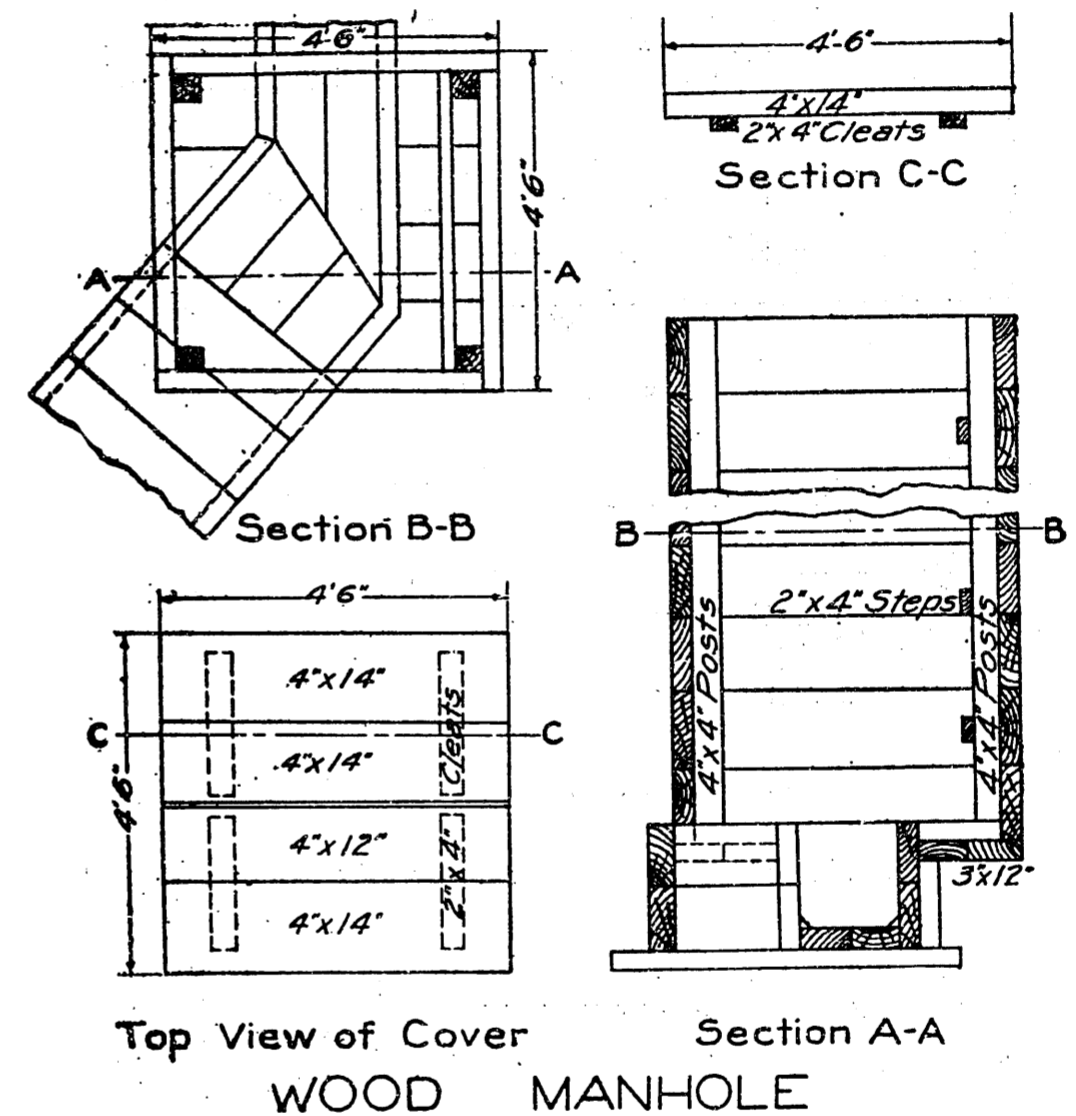

SEWERS—Continued

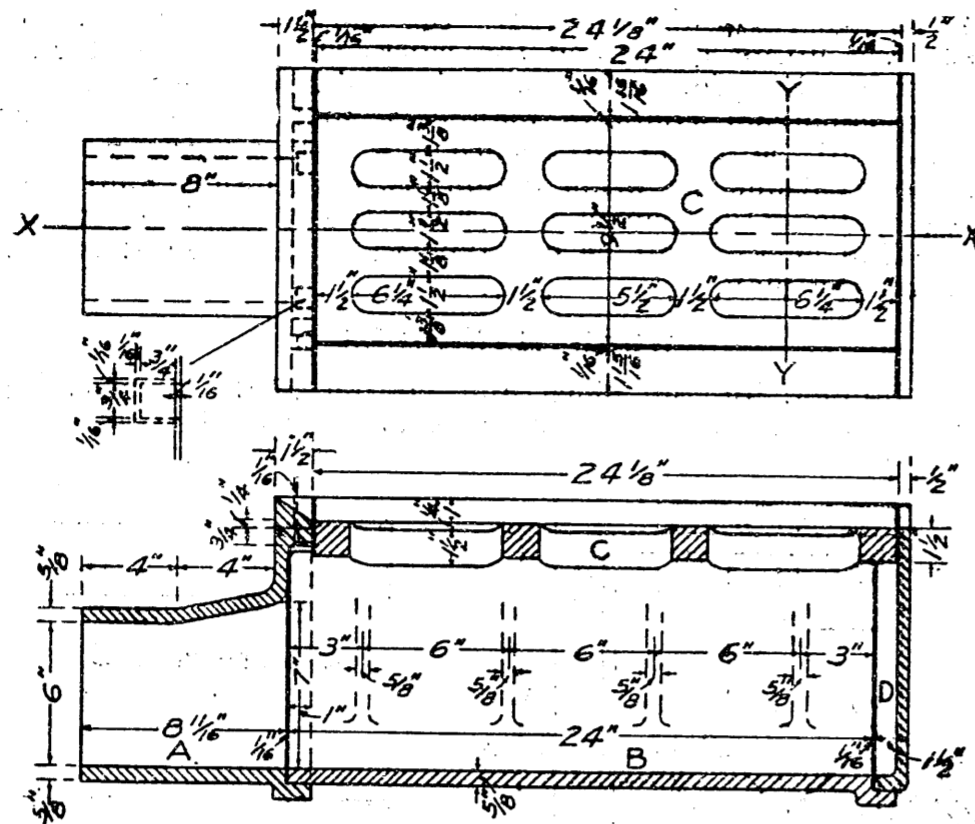


Section X-X

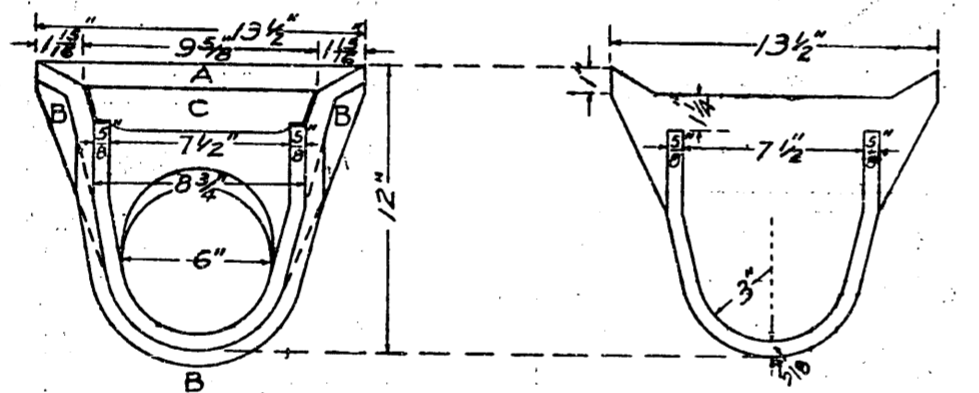


End View
Piece D Removed

Inner View of Piece D

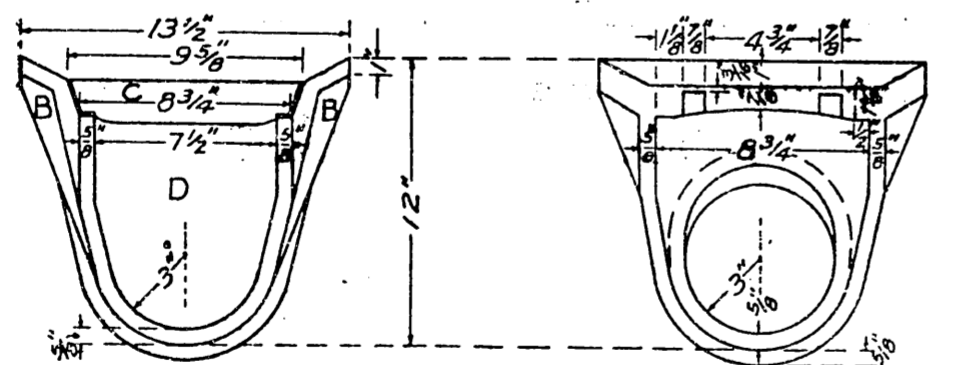

End View
Piece A Removed

Inner View of Piece A

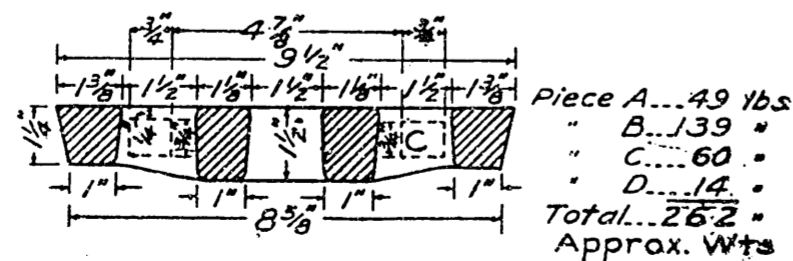

Section of Grate at Y-Y

INLET

SEWERS—Continued

WOOD MANHOLE EXTENSIONS

In ungraded streets all manholes shall be extended from the proposed street grade to the surface of the ground, as shown on the plan or as directed by the City Engineer, by constructing an extension of wood, which shall be built in all respects in accordance with the detail plans therefor. All edges shall be square.

REBUILDING MANHOLES

The contractor shall use such of the old materials as directed by the City Engineer and shall furnish all new material required to construct the manhole to meet the requirements of the plans and specifications.

REBUILDING CATCH BASINS

The existing catch basins shall be rebuilt in the position shown. The contractor shall use such old material as may be directed, and shall furnish all new material required, including all standard connections and making all necessary excavation.

MOVING CATCH BASINS


The existing catch basins shall be moved to the position shown. The contractor shall furnish all material and make the necessary standard connections and do all required excavating.

INLETS

Inlets shall be set in a neat and workmanlike manner, conforming to the existing curb and gutter, unless otherwise directed by the City Engineer. They shall be well bedded in concrete as shown in detail on the plans. When set in pavement, the highest point of the "U" shall be set one (1) inch below the surface of the pavement, and care should be taken that the pavement is brought down so as to lead all water quickly into the inlet. The connection from the inlet to the catch basin, whether the inlet is new or existing, shall be made in a straight line and no bends whatever will be allowed, and shall successfully admit of "rodding".

MOVING INLETS

Existing inlets shall be moved to the new positions. The contractor to furnish all new material required and to reset such inlets in the manner as specified for new work.

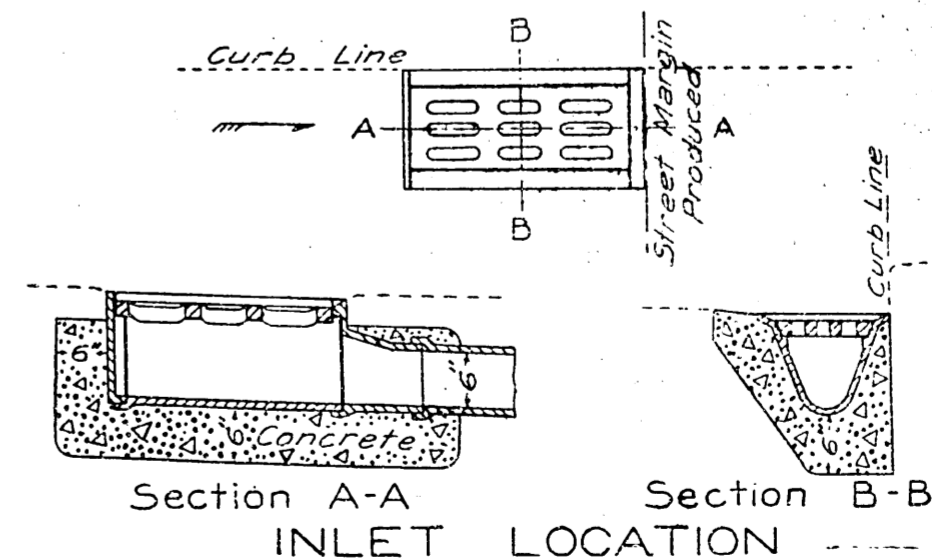


Section A-A

Section B-B

INLET LOCATION

CURB INLETS

They shall be set in a neat and workmanlike manner, conforming to the existing curb and gutter unless otherwise directed by the City Engineer. They shall be bedded in concrete composed of one part Portland cement, three parts sand and six parts gravel or broken stone as shown in detail on the standard plans. The connection from the inlet to the catch basin shall be made in a straight line, and no bends whatever will be allowed.

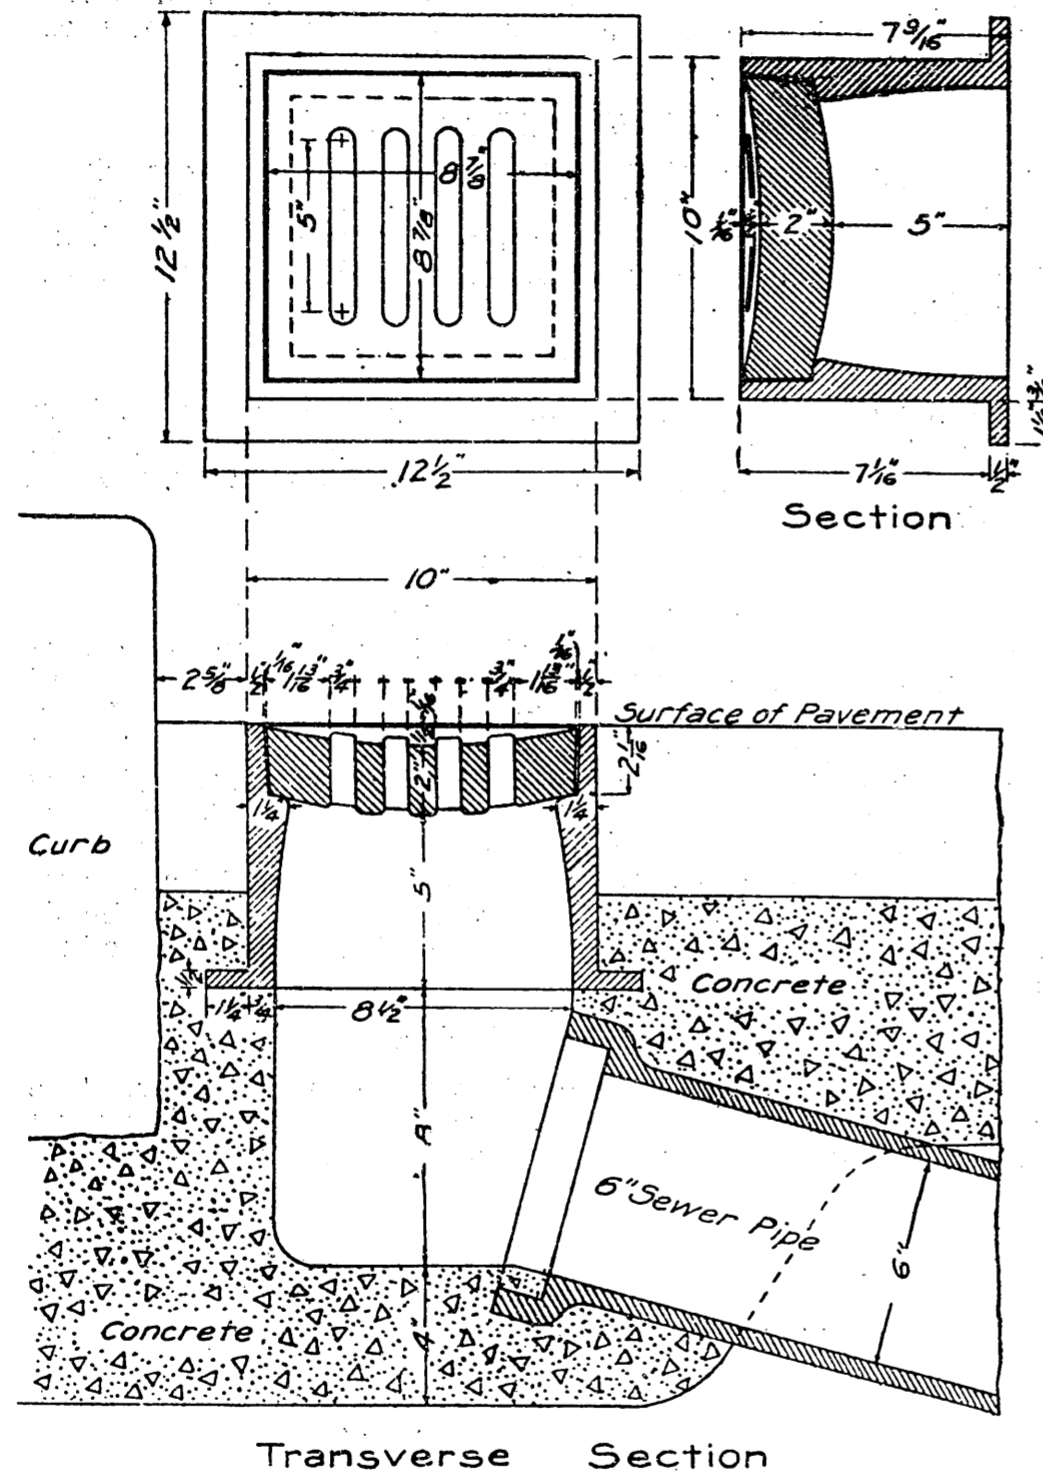

Cover.....33 lbs.
 Frame.....65 "
 Total.....98 "

CURB INLET

WATER MAINS

CAST IRON PIPE

The pipe shall be of the kind usually known as "Hub and Spigot," and in general each straight pipe shall be twelve (12) feet long, exclusive of socket. The form and dimensions of all hub and spigot ends of all pipes and castings shall be subject to the approval of the City Engineer, and shall conform accurately in shape and dimensions to any drawings which may be furnished by him from time to time. Each pipe shall have cast upon it the initials of the maker's name and year of manufacture.

Weight and Dimensions.—The weight and dimensions of pipe shall be as follows:

Size, Inches	Class	Maximum Head in Feet	Thickness of Pipe	Caulking Space	Weight of Pipe Laying 12 Feet	Depth of Lead Joint in Inches	Weight of Lead per Joint in Pounds
4.....		516	1/2 inch.	0.35 inch.	286 lbs.	2.25	6 lbs.
6.....	A	286	1/2 "	0.35 "	414 "	2.25	8 3/4 "
	B	458	1/2 "	0.35 "	470 "	2.25	8 3/4 "
8.....	A	300	1/2 "	0.35 "	613 "	2.25	11 1/4 "
	B	429	5/8 "	0.35 "	686 "	2.25	11 1/4 "
10.....	A	304	5/8 "	0.35 "	845 "	2.25	13 1/2 "
	B	408	5/8 "	0.35 "	935 "	2.25	13 1/2 "
12.....	A	228	5/8 "	0.40 "	1003 "	2.25	18 1/4 "
	B	401	5/8 "	0.40 "	1216 "	2.25	18 1/4 "
16.....	A	258	3/4 "	0.40 "	1598 "	2.75	28 1/2 "
	B	387	3/4 "	0.40 "	1879 "	2.75	28 1/2 "
20.....	A	274	7/8 "	0.40 "	2324 "	2.75	35 "
	B	378	7/8 "	0.40 "	2672 "	2.75	35 "
24.....	A	242	1 "	0.40 "	2975 "	2.75	42 "
	B	371	1 1/8 "	0.40 "	3593 "	2.75	42 "
30.....	A	263	1 1/8 "	0.40 "	4456 "	2.75	52 "
	B	401	1 3/8 "	0.40 "	5491 "	2.75	52 "

No pipe shall vary more than four per cent. either way from the above specified weight. The weights of all pipes shall be conspicuously painted in white on either outside or inside before delivery on the work.

The weight of lead per joint in the above table is given for convenience in estimating amount of lead only. The actual amount necessary will depend upon the size of the bells, which vary with different makes of pipe.

Quality of Metal.—All pipes and special castings shall be made of cast iron, of good quality, remelted in a cupola or air furnace, and of such character as to make the metal of the castings strong, tough and of sound, even grain, and such as will satisfactorily bear drilling, chipping and cuttings. It shall possess a tensile strength of not less than 18,000 pounds per square inch. Test bars of the metal, poured from the ladle at any time, two (2) inches by one (1) inch by twenty-six (26) inches long, when broken transversely twenty-four (24) inches between supports, shall have a breaking load of not less than 2,000 pounds, and shall have a total deflection of not less than thirty-two hundredths (0.32) of an inch before breaking. All pipes shall be entirely free from sand holes, scabs and defects of every kind. No plugging or filling will be allowed.

Coating.—Before being coated, all pipes and special castings shall be thoroughly cleaned from all scale, rust or other deleterious matter, both inside and outside. They shall then

be immediately coated with a preparation of hot coal tar pitch varnish. The coating must be durable, smooth, glossy, hard, tough, perfectly waterproof, not affected by any salts or acids found in the soil, free from bubbles or blisters, strongly adhesive to the iron under all circumstances, and with no tendency to flow when exposed to the sun in summer, or to become so brittle as to scale off in winter. This coating shall be applied at the foundry where the pipes are cast. Care shall be exercised in handling the pipe and fittings up to the time they are laid in the trench so as not to injure the coating. If any rust spots appear on the pipe when delivered on the work they shall be removed, and the pipe coated with P. & B. or some other approved coating. If the workmen, in laying or caulking the joints, remove the coating, it shall be replaced as specified for rust spots.

Standard Specials.—All standard specials, such as crosses, tees, bends, reducers, plugs, yokes, offsets and sleeves, shall be made of the same quality of iron as specified for pipe, and shall be coated with a similar preparation of coal tar pitch varnish, or such other coating as may be approved by the City Engineer. They shall conform to such dimensions as may be required, and shall not vary more than five (5) per cent. either way from the computed weights on file in the office of the City Engineer. Plugs shall be furnished and set where directed; where directed, they shall be furnished with yokes, put on in a manner satisfactory to the City Engineer. They shall be tapped for four (4) inch screw pipe. The weights of all standard specials used shall be conspicuously painted in white on either inside or outside before delivery on the work. Before inserting the four-inch plug, the threads shall be covered with one coat of steamfitters' cement.

Special Castings.—Any special casting required shall be made in accordance with the details shown, from the same quality of iron as specified for pipe, and shall be subject to the same requirements as to cleaning, coating and marking weight. Especial care must be taken to have the socket of the required size. Any special casting which is defective in joint room, from any cause, will be rejected. They shall conform closely to the dimensions and weights given. Special castings will be paid for at the rate bid therefor per pound, and such payment shall be in full for furnishing and setting in place, including all labor and materials. No excess of weight above the estimated weight for the respective patterns of more than five (5) per cent. will be paid for.

Alignments and Grades.—Alignments and grades will be given from hubs driven into the ground parallel with the line of pipe. In graded streets grades may be taken, when directed, from the existing curbs. The top of the pipe shall be at the following depths below the curb elevations, measured to the barrel of the pipe:

For six (6) inch and eight (8) inch pipe, thirty-five (35) inches; for ten (10) inch pipe, forty (40) inches; for twelve (12) inch pipe, forty-three (43) inches; and for all larger sizes up to thirty (30) inch pipe, inclusive, thirty-six (36) inches. Where one side of street is higher than the other, due allowance shall be made to secure proper cover.

In ungraded streets the pipe shall be laid in conformity with the grades shown on the profile, and no allowance will be made for extra excavation beyond the price bid per linear foot of pipe in place. The pipe shall conform accurately to the alignment and grades given.

Gate valves, hydrants, standard specials and special cast-

ings shall be set as shown on the plan, or as directed by the City Engineer.

Trenching.—Trenches for the pipe shall be opened in accordance with the lines and grades given, and in such order as may be directed. They shall be of sufficient width to give convenient access to the pipes for caulking the joints and packing the earth under and about the pipes. Wherever water occurs in the bottom of the trench it shall be sufficiently drawn off, at contractor's expense, to obtain a firm basis for the pipes, and to admit of the caulking being properly performed.

Wherever the pipe is to be laid on a fill, such fills shall be made of proper material and of such dimensions as to be not less than eighteen inches in depth over the top of the pipe, and four feet in width on top of the fill, with proper side slopes. The fills shall be properly compacted by tamping or otherwise, as may be directed by the City Engineer, before laying the pipe. The cost of such filling shall be included in the price bid per linear foot for the pipe complete. Any culverts or box drains which may be necessary through fills shall be constructed in accordance with the details shown on the plans, or the direction of the City Engineer. Such work will be paid for at the prices bid therefor as stated on the bid blanks for this improvement.

All parts of stumps that are within four (4) feet of the pipe must be totally removed. Boulders or rocks must be removed to the width of the trench before the water main is laid, and the cost of such removal must be included in the price per linear foot of water main laid.

Wherever paving, macadam, planking, etc., have to be disturbed to permit the contractor to lay the pipe, he will remove it and replace it in as good condition as when disturbed. The relaying of all paving shall be subject to the provisions of Ordinances Nos. 17313 and 25150. The cost of relaying all paving, macadam, planking, etc., shall be included in the price bid per foot of pipe laid in place.

Laying Pipe.—After the trenches are completed to the required depth, the spigots of the pipe shall be so adjusted as to give uniform space all round, and if any pipe does not allow sufficient space it shall be replaced by one of the proper dimensions. The joint shall at all times be not less in thickness and depth than shown in the foregoing table of weights and dimensions. Gaskets of clean, sound hemp yarn or oakum braided or twisted and tightly drawn, shall be used to pack these joints. When required, a space one-quarter ($\frac{1}{4}$) of an inch shall be left between contiguous pipes.

Jointing.—The lead used shall be of the best quality of pure, soft lead, suitable for caulking and securing a tight and permanent joint. Before running the lead, the joints shall be carefully wiped out to make them clean and dry. The joint shall be run full at one pouring, and the melting pot shall be kept within fifty (50) feet of the joint about to be poured. The joint shall be caulked by competent mechanics; the caulking to be faithfully executed and in such manner as to secure a tight joint without over-straining the iron of the hub. The lead, after being caulked, shall be flush with the face of the socket. The bell hole shall be perfectly free from water while joint is being prepared.

The pipes and all other castings shall be carefully swept out and cleaned, as they are laid, of any earth or rubbish which may have found place inside during or before the

operation of laying. Every open end of a pipe shall be plugged before leaving the work for the night.

Whenever it shall be discovered that a lead joint is less in depth than required by these specifications, the contractor will be required, at his own expense, to drill, cut out, or otherwise remove the lead from any or all joints desired, until the City Engineer is satisfied that all shallow joints have been discovered. All joints deficient in lead depth must then be cleared of lead and yarning, re-yarned the depth required by these specifications, leaded and caulked as required; all at the contractor's expense.

Back Filling.—In refilling the trenches, the earth filled into the bottom of the trench, under and to the top of the pipes and other castings, shall be free from stones and carefully packed and well rammed with proper tools for the purpose. Special care shall be taken in ramming not to injure the coating of the pipe.

Care shall be taken to give the pipe a solid bearing throughout its entire length. The earth filling above the pipes shall be sufficiently packed and rammed to prevent after settlement, and the material used shall be free from large stones. The trenches shall, in all cases, be refilled with the material furnished by their excavation, provided that it be of proper quality. In lieu of ramming, the trenches may be thoroughly water settled.

The City Water Department will charge the contractor for city water used in settling earth at the rate of \$1.40 for every 100 cubic yards of material water settled. The contractor will be required to furnish all hose and other implements necessary for said water settling. The City Inspector in charge of the work will be authorized to open and close the hydrants without cost to the contractor, provided that any damages resulting to the city hydrants while in use for the purpose of water settling will be repaired by the City Water Department, and the cost of said repairs will be deducted in the contractor's final estimate. Any hose, pipe or other utilities belonging to the City Water Department, and any labor furnished by the City Water Department in connection with the water settlings, will be charged to the contractor in the final estimate.

Tests.—All pipes shall be able to stand a thorough hammer testing while under the following hydraulic pressures: For six (6) inch and eight (8) inch pipes, five hundred (500) pounds per square inch; for ten (10) inch and twelve (12) inch pipes, four hundred (400) pounds per square inch, and for larger sizes, three hundred (300) pounds per square inch.

As soon as any section of pipe between any two gate valves is laid, or when directed by the City Engineer, the same shall be tested by hydraulic pressure. The pressure shall be brought up to three hundred (300) pounds per square inch for four (4) inch, six (6) inch and eight (8) inch pipes; two hundred seventy-five (275) pounds per square inch for ten (10) inch pipe; two hundred fifty (250) pounds per square inch for twelve (12) inch pipe; two hundred twenty-five (225) pounds per square inch for sixteen (16) inch pipe; and two hundred (200) pounds per square inch for all larger sizes, and while under this pressure each pipe shall be thoroughly hammer tested from end to end. Any pipe which exhibits any defects shall be taken out and replaced by a sound pipe. All pumps, gauges and other appliances used in making this test shall be furnished by the contractor, but the City reserves the right to test and approve all gauges used. If, after any portion of the trench is refilled and be-

fore the final release of contract, any defects appear, the contractor shall, at his own expense, re-excavate such portion in order to make good defects.

Measurements.—Measurements for the estimate of pipe will be taken along the top of the pipe in a vertical plane passing through its axis; including all gate valves and standard specials, but omitting all special castings.

Payment for cast iron pipe will be in full for furnishing and laying the pipe, and all standard specials shown on the plans, and shall also include all trenching, jointing, back-filling, restoring the street surface, relaying of paving or planking, and all other material and labor necessary for the completed work. Any standard specials not shown on the plans, and which may be ordered by the City Engineer, will be paid for at the rate of six cents (\$0.06) per pound, in place. In case any such standard specials as shown on the plan are omitted in the work, a corresponding reduction will be made from the estimate. Any excavation above that shown on the profiles, or specified above, under "Alignment and Grades," which may be ordered by the City Engineer, will be paid for at the rate bid for "Extra Excavation" per cubic yard.

GALVANIZED IRON PIPE

The pipe shall be standard size, guaranteed wrought iron pipe, galvanized, full weight, and equivalent in quality in every respect to the pipe manufactured by A. M. Byers & Co., Pittsburg. All pipe $1\frac{1}{4}$ inch internal diameter must be lap welded. All pipe less than and including $1\frac{1}{4}$ inch inside diameter may be butt welded. No steel pipe will be accepted. The weights must not vary more than 5 per cent. from the weights given in the following table:

For $\frac{1}{2}$ in. inside diam., wt. per ft.....	.84 lbs.
For $\frac{3}{4}$ in. inside diam., wt. per ft.....	1.12 lbs.
For 1 in. inside diam., wt. per ft.....	1.67 lbs.
For 2 in. inside diam., wt. per ft.....	3.66 lbs.
For $2\frac{1}{2}$ in. inside diam., wt. per ft.....	5.77 lbs.
For 3 in. inside diam., wt. per ft.....	7.54 lbs.
For $3\frac{1}{2}$ in. inside diam., wt. per ft.....	9.05 lbs.
For 4 in. inside diam., wt. per ft.....	10.72 lbs.


Connections shall be made to the main pipe line by means of a standard water pipe clamp with threaded outlet. When possible connection shall be made to the main line at a tapped plug. All threads of screw connections are to be unbroken and cut full depth. Before connections are made threads are to be well covered with steamfitters' cement. The pipe is to be laid with a cover of not less than two (2) feet. All galvanized iron pipe when laid shall be tested by hydraulic pressure to 300 lbs. per square inch.

Payment for galvanized iron pipe will include all trenching and filling, necessary bushings, clamps, fittings and all labor necessary to place in position.


GATE VALVES

All gate valves shall be iron-bodied, bronze-mounted, two-faced, wedge valves of some standard make. All valves shall be equal to those made by the Rensselaer Manufacturing Co., of Troy, N. Y. If required, detail plans of the valves proposed to be used shall be submitted to the City Engineer for his approval. Valves and seat rings shall be of composition metal, and valve stems of phosphor bronze, of some approved proportions. All valves shall satisfactorily stand a pressure of 300 pounds per square inch, both when closed

WATER MAINS—Continued

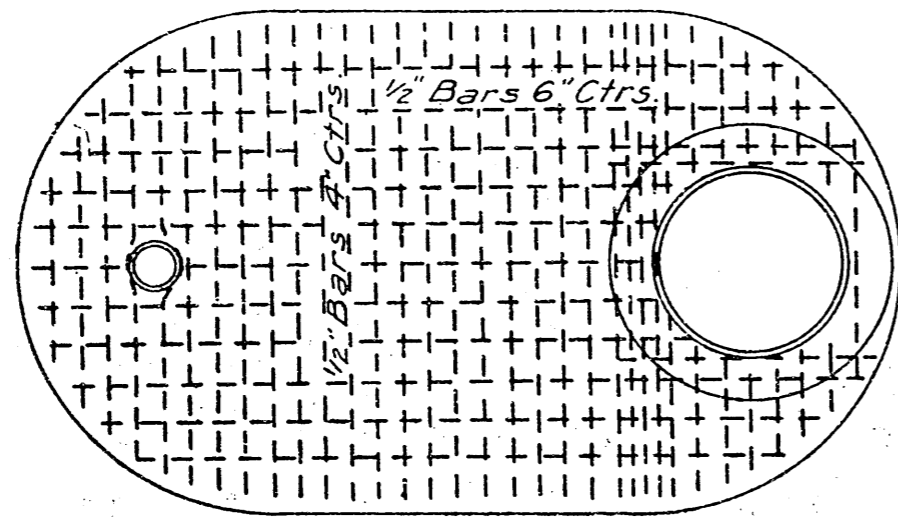


Top View

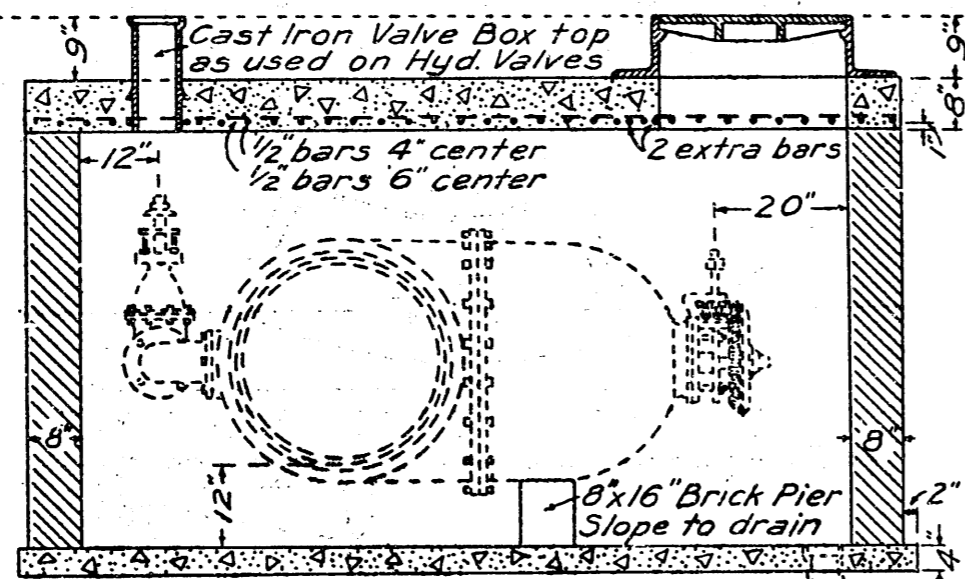

4" Sewer Pipe to Sewer.
not included with chamber



Longitudinal Section

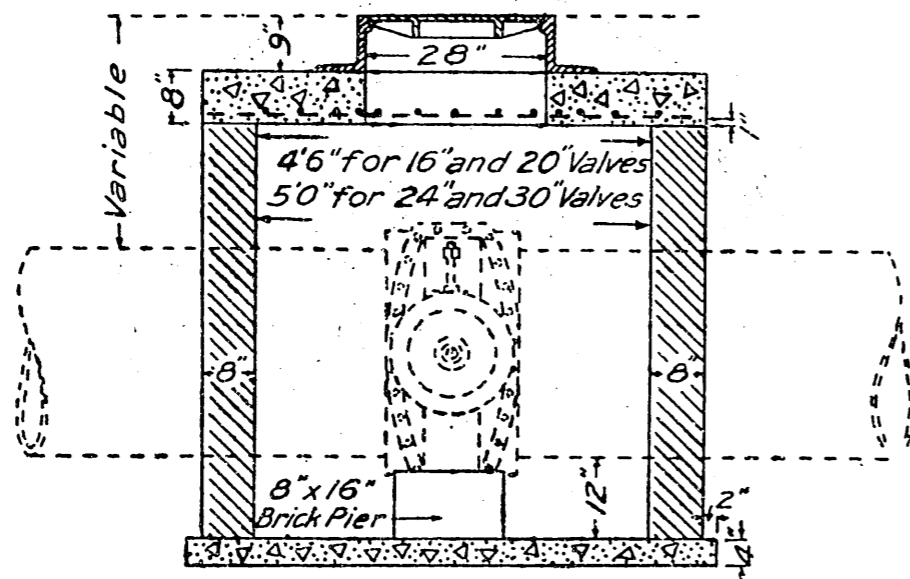

Cross Section

LARGE BRICK VALVE CHAMBER


WATER MAINS—Continued

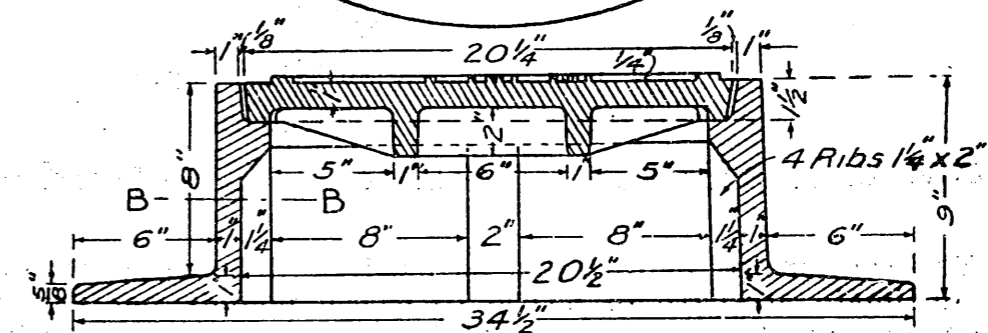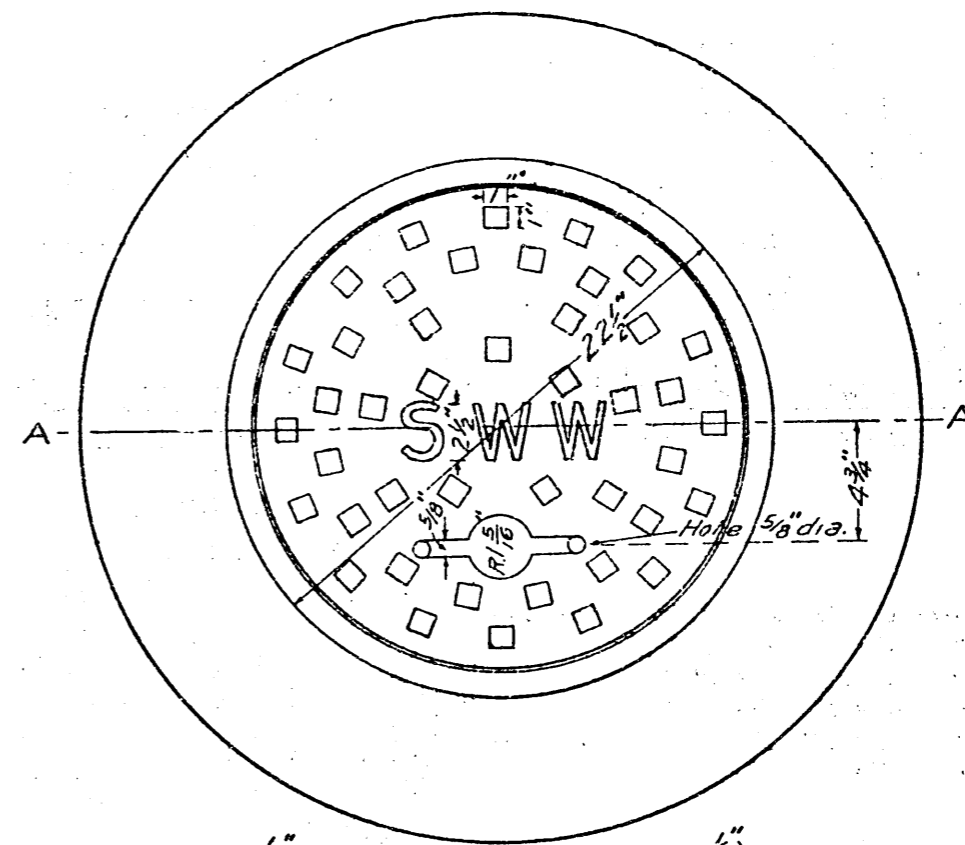


Section A-A




Section D-D

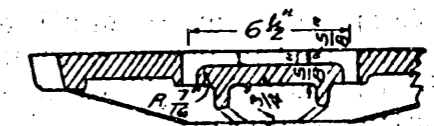


Section C-C

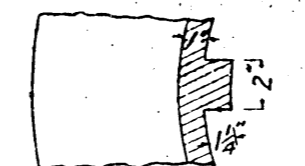

Section B-B

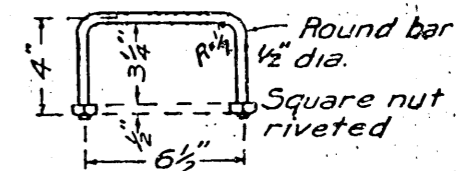

Cover Handle

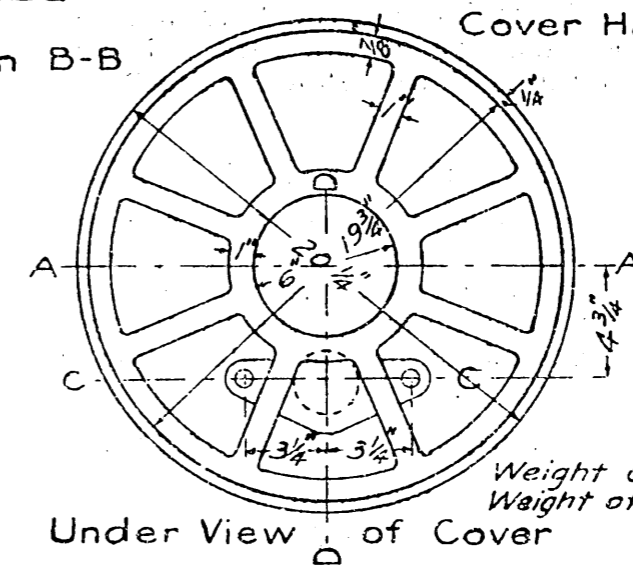


Weight of Ring 336 lb.
Weight of Cover 115 lb.

Under View of Cover

VALVE CHAMBER COVER (SMALL)

WATER MAINS—Continued

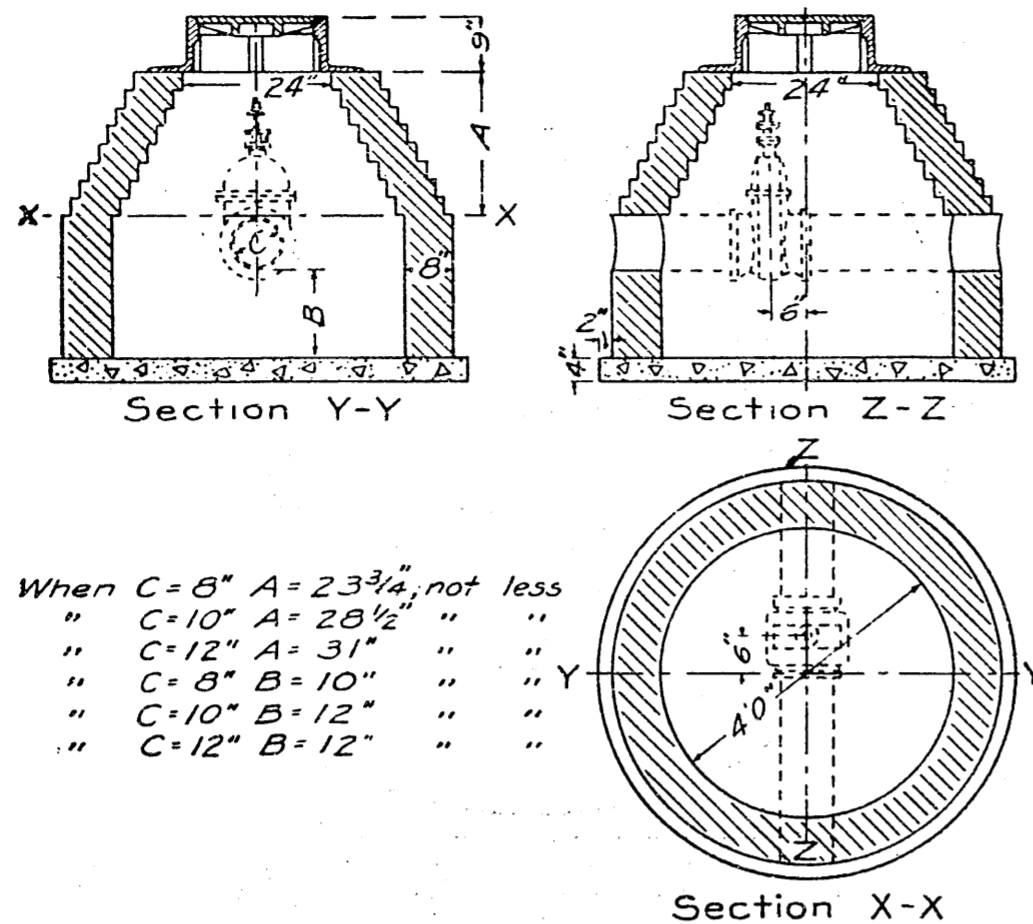

SMALL BRICK VALVE CHAMBER

The reinforcing material to be used shall be mild steel of an ultimate strength of 55,000 to 65,000 pounds per square inch and an elastic limit of not less than one-half the ultimate strength.

Cast iron covers shall be provided of design and size as shown in the detail drawings, and also as designated in the bill of material. They shall conform in quality of material, coating, marking and all other respects to special castings as specified elsewhere in these specifications under the heading of "Standard Specials" or "Special Castings."

Payment.—Valve chambers with reinforced concrete covers will be designated as large valve chambers, and will be paid for at the rate bid for "Large Brick Valve Chambers." Other valve chambers will be designated as small brick valve chambers, and will be paid for at the rate bid for "Small Brick Valve Chambers."

The price will not include the four-inch sewer pipe drain, which will be paid for at the rate bid per linear foot in place for "Four-inch Sewer Pipe Drains."


CAST IRON VALVE BOXES

All gate valves, except where they are enclosed in brick chambers or wooden boxes, shall be protected by an adjustable cast iron valve box, provided with a suitable cover and of a design satisfactory to the City Engineer. All valve boxes shall be coated as specified above for cast iron pipe.

WOODEN VALVE BOXES

Where shown on the plans, or where directed by the City Engineer, gate valves, including district gate valves, shall

WATER MAINS—Continued

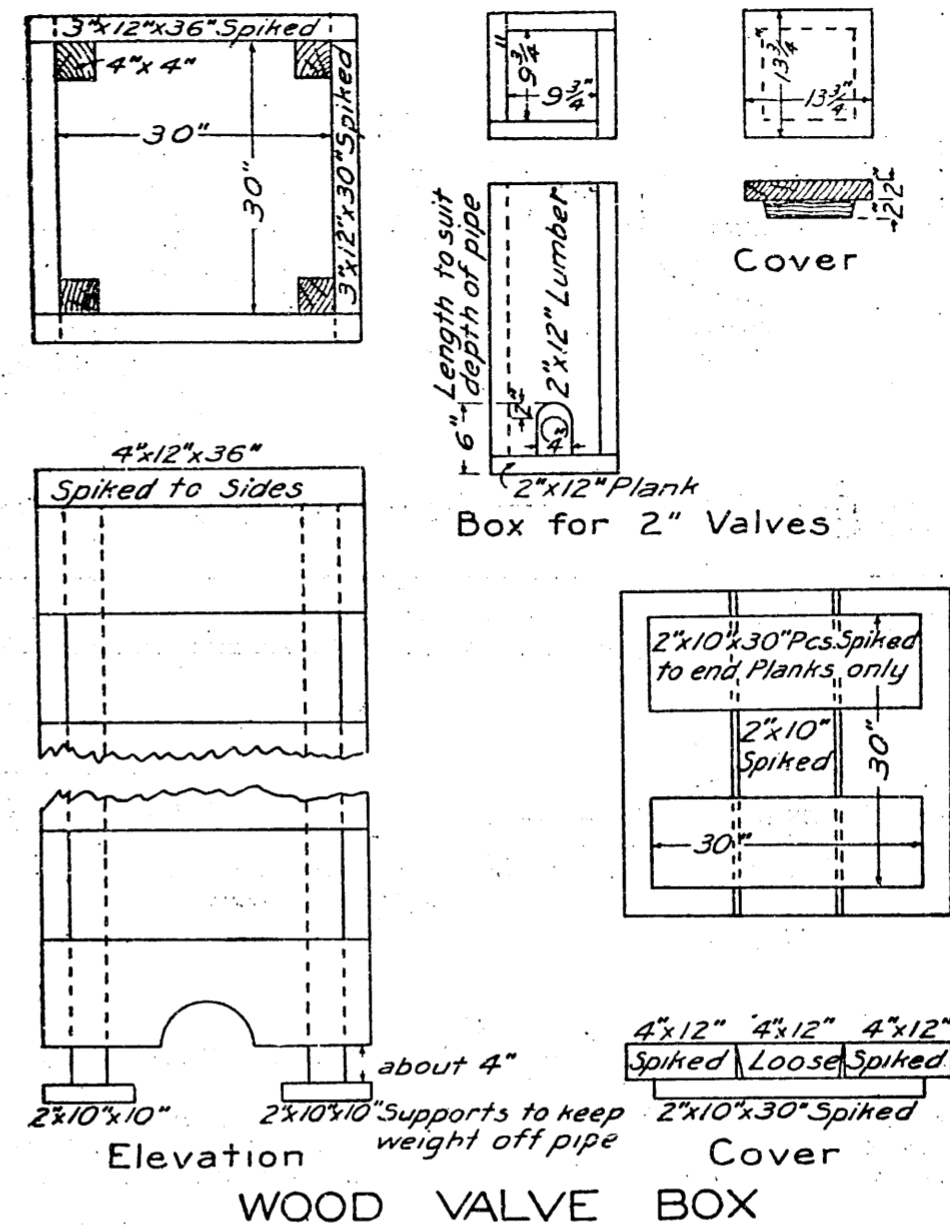


be protected by a wooden box, constructed of three (3) inch lumber and made in conformity with the standard drawings, unless otherwise shown on the plans.

HYDRANTS

Hydrants shall be located as shown on plans. They shall be of some standard make, at least equal to those made by the Rensselaer Manufacturing Co. If required, detail plans shall be submitted to the City Engineer for his approval. All hydrants shall have bronze mountings, and be so arranged that all working parts can be removed without digging around or disturbing the barrel. They shall be set in a bed of broken stone or coarse gravel. Hydrants shall be connected to the main with a section of cast iron pipe, which shall conform both in material and laying to the requirements of these specifications for main pipe. Each branch shall be provided near the hydrant with an auxiliary gate valve placed vertically and provided with a suitable cast iron valve box. This gate valve shall conform to the foregoing specifications. All hydrants and auxiliary gate valves shall have flanged ends.


Hydrants must have a waste orifice for draining them, so located and designed that when all hose and steamer ports are closed and the main valve slightly opened, water will be forced through the waste orifice under pressure. The

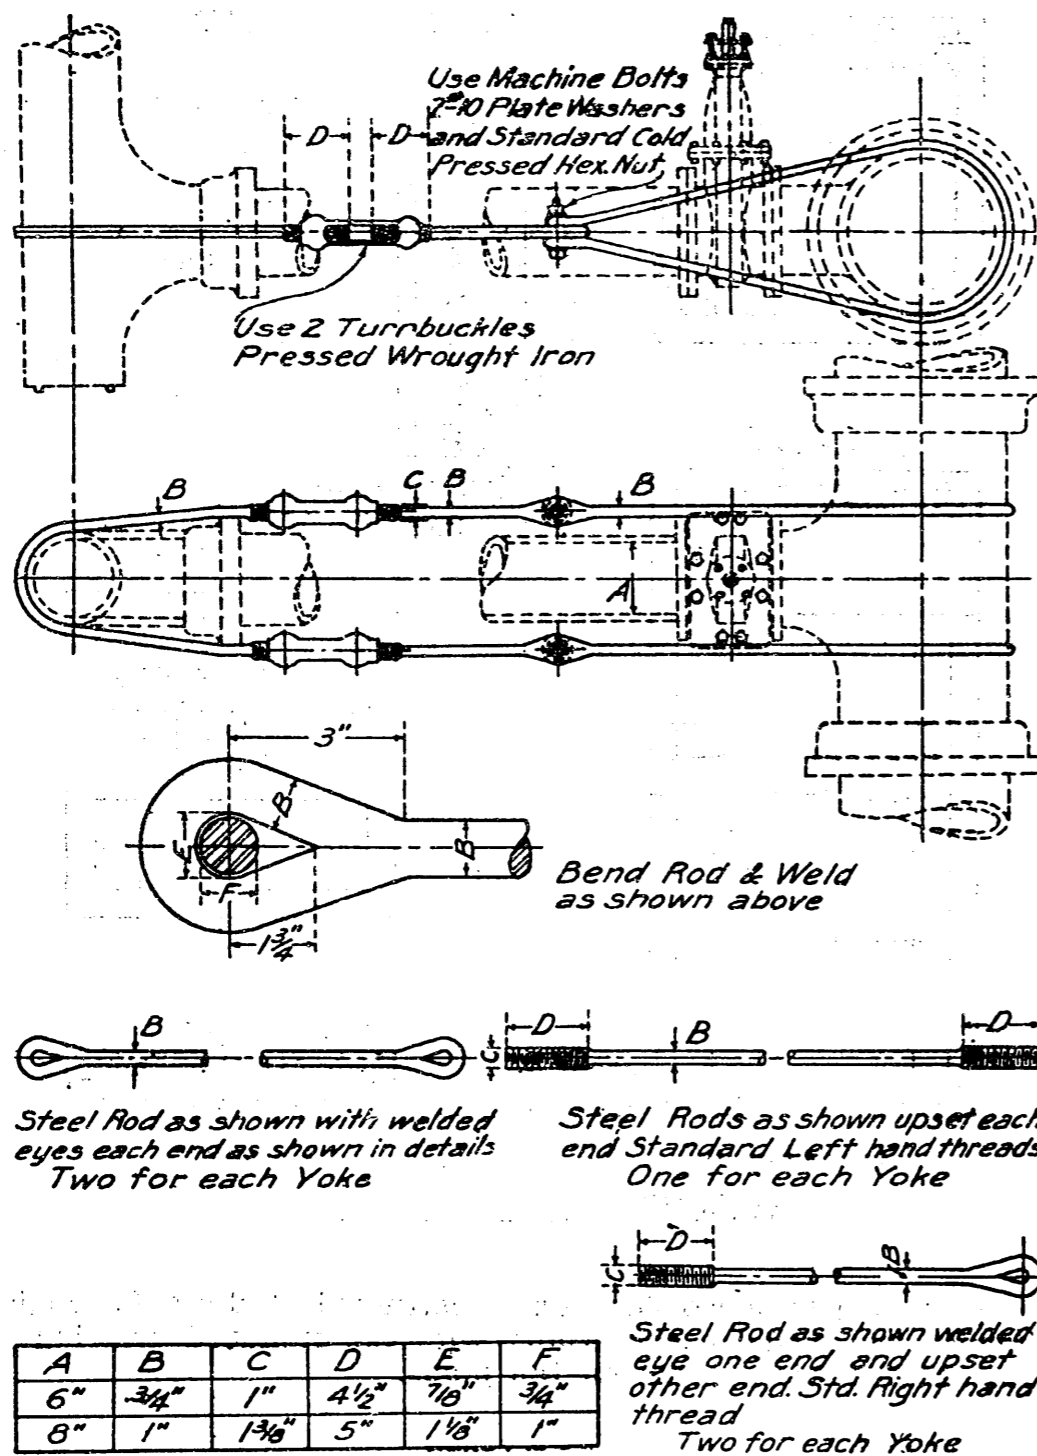

HYDRANT SHACKLE


waste orifice shall have a suitable threaded connection for attaching a drain pipe.

The cast iron tees for hydrant connections are to have lugs cast on the outlet for the insertion of rods to tie the hydrant to the main. A cast iron hub and flange connection, made in accordance with standard drawings, is to be bolted on to each auxiliary hydrant gate valve. Hydrants are to be shackled to the main pipe by two iron rods attached at one end to lugs cast on the outlet tee in the main pipe and at the other end to lugs cast on the hub and flange connection mentioned in the paragraph last above. The price of these rods, together with all nuts necessary to attach them, is to be included in the price bid for pipe for hydrant connections. These rods are to be painted with two coats of P. & B. paint.

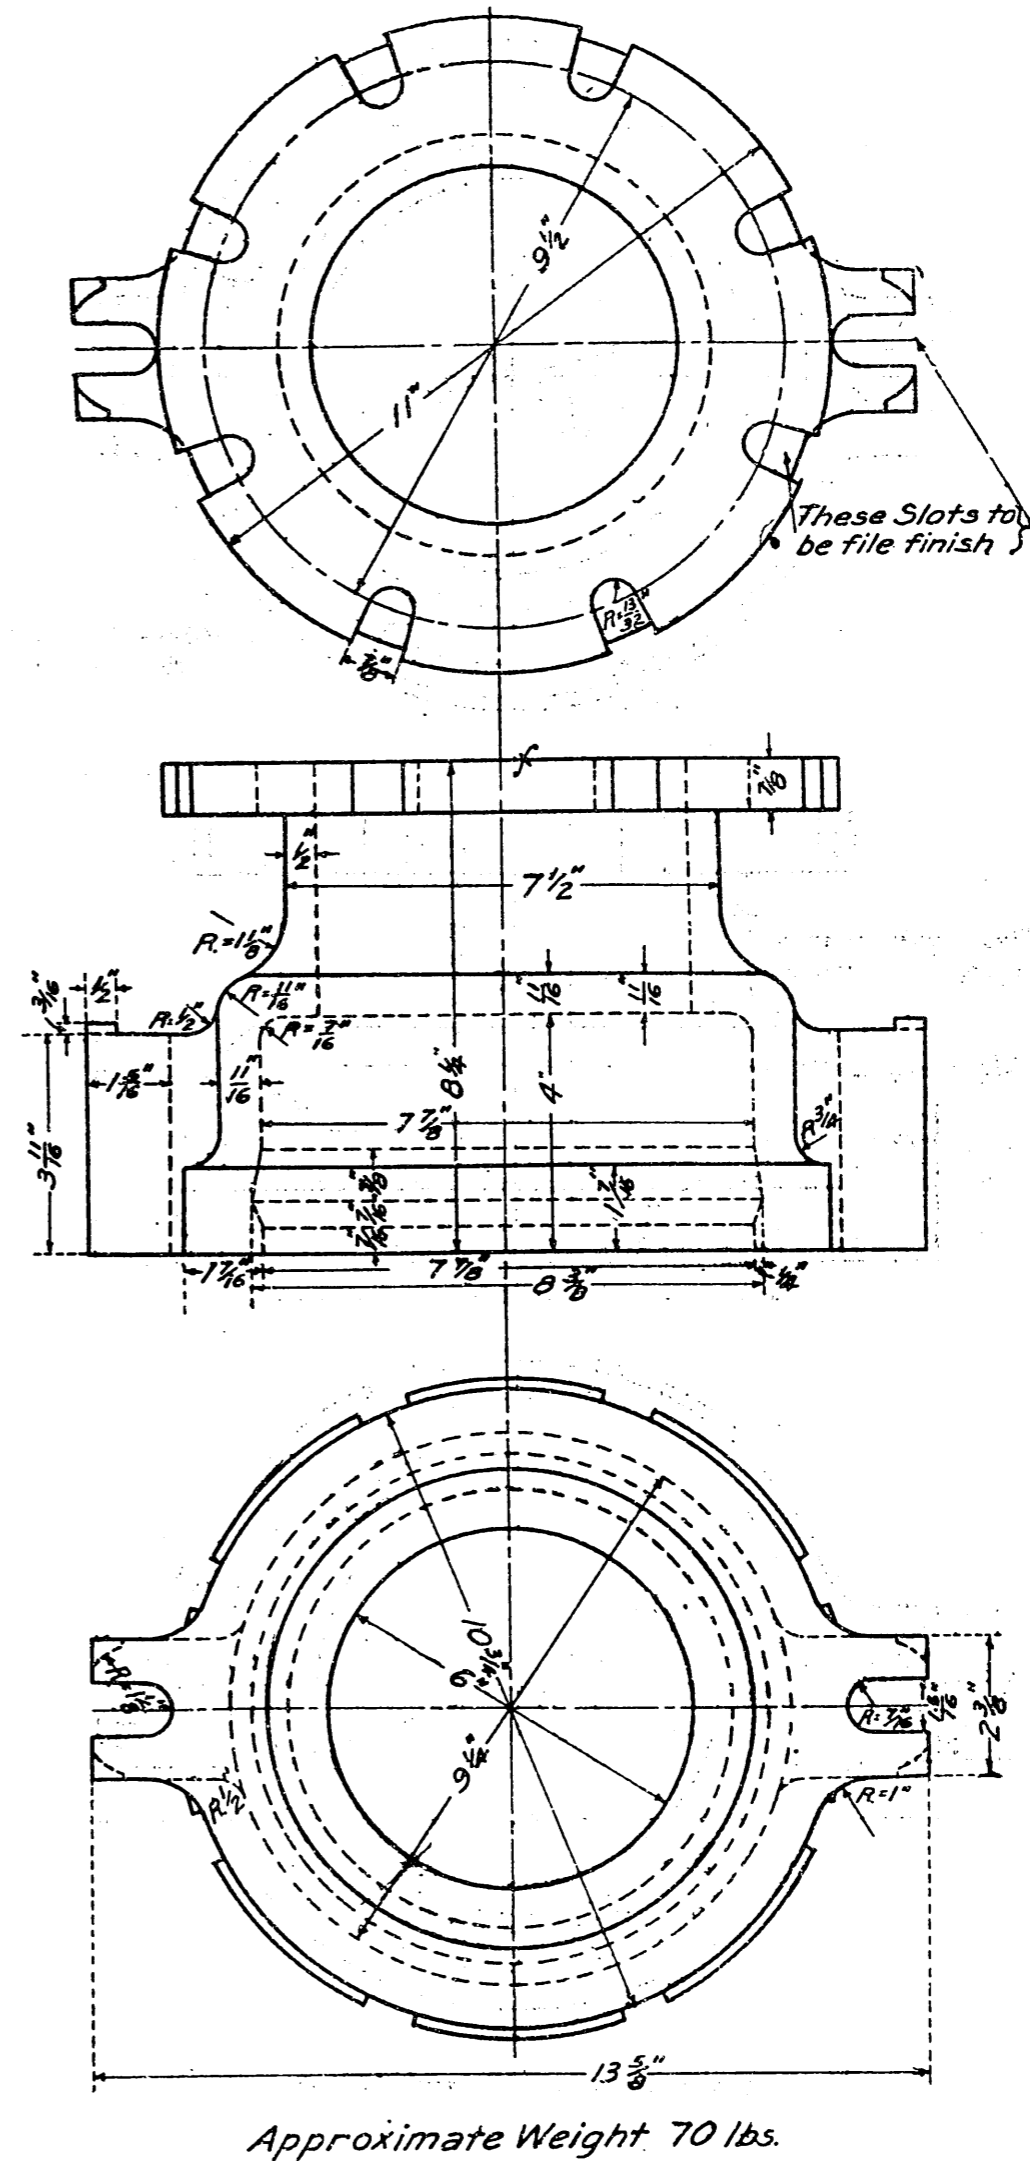

6" HUB AND FLANGE CASTING

WATER MAINS—Continued

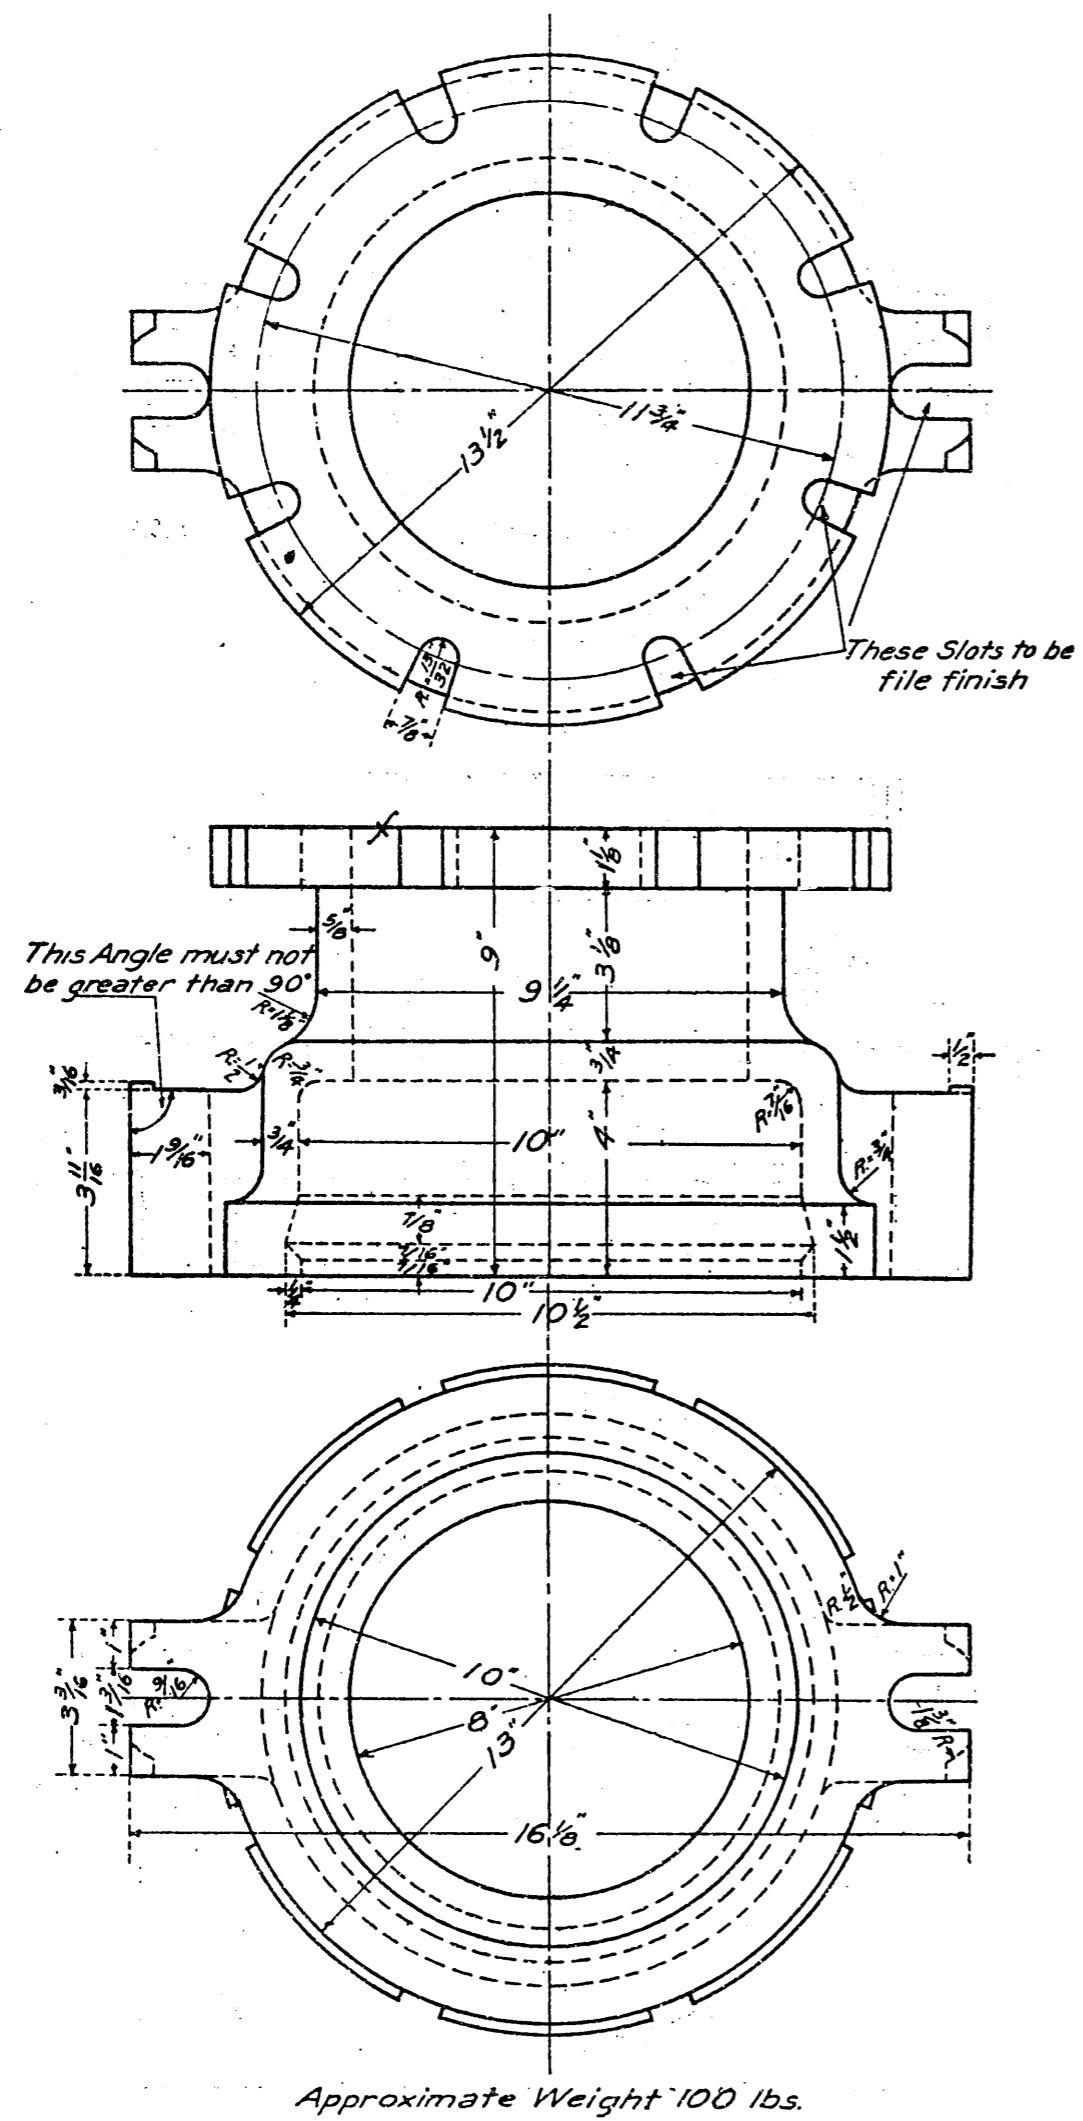

8" HUB AND FLANGE CASTING

WATER MAINS—Continued



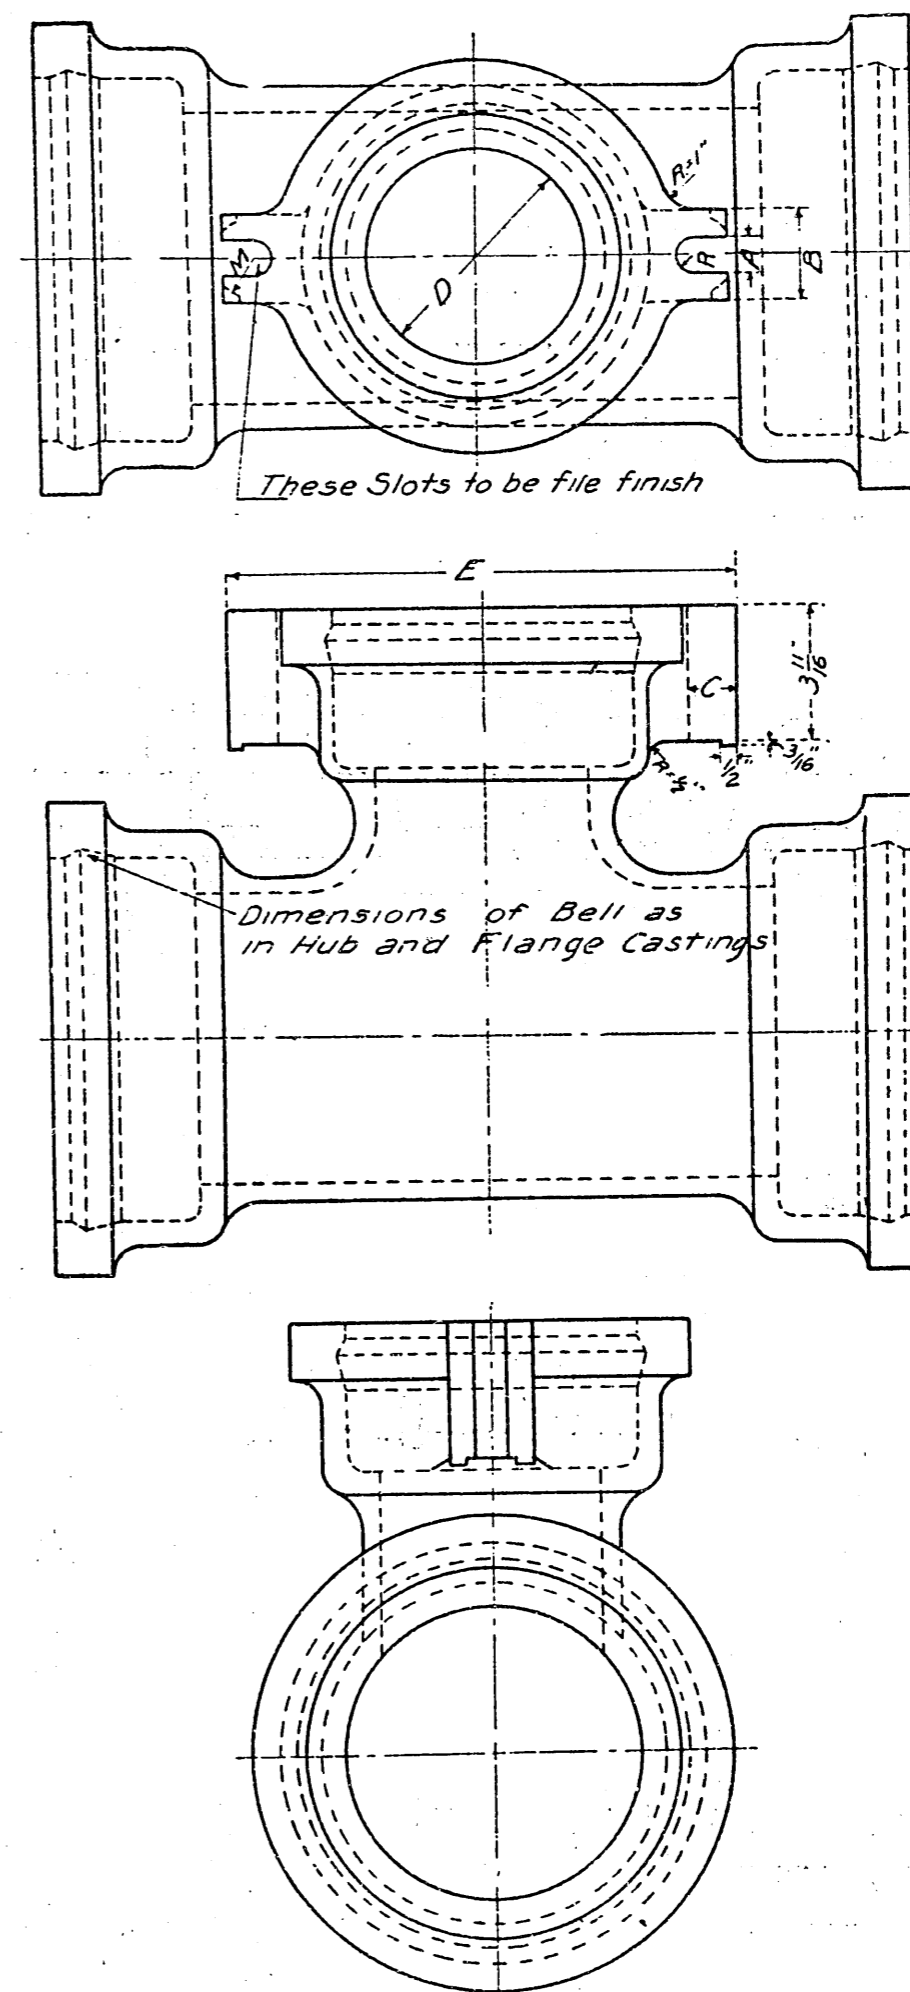


Table of Dimensions for Lugs on Hydrant Tees

Diameter of Outlet	A	B	C	D	E	R	M
6"	1 5/16	2 3/8	1 3/16	6"	13 3/8	7/16	1 1/8
8"	1 3/16	3 3/16	1 9/16	8"	16 1/8	3/16	1 3/8

LUGS WITH 6" OR 8" OUTLET

WATER MAINS—Continued

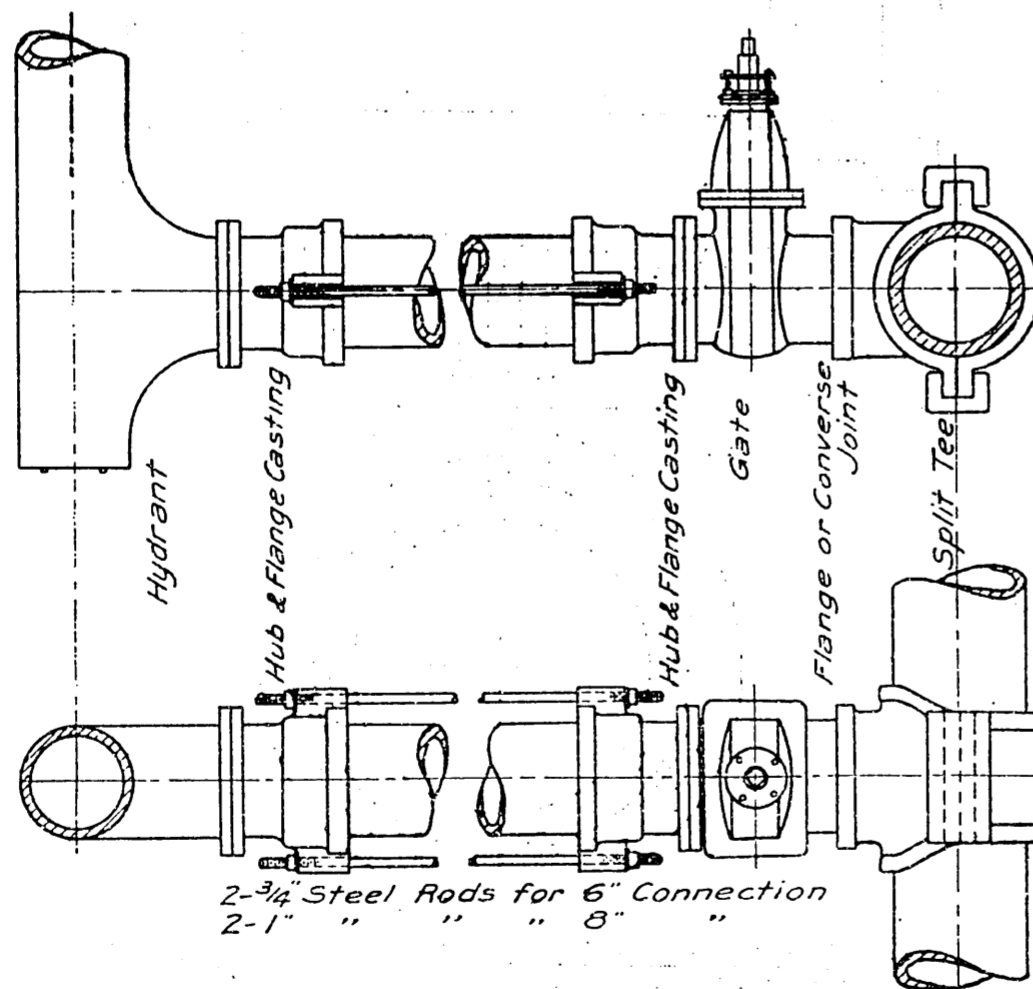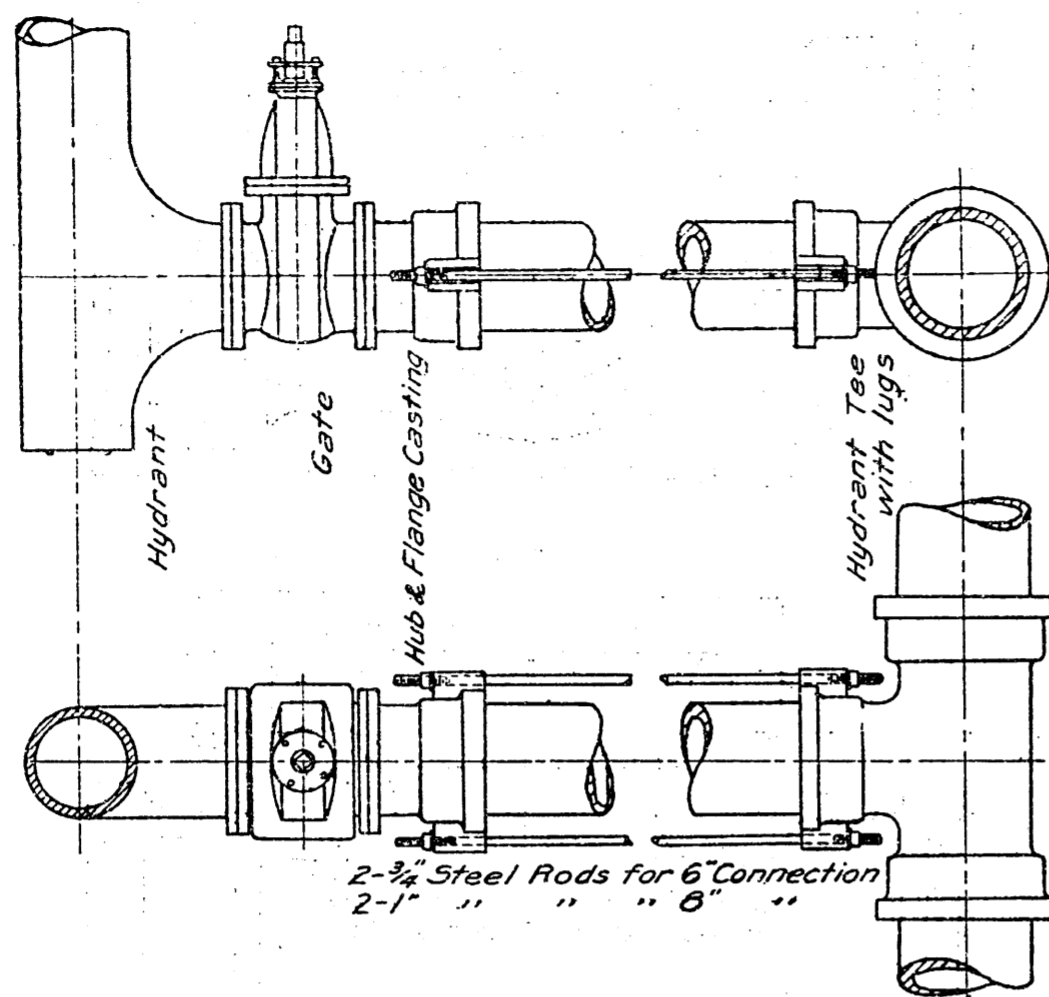

ARRANGEMENT OF
HYDRANT AND AUXILIARY GATE

WATER MAINS—Continued

The dimensions and details shall be as follows:

Inside diameter of cast iron pipe hydrant connection...	6 inches	8 inches
Inside diameter of stand pipe, not less than.....	7 inches	9 inches
Depth below sidewalk.....	3 feet	3 feet
Diameter of valve opening, not less than.....	5 inches	6 $\frac{1}{4}$ inches
Size of auxiliary gate valve.....	6 inches	8 inches
Number and size of nozzles.....	2—2 $\frac{1}{2}$ inch.	3—2 $\frac{1}{2}$ inch.
	1—4 inch.	1—4 inch.
	5-sided as per templet	
Size of valve nut.....	Per samples	
Number of nozzle threads per inch.....	Furnished by City Engineer	
Diameter at top of threads, hose nozzles.....		
Diameter at top of threads, steamer nozzles.....		
Diameter of shackle rods.....	$\frac{3}{4}$ inch	1 inch

That portion of hydrants below the surface of the ground shall be thoroughly repainted with "P. & B." or some other preparation approved by the City Engineer. The portion above the ground shall be repainted with two coats of dark green. The paint above the ground to be applied after the hydrants are set and tested.

Hydrants shall be provided with an independent valve for each hose nozzle. All hydrants shall open by turning to the left. They shall be able to stand a pressure of 300 pounds when the hydrant valve is closed, and of 300 pounds when the valve is open.

Payment for hydrants will be in full for the hydrant proper, the auxiliary gate valve and valve box, the hub and flange casting, all bolts, nuts and gaskets, laying, jointing, and setting thereof in place, including all excavation and re-filling, and all other materials and labor necessary for a finished result, but will not include the tee on the main line.

When the auxiliary gate valve is provided with a brick chamber, in place of the cast iron valve box, the sum of \$4.00 will be deducted from the bid price of each hydrant.

Hydrant Connections.—"Hydrant connections" will be paid for at the rate bid therefor per linear foot, and such payment to be in full for furnishing, laying, jointing, and all other material and labor necessary for the completed result. "Hydrant connections" will be measured from socket of tee on main line to socket of hub and flange casting at hydrant.

RESETTING EXISTING HYDRANTS

Where shown on the plans or when directed by the City Engineer existing hydrants are to be reset. The work will conform in all respects to the specifications for setting hydrants as mentioned elsewhere in these specifications. Where existing hydrants are blocked to the main line the same method will be used in resetting unless it is found necessary in the judgment of the City Engineer to shackle them, in which case some approved form of shackling to the main line with iron rods will be used.

Payment for resetting of hydrants will include all labor and material necessary to place and connect the hydrant in its new position, but will not include new shackle rods or new pipe for hydrant connections, which will be paid for at the rate bid for "Shackle Rods" and "Hydrant Connections," as mentioned elsewhere in these specifications.

HYDRANT DRAINS

When ordered by the City Engineer, waste orifices of hydrants are to be connected to the sewer or other outlet, by galvanized wrought iron pipe of size as called for. It is to conform in all respects to the requirements for "Galvanized Iron Pipe," as specified elsewhere in these specifications.

Payment for hydrant drains will be in full for furnishing and laying the pipe, including all trenching, back-filling, fittings and all labor necessary to place in position.

HYDRANT EXTENSIONS

All two-flanged extensions, such as vertical extensions in the barrel of hydrants, or horizontal extensions between the hydrant and auxiliary gate valve, shall conform in quality of material, coating, marking and all other respects to special castings as specified elsewhere in these specifications under the heading of "Standard Specials" or "Special Castings." In all cases the contractor must see that the drilling in flanges of extensions will fit the drilling in the flanges of hydrant barrels or gate valves, as the case may be, and in no case will the city be responsible for any error in these drillings. The length of the vertical extensions will be determined after the hydrant is in place.

Payment.—All vertical hydrant extensions will be paid for at the rate bid for "Vertical Hydrant Extensions" per pound in place, and the price so bid will include all machine work, extension of hydrant rods, bolts, nuts, washers and gaskets. All horizontal hydrant extensions will be paid for at the rate bid for "Horizontal Hydrant Extensions" per pound in place, and the price so bid will include all machine work, bolts, nuts, washers and gaskets.

STEEL PIPE

Chemical and Physical Properties.—Steel shall be made by the open-hearth process. For the purposes of this specification it shall be divided into three classes, namely, steel for plates, steel for rivets, and steel for castings, which shall conform to the following limits in chemical and physical properties:

	Steel for Plates	Steel for Rivets	Steel for Castings
Phosphorus shall not exceed.....	0.04%	0.04%	0.05%
Sulphur shall not exceed.....	0.04%	0.04%	0.05%
Carbon shall not exceed.....	0.20%	0.20%
Manganese shall not exceed.....	0.50%	0.50%
Ultimate tensile strength, pounds per square inch.....	52000-62000	45000-55000	60000-65000
Yield point in pounds per square inch shall not be less than.....	½ ultimate tensile strength	½ ultimate tensile strength	½ ultimate tensile strength
Elongation, when measured longitudinally, shall not be less than.....	26% in 8 in.	23% in 8 in.	18% in 2 in.
When measured transversely, shall not be less than.....	22% in 8 in.
Reduction of area shall not be less than.....	50%	50%	30%
Cold bend without fracture.....	180° flat	180° flat	90° about diameter of 3 times thickness
Quench bend without fracture.....	Silky or fine granular
Character of fracture.....	Silky	Silky

For plates more than ¾ inch in thickness a deduction of one (1) shall be made from the specified percentage of elongation for each ¼ inch in thickness above ¾ inch. For plates less than 5-16 inch in thickness a deduction of 2½ shall be made from the specified percentage of elongation for each 1-16 inch in thickness below 5-16 inch. The standard tensile test specimen of 8 inch gauged length, as shown

Figure 1


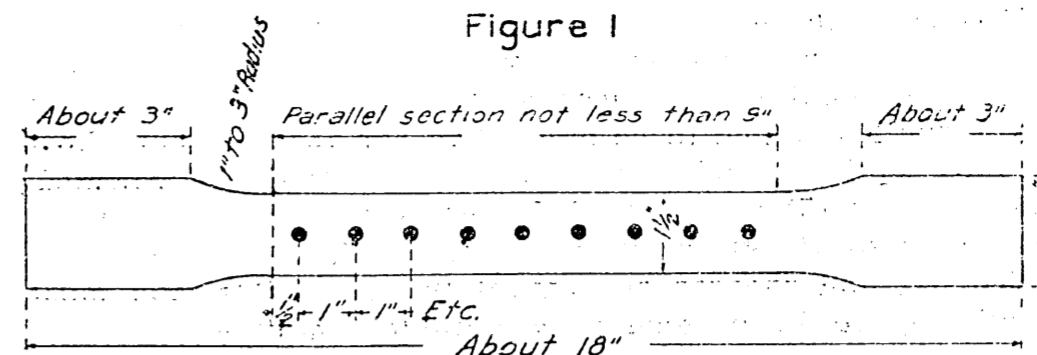


Figure 2

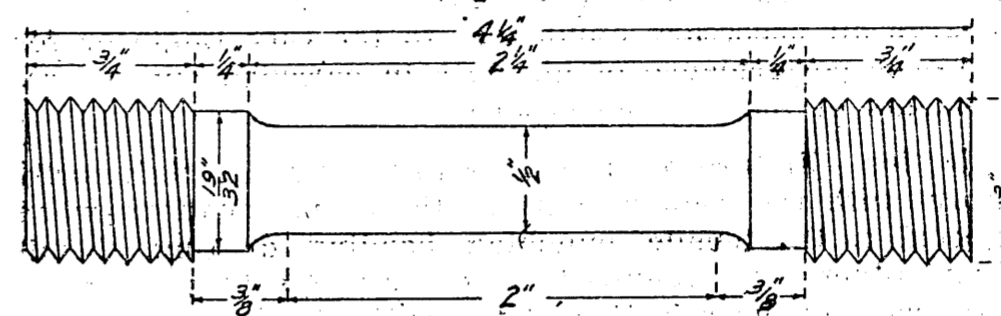

in figure one, herewith, shall be used to determine the physical properties of steel for plates as above specified. The bending test specimens shall be cut lengthwise and crosswise from the sheets. Rivet rounds shall be tested of full size as rolled. Test specimens for steel castings shall be of the form shown in figure two, herewith, they shall be cut cold from the sink heads of one or more castings from each melt, or from coupons cast for the purpose.

Steel for Lock Bars.—The steel for lock bars shall be a steel which experience has shown to be adapted to the work intended; it shall be equal in quality to the steel specified for rivets and shall be subjected to the same tests. It shall be of a quality which will stand cold rolling and working.

Punching Tests.—The specimens for punching tests shall be one and three-quarters (1¾) inches wide and not less than ten (10) inches long; a row of not less than eight holes, ¾ inch in diameter, spaced 1¼ inches between centers, shall be punched while the plate is cold, without causing any cracks.

Drifting Tests.—Specimens for drifting tests shall be three (3) inches wide and not less than five (5) inches long; not less than two holes, ¾ inch in diameter, spaced to two inches between centers, and 1½ inches from the edges, shall be punched and then enlarged cold by blows from a sledge hammer upon a drifting pin, until said holes are at least 1¼ inches in diameter, without causing any cracks.

Additional Tests.—The plates must also admit of cold hammering, and of scarfing to a fine edge at the laps without cracking. The test pieces must furthermore stand quenching, forging and other tests as may suffice to exhibit fully the temper, soundness and fitness for use of the material. The failure of said test specimens when taken at random, as aforesaid, from the finished product of any heat or melt, to conform with any or all of the above stipulated requirements, will be sufficient cause for the rejection of the entire product of such heat or melt.

WATER MAINS—Continued

Perfect Plates.—The plates shall be free from laminations, cinders, and any other surface defects. They shall be fully up to the required thickness at the edges, and any plates which shall be found to be more than five (5) per cent. short of the required thickness at any point shall be rejected. Not over five (5) per cent. of the plates shall be short of the full required thickness at any point. The plates must be rolled flat and sheared as accurately as possible, and must in all respects be in good merchantable condition.

Inspection of Manufacture.—The City Engineer, or his representatives, shall have the right at all times to inspect the manufacture of any and all sheets or plates, and all work connected therewith, and the contractor must furnish free of charge all necessary appliances to the City Engineer for the proper performance of his duty in carrying out the requirements of these specifications.

Rejection.—Failure of specimens to fully and satisfactorily conform with the requirements of these specifications when subjected to the tensile, punching, bending, drifting, chemical and other tests required, or to any of said tests, shall be followed by the rejection of the entire heat or melt from which the samples were obtained. Should any sheet or plate show defect during the process of punching, bending and riveting, for manufacture into pipes, it shall be rejected, notwithstanding the test pieces from the heat or melt from which said plates were manufactured may have been previously satisfactorily tested.

Protection of Metal.—All plates and rivets must be kept free from rust, and be kept under cover from the time of their manufacture until the pipe is dipped and coated. At the place of manufacture the plates must be loaded under cover upon suitable covered cars, satisfactory to the City Engineer or his authorized representative. They must at no time be exposed to the weather or to moisture, and must be delivered under cover at the pipe shop. In case of accidental rust, either during transportation or the process of manufacture, the rust must be removed from the plate at once by brushing with stiff brush and scrubbing them with diluted acid, followed by mopping or brushing with a saturated solution of soda or other suitable alkali to remove the acid. This must be continued until the rust has been removed. The alkali must then be washed off and the plates be thoroughly dried.

Manufacture of Pipe.—The pipe is to be riveted pipe or of the type known as "Lock Bar Pipe," as manufactured by the East Jersey Pipe Company. It shall be manufactured of plates of the thickness given on the plans, and shall be of full specified internal diameter at the small end of the sections. Each section of pipe as shipped shall be approximately thirty feet in length except where shorter sections are necessary in order to produce the proper angles or curves in grade or alignment. Longitudinal seams in riveted pipe shall be double riveted in plates $\frac{3}{8}$ inch and less in thickness, in plates over $\frac{3}{8}$ inch in thickness they shall be triple riveted, all circular seams are to be single riveted.

WATER MAINS—Continued

Shop Riveting.—The spacing and the dimensions of rivets shall be as shown in the following table:

Thick-ness of plate, inches	Diameter of pipe, inches	Diameter of rivets, inches	LONGITUDINAL SEAM			Number of rivets, circular seams	Distance of rivets from edge of plate, inches	Maxi-mum head in feet	Shop test pressure, pounds per sq. inch
			Pitch of rivets, inches	Distance between rows, inches	No. of rows				
$\frac{1}{4}$	42	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	68	$1\frac{1}{8}$	262	175
$\frac{1}{4}$	36	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	56	$1\frac{1}{8}$	306	200
$\frac{1}{4}$	32	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	52	$1\frac{1}{8}$	345	225
$\frac{1}{4}$	30	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	48	$1\frac{1}{8}$	367	250
$\frac{1}{4}$	24	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	40	$1\frac{1}{8}$	459	300
$\frac{1}{4}$	20	$\frac{5}{8}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	32	$1\frac{1}{8}$	550	350
$\frac{3}{8}$	42	$\frac{3}{4}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	56	$1\frac{1}{4}$	320	200
$\frac{3}{8}$	36	$\frac{3}{4}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	48	$1\frac{1}{4}$	373	250
$\frac{3}{8}$	32	$\frac{3}{4}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	44	$1\frac{1}{4}$	420	275
$\frac{3}{8}$	30	$\frac{3}{4}$	$2\frac{1}{8}$	$1\frac{3}{8}$	2	40	$1\frac{1}{4}$	448	300
$\frac{3}{8}$	42	$\frac{7}{8}$	$2\frac{3}{4}$	$2\frac{1}{4}$	2	52	$1\frac{1}{8}$	387	250
$\frac{3}{8}$	36	$\frac{7}{8}$	$2\frac{3}{4}$	$2\frac{1}{4}$	2	44	$1\frac{1}{8}$	450	300
$\frac{7}{8}$	42	$\frac{7}{8}$	$3\frac{1}{8}$	2	3	52	$1\frac{1}{8}$	485	325

Allowable tension in plates, 14,000 lbs. per square inch, net section; allowable shear in rivets, 8,000 lbs. per square inch; allowable bearing of rivets, 16,000 lbs. per square inch.

Shop riveting must be done with hot rivets by steam, compressed air, or hydraulic machinery, capable of exerting a low pressure sufficient for the formation of perfect rivet heads. The rivet holes must be punched from the side of the plate which is to be placed in contact with another, and all burrs caused by the punch on the lower side of the plate must be removed by countersinking.

Drifting.—No excessive drifting will be allowed to force rivet holes to coincide at any seam or lap, and all plates will be rejected in which the said holes cannot be made to receive a rivet of the specified diameter with such slight drifting or reaming as will not, in the opinion of the City Engineer, materially reduce the strength of the plate.

Formation of Angles and Curves.—Where angles and curves occur in the alignment and grade of the pipe line, the plates must be cut and punched to the required lines for forming a slight oblique angle at the circular seams, or as many courses as may be needed to produce the given total deflection, or curvature, in each locality. Copies of shop sheets to be furnished the City Engineer before manufacture of pipe.

Caulking.—As soon as riveted, the pipe shall be properly caulked, both inside and outside, in a workmanlike manner, by the most approved pneumatic machines; all caulking to be done by round-nosed caulking tools, no split caulking being allowed.

Testing.—Each section of pipe after completion, and before coating, shall be subjected to a hydrostatic pressure equal to one and one-half ($1\frac{1}{2}$) times its allowable working pressure. The pipe must, during said test, be absolutely free from leaks or fractures.

Cleaning.—Before the pipe sections are coated, they shall be thoroughly cleaned by the sandblast or other equally efficient means, so as to show in all parts the color of the metal.

Coating.—Immediately after being cleaned, and before any discoloration due to rusting has begun, the pipe shall be

carefully inspected, and upon approval by the City Engineer, or his authorized inspector, shall be coated by dipping vertically, in what is known as the "Pioneer Mineral Rubber Pipe Coating," or the "Sarco Mineral Rubber Pipe Coating," at a temperature of 400 degrees F., the pipe having been heated to the same temperature as the asphalt bath. The pipe, on being removed from the bath, shall present a thoroughly smooth and even surface, both on the inside and outside.

Manholes.—Wherever shown on the profile, the contractor shall place on the steel pipe manholes, with covers, gaskets and bolts, complete. The openings for said manholes shall be elliptical, having fourteen (14) and sixteen (16) inches, diameter, respectively. The joints between the cover and the frame must, in all cases, be made water-tight by facing the abutting surfaces and inserting a suitable gasket of sheet copper or lead.

Air Valves.—Air valves four (4) inches in diameter are to be placed on the pipe at points on the line as indicated on the profile. The valves are to be of the pattern known as the "Crispin Automatic Air and Vacuum Valve," or some other approved model, with one-half ($\frac{1}{2}$) inch bibb. Cast steel branches having flanges to conform to the circumference of the pipe at one end, and the other end fit the flanges of the valve, shall be used for attaching them to the pipe. Between the air valves and the casting on the pipe, there shall be placed a four (4) inch double-flanged gate valve.

Transportation.—The pipes and specials, on completion at the shop, shall be transported to the line of ditch, being carefully loaded on cars, wagons or trucks with skids and blocking and protected from chafing by chains or ropes, with rubber packing or other soft and yielding material. When the coating has been rubbed off any portion of the pipe, it may be replaced by "Pioneer Mineral Rubber Field Coating," or "Sarco Mineral Rubber Field Coating," or such other material as may be approved by the City Engineer. All damage or indentation of the pipes, before or during the laying in the ditch, must be repaired to the satisfaction of the City Engineer or the pipe will be rejected. Before laying of pipe in the ditch, the coating inside and outside must be carefully examined and repaired, when injured, in the manner above specified. The ends of each length must then, for a distance of three (3) inches, be carefully scraped inside and outside, and the coating entirely removed to insure a perfect contact of the metal.

Field Riveting.—All field rivets, for connecting lengths of pipe, attaching specials, etc., shall be air driven, from the outside of the pipe. Tools for "holding on" shall be operated by compressed air and shall be applied inside the pipe. All field joints are to be caulked as specified under "Caulking" above. As soon as each joint is caulked it must be cleaned and thoroughly painted with the field coating.

As the work on the pipe progresses, it will be examined by the City Engineer and under his direction the pipe shall be thoroughly cleaned, and all sacks, caulking tools, stones, and other debris accumulated during construction, must be removed. All defective caulking must be remedied, imperfect rivets replaced, and the coating renewed where found necessary.

Hydrostatic Tests.—After the pipe has been laid in the trench, it must be plugged at the ends and tested with hydrostatic pressure in convenient sections of such length as the

City Engineer may direct, to fifty pounds per square inch in excess of the pressure to which it will be subject under the natural working conditions when in operation. In no case shall the test pressure be less than 150 pounds per square inch. Caulking must be continued until the pipe is tight at this pressure.

The contractor must find his own ways and means of furnishing water and appliances and material for testing, and the caps, plugs, etc., necessary for closing all openings in the pipe and branches. The closing of said openings must in all cases be absolutely tight to prevent filling the trench with water. Should any pipe, special or appurtenance, break in making said test, they must be replaced by the contractor at his own expense.

Trenching and Backfilling.—The requirements specified under "Trenching" and "Backfilling" for Cast Iron Pipe shall be held to cover the same operations for Steel Pipe.

Bidding Formalities.—Bids on the pipe shall include the cost of supplying the materials as specified, free from all charges, and must include the cost of delivering all materials along the line of the trench, excavating the trench, backfilling, putting in place, making all connections and supplying materials therefor, digging all joint holes, and in every way putting the pressure pipe into proper shape for permanent use, and into the finished condition contemplated by the plans and specifications.

ADJUSTMENT OF WATER MAINS

Where shown on the plan, or where ordered by the City Engineer, the existing water mains are to be adjusted to the finished grade of the streets. Water mains to be adjusted for grade are to be raised or lowered in such a manner and by such means as will not interfere with the supply of water to consumers who may be connected therewith. Mains are to be lowered, or raised, without turning the water out of same, except in special cases where written permission of the City Water Department is obtained. As soon as the main is adjusted to grade, and before it is covered with earth, and while it is full of water under full service pressure, it shall be carefully tested for leaks by the City. Leaks shall be carefully stopped in a workmanlike manner.

The contractor shall give twenty-four hours' notice to the City Engineer's Office and to the City Water Department before he commences to adjust any section of water mains, and he shall not proceed with the work until he has been notified by each department that he may do so. The City Water Department will furnish a man who will be authorized to close and open gate valves and service cocks, and in no case shall the contractor open or close gate valves or service cocks. Service connections will be cared for by the City Water Department, and their adjustment will not be a part of this contract.

Water mains to be adjusted will be paid for at the rate bid therefor per linear foot, and the price so bid shall include the cost of making any adjustments as shown on the plans for this improvement, and the price so bid shall include all excavation, labor, supervision, testing, the furnishing of all necessary blocking and other material necessary to secure the finished result; and shall include also the adjustment of all gate valves and valve boxes and other appurtenances except hydrants.

Should the City Engineer order any additional adjustments of water mains, the same will be paid for per linear foot at

the rate bid for "Additional Adjustment of Water Mains for each six inches of depth," and the price so bid shall be in full for any additional adjustment caused by change of grade or other cause. In estimating this additional adjustment, the average difference between the final position of the pipe and the position as shown on the plan will be taken. If the average adjustment for any section is six (6) inches or less, the actual number of linear feet in the section will be allowed for; if the average adjustment is one (1) foot or less, but more than six (6) inches, twice the actual number of linear feet in the section will be allowed for, etc.

In all work connected with the adjustment of water mains, the quality of work and material shall conform to the City of Seattle standard specifications.

The Board of Public Works reserves the right to have the City Water Department adjust all water mains, hydrants, etc., or to require the contractor to make such adjustments at the rate bid therefor.

Should the Board of Public Works direct that the Water Department adjust any water main or hydrant, then the contractor shall pay into the City Treasury, to the credit of the Water Fund, such a sum of money as is equal to the actual cost of the work performed by the Water Department. The contractor will in that case be allowed such amount on his final estimate.

Miscellaneous Items

Connections to Existing Mains.—All connections of water mains in use will be made by the City Water Department. Any crosses or other special required to be inserted in any main already in use shall be furnished by the contractor and set by the City Water Department. The contractor shall furnish the specials, as shown on the plans, and all other material required, and shall make all necessary excavations at his own expense. The labor of cutting and inserting the special will be performed by the City Water Department. The contractor shall give at least twenty-four hours' notice when the service of the Water Department is required.

The City Water Department will charge the contractor for this labor, and the amount so charged shall be paid into the City Treasury, to the credit of the Water Fund. The amount so paid by the contractor will be returned to him in the estimates.

Service Connections.—As soon as the section satisfactorily stands the required test, the Water Department will make any service connections or changes of connection required. The contractor will leave open the section of trench until such connections have been made, except at street crossings and where back-filling is specially directed by the City Engineer.

For the purpose of supplying consumers with water, it is understood and agreed that the City of Seattle shall have the right, at such time, or times, and at such place or places, as the Board of Public Works may elect, during the progress of the improvement, to attach corporation cocks to the main or mains to be constructed hereunder, and the attaching of any such corporation cock or cocks shall not be construed as an acceptance by the City of Seattle of any part of the work to be performed under this contract.

Removal of Old Pipe.—The contractor will be required to give proper care and protection, during construction, to any water pipes or mains in use.

As soon as service connections have been made all the

old pipe will be taken up and removed by the Water Department. When the old pipe does not come in the same trench as the new pipe the entire work of digging up, taking out and removing such old pipe and back-filling will be performed by the Water Department. When it does come in the same trench all excavation and back filling shall be performed by the contractor, when directed by the City Engineer.

Maintenance of Roadway.—After the trenches have been flushed, and before the final release of the contract, the street surface shall be restored and any surplus earth removed. In all cases the contractor shall maintain the roadway over the water main constructed for a period of thirty (30) days after the acceptance of the water main by the Board of Public Works, and in no case will the thirty (30) per cent. of the total amount of the contract reserved for thirty (30) days under the provisions of the City Charter be paid to the contractor until the roadway shall have been leveled or surfaced to the satisfaction of the City Engineer.

PAVING

Clearing and Grubbing. See page 1.
Sub-Grading. See page 4.

CONCRETE BASE

The concrete base for pavements shall be composed of one part Portland cement, four parts sand and seven parts gravel (1:4:7) by measure. A barrel of cement weighing not less than 376 pounds shall be taken as measuring three and one-half (3½) cubic feet. The concrete shall measure three and be mixed in accordance with the standard specifications of the City of Seattle for concrete sidewalks, except that the gravel shall range uniformly from one-fourth (¼) to two and one-half (2½) inches in diameter. The concrete may be mixed by a machine of the batch type approved by the City Engineer, and which admits of the accurate measurement of the sand and gravel. The amount of water used shall be accurately gauged, and together with the number of revolutions per batch shall be as directed by the City Engineer, from time to time.

All concrete shall be carefully deposited in such manner as to disturb the sub-grading as little as possible. In hot and dry weather, the ground shall be thoroughly sprinkled before the concrete is laid. In wet weather, the sub-grade shall be protected by planking, and all turning of carts or wheel-barrow shall be done on the planking. No tearing up of the sub-grading or turning of the carts on the same will be permitted.


An allowance will be made the contractor on the monthly estimates for concrete base laid but not covered with pavement as follows:

4-inch base, 60 cts. per sq. yd.
5-inch base, 75 cts. per sq. yd.
6-inch base, 90 cts. per sq. yd.

These allowances will be withdrawn as soon as the base is covered.

Grade stakes shall be furnished by the contractor and set by the Engineer during the progress of the work when deemed necessary by him. These stakes must be maintained

PAVING—Continued

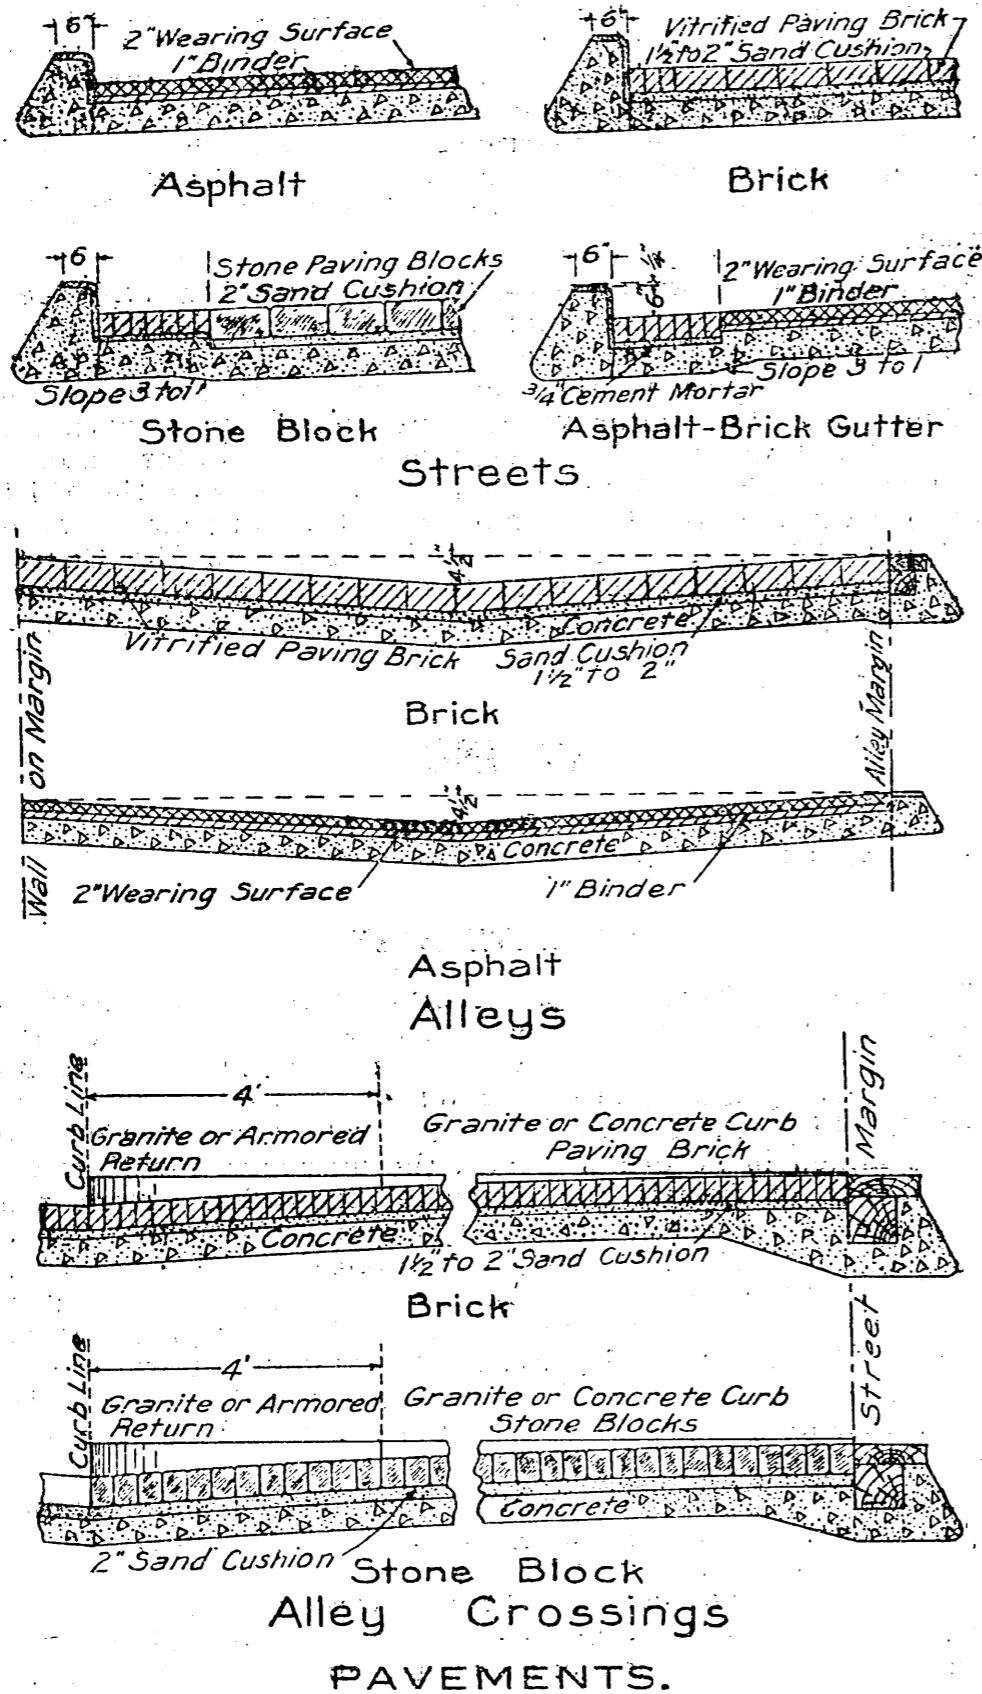

PAVEMENTS.

in place by the contractor until ordered removed by the Engineer, after which the holes shall be filled with cement mortar or concrete, and tamped flush with the surrounding surface.

Concrete base shall be allowed to set at least six (6) days undisturbed, and during this period shall be thoroughly wetted as often as may be directed by the City Engineer.

Payment for concrete base will be included in the price bid for pavement.

PAVING—Continued

ADDITIONAL BASE

Concrete base shall be laid the extra thickness designated by the City Engineer, complying to all requirements as specified above for concrete base.

Payment for additional concrete base will be at the rate bid per square yard for each extra one (1) inch in thickness.

STONE BLOCK PAVEMENT

The blocks shall be of a durable, sound and uniform quality. The stone shall be of the same quality as to hardness, color and grain. No out-crop, soft, brittle or laminated stone will be accepted.

Size of blocks will be not less than three and one-half (3½) nor more than four (4) inches thick; not less than five (5) nor more than five and one-half (5½) inches deep, and from eight (8) to twelve (12) inches long. The surface of the blocks to have parallel and rectangular sides and ends and so prepared that when in place and resting against the adjoining stone, the joints in their widest part shall not exceed one-half (½) inch in width.

Stones are to be split or broken with top surface hammer-cut or axed off smooth; sides and ends being dressed, when necessary, to secure the one-half (½) inch joints as specified.

Upon the concrete base is spread a layer of clean, dry coarse-screened bedding sand, and on this sand the blocks are to be laid in straight and even courses of uniform depth at right angles with the line of the street, unless otherwise directed by the City Engineer; with close joints, longitudinal joints broken by a lap of at least three (3) inches; sufficient sand being used to bring the blocks to grade and form for the finished roadway. After they have been thoroughly rammed as hereinafter provided, they shall be carefully fitted around all catch basins, manholes, inlets and other openings. No piece smaller than one-half (½) a block to be used. All blocks not uniform in width, or improperly laid, shall be taken out and proper ones set in their places. Enough clean gravel in size from one-eighth (⅛) to one-quarter (¼) of an inch is to be spread over the blocks, raked and swept into the joints to fill them half full. The blocks are then to be thoroughly rammed to the satisfaction of the City Engineer to a firm, unyielding bed, the surface parallel to the grade and crown required. Blocks broken in process of ramming shall be removed and replaced by sound blocks thoroughly tamped. Rammers used in compacting the blocks shall be of size and make as specified by the City Engineer. No ramming is to be done within fifteen (15) feet of the face of the paving that is being laid.

After the surface has been thoroughly compacted, it shall be swept clean and the remaining portion of the joints and spaces between the blocks filled with two coats of cement grout in the manner as provided for under Brick Paving, except that the first coat shall be a mixture composed of one (1) part Portland cement to two (2) parts sand, and the second coat shall be a mixture composed of one (1) part Portland cement and one (1) part sand. Grout mixing boxes shall be used as provided for under Brick Paving.

Bidders Will be Required to submit samples of the stone blocks which they propose to use in this improvement, with their commercial names, and no stone block will be accepted that is not equal or superior to the samples submitted.

BRICK PAVEMENT

Brick pavement shall consist of: 1st. A concrete base of the thickness specified. 2nd. A sand cushion; and 3rd. A surface of vitrified brick.

Brick.—The brick to be used in the pavement shall have the following dimensions: Two and three-eighths ($2\frac{3}{8}$) inches by four and one-eighth ($4\frac{1}{8}$) inches by eight and three-eighths ($8\frac{3}{8}$) inches. They shall not vary from these dimensions more than five (5) per cent. Special shaped bricks shall be furnished where required. All exposed edges shall be rounded to a radius of not more than one-fourth ($\frac{1}{4}$) of an inch. The top surface as laid in the pavement shall have a perfectly smooth straight surface, and the remainder of the brick shall be sufficiently straight and free from warp to fit evenly and snugly in the pavement in connection with surrounding brick. Slight kiln marks on the surface next to the sand cushion will be permitted, but brick which show any marked rounding or warping will be rejected. They shall be free from checks and fire cracks. They shall have four lugs or projections on one vertical face, the lugs to be not more than three (3) square inches in area nor to project more than one-eighth ($\frac{1}{8}$) of an inch. The imprint or name of maker, if used, shall be by means of recessed, and not by means of raised letters.

When broken, the fracture shall be smooth and straight. The texture of the brick shall show a uniform vitrification throughout and shall not be granular nor show any marked lamination.

The absorption of moisture of any block or portion thereof shall not exceed three (3) per cent. of the weight of any sample after thorough drying and immersion in water for three (3) consecutive days. No bricks will be accepted which contain lime or other soluble substances in such proportions as to cause spalling or pitting of the surface when soaked in water for three (3) consecutive days and then exposed to the air for a corresponding length of time.

The average crushing strength of two-inch (2 in.) cubes, taken from any part of the brick shall not be less than twelve thousand (12,000) pounds per square inch.

The specific gravity shall not be less than two and one-quarter ($2\frac{1}{4}$), and each brick must be toughened by thorough annealing in the kiln.

The loss in weight of any whole brick placed loose, either single or in lots, in a cast iron drum or hollow cylinder twenty-four (24) inches in diameter, similar to those used as rattlers in foundries, revolving at a rate not exceeding thirty (30) revolutions per minute, shall not be more than fifteen (15) per cent. after six hundred (600) revolutions, twenty-five (25) per cent. after two thousand (2000) revolutions, or thirty-five (35) per cent. after four thousand (4000) revolutions.

All bricks will be inspected in a general way when the same are delivered upon the ground and samples will be selected by the City Engineer for such tests as he may deem necessary. The failure of several samples selected from any shipment or pile of brick to satisfactorily withstand any of the tests herein specified may, at the option of the City Engineer, cause the rejection of the whole of such pile or shipment, and the same shall be immediately removed by the contractor as hereinafter specified. If, during the progress of construction or after the completion of the pavement, any soft, fractured, spalled or otherwise defective or objectionable brick is detected in such pavement, such brick

or bricks shall be immediately taken out and replaced by acceptable brick or bricks.

These conditions regarding the brick used in the pavement will be rigidly enforced during the entire time specified for maintenance by the contractor.

Brick Laying.—When delivered, the brick shall be piled in tiers on the wagon and carefully removed therefrom by hand, and piled on boards or other suitable platform to protect them from the dirt. No dirty brick will be permitted in the pavement, nor will dumping of brick from the wagon be allowed. The brick shall be carried from the piles to the brick layers, in clamps or pallets, by hand. No wheeling of bricks in barrows, over those already laid, will be permitted. They shall be sorted and culled at the piles before delivery to the brick layers. Care shall be taken to use brick of approximately the same size and degree of hardness in the same locality.

The brick shall be carefully laid upon the sand cushion, each course breaking joints and the courses laid to true lines. They shall be laid with the best surface exposed. No bats or broken brick will be allowed in any part of the work except at the end of the courses, where nothing less than a half brick shall be used. Around all covers or castings belonging to the sewer, water or lighting systems or other public utilities, which may be found within the line of the improvement, the brick shall be carefully cut and fitted. The surface of all such covers or castings shall be brought to true grade and must be coincident with the surface of the surrounding pavement when finished. The brick shall be laid in rows transversely to the roadway, except that there shall be three longitudinal rows next to the curb. At the street intersections the brick shall be laid as directed by the Engineer. In alleys, when the grade does not exceed one (1%) per cent., four courses of brick shall be laid longitudinally along the valley. After being set, each row shall be barred or driven together end on so as to make the smallest possible end joint, and said rows shall be barred or driven together sidewise, every fifth course, to a perfectly straight line. The course must be kept straight within a maximum variation of not over two (2) inches. Any variation greater than this shall be remedied by taking up as many courses as may be necessary, and relaying the same.

After laying, and before rolling, the brick will be inspected, and all soft, spalled or badly shaped brick must be removed and replaced with perfect ones. Any brick showing kiln marks may be turned over, provided the reverse surface be smooth. In replacing brick, care shall be taken to adjust the sand cushion to bring the surface even with surrounding brick. The City Engineer may cause the pavement to be sprinkled with water by the contractor, and any soft brick which show up under this test shall be removed and replaced with brick of a suitable degree of hardness. Special care shall be taken at all times previous to grouting to keep the pavement free from sand, dirt or other debris which will fill up the joints.

In case the surface of the concrete, for any reason, will not permit the laying of the sand cushions within these limits, it shall be cut down if too high, provided the thickness is sufficient; or brought up, if low, by addition of mortar or concrete carefully spread and tamped.

The brick shall then be rolled with a steam roller weighing not less than two and one-half ($2\frac{1}{2}$) tons nor more than five (5) tons, until brought to a perfectly smooth and even surface. The rolling shall commence near the curb at a

very slow pace and continue back and forth until the center of the pavement is reached; then the roller shall pass to the opposite curb and repeat the operation. After the first longitudinal rolling, the pavement shall be rolled transversely at an angle of forty-five degrees (45°) to the curb, and this transverse rolling repeated in the opposite direction.

An expansion cushion shall be provided next the curb. In laying the brick, a board sized on both sides to a taper of about one-quarter ($\frac{1}{4}$) inch and of about one (1) inch in thickness and not less than one (1) inch higher than the brick, shall be placed next to the curb and shall remain there until the brick have been rolled and grouted. It shall then be very carefully removed in such a manner as not to injure the pavement, and the space filled with melted asphalt, having a temperature of from 45° to 60° Dow.

Grout Filler.—After all defective brick have been removed and replaced by sound brick, and after the brick have been properly rolled and brought to a true and even surface, conforming to the grade and crown required, the pavement shall be thoroughly swept clean. The brick shall then be sprinkled with water and the joints filled with Portland Cement Grout. The grout shall be composed of one part of Portland cement and one part of clean, fine sand. The use of coarse sand suitable for concrete will not be permitted. It shall be as nearly dry as possible before admixture with the cement. It shall be mixed in batches not larger than one sack of cement and an equal amount of sand. The materials shall be placed in a proper box and mixed dry until the mass assumes an even and unbroken color; then sufficient water shall be added to form a liquid mixture of the consistency of thin cream and which will flow easily to the bottom of the joints. From the time the water is applied until the last drop is removed and placed in the pavement, it shall be kept in constant motion by stirring to the bottom. The mixture shall be removed from the box to the surface of the street with scoop shovels and shall be stirred constantly in the box while the same is being emptied. The box shall be not more than four (4) feet long by two and one-half ($2\frac{1}{2}$) feet wide and fourteen (14) inches deep. It shall rest on legs of different lengths, so that the mixture will readily flow to the lower corner of the box, which shall be not less than nine (9) inches above the pavement. From the moment the grout is applied to the pavement, it shall be thoroughly broomed into the joints. One box shall be provided for every fifteen feet of width in the street, or major fraction thereof.

The work of filling shall be carried forward in a uniform line until fifty or sixty feet in length has been covered, when the crew shall be turned back and cover the same space in a similar manner, except that the proportions shall be one (1) sack of cement to one-half ($\frac{1}{2}$) the amount of sand and shall be mixed slightly thicker in consistency than the first coat. If the grout thickens at any point, it shall be gently sprinkled with water from a can fitted with a rose sprinkler. Within one-half to three-quarters of an hour after the last coat has been applied, the whole surface must be slightly sprinkled, and all surplus mixture left on the top of the bricks swept into the joints, bringing them up flush and full.

Instead of mixing the grout in boxes, as herein provided, any mechanical device which keeps the grout in constant motion and distributes it evenly on the pavement may be used, subject to the approval of the City Engineer. After the joints have been filled flush with the top of the brick and the initial set has taken place, a coating of one-half ($\frac{1}{2}$)


inch of sand shall be spread over the whole surface and if necessary kept damp by sprinkling for not less than three (3) days.

Before acceptance of the work, the pavement shall be thoroughly cleaned and washed.

Payment.—Payment for brick pavement will include concrete base, sand cushion, brick, filling joints and sand coating, and all other labor and materials required by these specifications.

BRICK BLOCK PAVEMENT

The specifications herein for brick paving shall apply for brick block paving except as to size of blocks. The cement

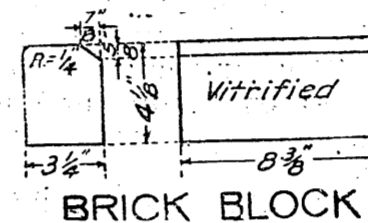

grout filler shall not be kept higher than the bottom of the level of the brick.

BRICK GUTTERS

All brick used shall be smooth, conforming to the general requirements for paving brick, as specified under "Brick Pavement." Whenever the roadway pavement is asphalt or stone blocks, then the brick gutters adjacent to same shall be laid in a bed of cement mortar three-fourths ($\frac{3}{4}$) of an inch in thickness, mixed one (1) part Portland cement to five (5) parts sand. Whenever the roadway pavement is brick, the brick gutters shall be laid on a sand cushion similar to that used for the brick pavement in the roadway. After being laid and thoroughly wetted to the satisfaction of the City Engineer, the brick shall be carefully tamped and brought to a smooth and even surface, conforming to the grade and crown. All joints shall be completely filled with Portland cement grout as specified under "Brick Pavement."

Measurement will be the same as for other paving.

ASPHALT PAVEMENT

Asphalt Pavement Shall Consist of: 1st, a layer of concrete of the thickness specified; 2nd, a binder course one (1) inch in thickness, and 3rd, a wearing course two (2) inches in thickness.

Refined Asphalt.—The asphalt employed in the preparation of the asphaltic cement for use in the asphalt paving mixture shall be a solid natural bitumen obtained from some natural deposit that has been in use in the paving industry for at least five (5) years. It shall be so refined as to be in every respect uniform, of a character recognized as being suitable for asphaltic paving cement; must have been freed as far as possible from all foreign and organic matter and volatile oil, and at least 98.5 per cent. sol. in cold carbon disulphide, and must not contain more than two (2) per cent. of free carbon or soot. The penetration of this refined asphalt shall be 45° Dow or higher. When twenty (20)

grammes are placed in an oven at a temperature of 325 degrees Fahrenheit, for a period of five (5) consecutive hours, the loss shall not be greater than 3 per cent. by weight and the penetration of the residue shall not be less than 50 per cent. of that of original sample, these tests to be made under conditions and by methods employed in City Engineer's Testing Laboratory. The bitumen contained therein must be of a cementitious character, suitable to make, on proper admixture with the flux, a durable and satisfactory asphaltic paving cement, and shall be in all respects satisfactory to the City Engineer.

Satisfactory proof must be furnished that the asphalt proposed to be used has been in successful use as a paving material for at least three years.

Flux.—The oils used in the manufacture of the asphaltic cement shall be a petroleum from which the lighter oils have been removed by distillation. It shall be freed from coke and other impurities, and shall have a specific gravity of 18 degrees to 22 degrees Baume and fire test of 300 degrees Fahrenheit, and shall not contain more than ten (10) per cent. of paraffine.

The flux or petroleum substitute should be a residue from the distillation of California petroleum, with steam agitation at a temperature not to exceed 620 degrees Fahrenheit.

It shall have the following characteristics:

1. It shall be soluble in carbon bi-sulphide to the extent of 99 per cent., and in 88 degrees naphtha to the extent of 90 per cent.
2. It shall be free from water, and shall not flash below 350 degrees Fahrenheit, in a New York State oil tester, and shall have a density of not less than .98 or 12.9 degrees Baume, or more than 1.050 or 9.3 degrees Baume at 25 degrees Centigrade when referred to water at the same temperature.
3. It shall volatilize not more than 5 per cent. of oil when heated for seven hours at 325 degrees Fahrenheit according to method employed by the City Engineer's laboratory.
4. The residue from heating the oil in the same way to 400 degrees Fahrenheit for seven hours shall be a soft flux, not hard enough to give a penetration of less than 130 degrees Dow Penetration Machine.
5. It shall not yield more than 6 per cent. fixed carbon on ignition.
6. Under the microscopes, beneath a cover glass, it shall appear free from insoluble or suspended matter.

Filler.—The filler shall be powdered mineral matter of such a degree of fineness that the whole of it shall pass a 50-mesh screen, and at least 66 per cent. shall pass a 200-mesh screen.

Asphaltic Cement.—The refined asphalt and flux of a character corresponding to that described in the foregoing paragraphs, shall be combined as follows for the preparation of asphaltic cement:

To the melted asphalt of a temperature of not over 350 degrees Fahrenheit the flux, after being heated to about 200 degrees Fahrenheit, is to be added in such proportions as to produce an asphaltic cement having a consistency as indicated by the Dow Penetration Machine of about 65 degrees at a standard temperature of 77 degrees Fahrenheit.

While the oil or flux is being added, agitation shall be

maintained by means of an air blast or live steam, and shall be continued until the asphaltic cement is homogeneous.

The agitation shall be continued for at least three (3) hours before attempting to use in pavement mixture, during which time the temperature shall be maintained at from 300 degrees to 325 degrees Fahrenheit.

Should the finished cement not prove of proper consistency, it shall be modified by the addition of further oil or melted asphalt, as may be necessary. The asphaltic cement while in use must be thoroughly agitated.

For every lot or shipment of asphalt or asphaltic flux used upon this contract, the contractor shall furnish a statement giving the selling agent or company, the refinery that refined the asphalt or prepared the flux, the field or locality from which the crude asphalt or flux was obtained, and a refining report of tests or penetration of each lot or run, with numbers corresponding to a batch or lot number plainly stenciled on each barrel or container. This report to be delivered to the department laboratory at the earliest possible date to allow sufficient time for sampling and making of tests as herein mentioned to verify refinery report and determine the suitability of the material offered before it will be accepted for use on this work.

Before beginning the operation of the plant, the City Engineer will assign, at the expense of the improvement district in which the asphalt is to be laid, a man skilled in the testing and mixing of asphalt paving mixtures, whose duty it shall be to supervise the testing, preparation and mixing of the various ingredients that enter into the making of a first-class asphalt paving mixture, and a part of whose duty it will be to see that none but competent men be employed in the various departments about the plant.

To facilitate the necessary test, and to provide for proper control of the plant work, the contractor shall provide a room convenient to the plant and well protected from dust and atmospheric changes (provided with telephone connections with the City Engineer's office), of approximately 150 square feet floor area and at least 9 feet from floor to ceiling, and provided with city water, gas, etc., and in which is provided a closet large enough for the penetration work, and in which closet the temperature can be raised to 77° Fahrenheit inside of thirty (30) minutes and maintained at that temperature constantly for a period of at least four (4) hours during such variation of weather and temperature as will occur when asphalt pavements are permitted to be put down.

This room shall be properly fitted up with the following testing apparatus for taking the penetration of and testing asphalt paving mixtures:

One apparatus, either of the Dow or New York Testing Laboratory Penetrometer Type, and a clock or pendulum for accurately measuring seconds.

At least two sets of standard 8-inch brass-bound sieves, from 10 to 200 mesh to the linear inch inclusive, as follows:

- 10 mesh to the linear inch
- 20 mesh to the linear inch
- 30 mesh to the linear inch
- 40 mesh to the linear inch
- 50 mesh to the linear inch
- 80 mesh to the linear inch
- 100 mesh to the linear inch
- 200 mesh to the linear inch

These sieves to be in nests of eight, with tight covers and dust pan, all to be approved by the City Engineer.

With the above sieves shall be provided a suitable balance or scale of about one and one-half or two pounds capacity for quickly and accurately weighing the percentage of the different sand residues remaining or passing the different mesh sieves.

There shall be provided two Baume hydrometers for liquids lighter than water, with a suitable hydrometer jar, two thermometers, Fahrenheit scale for measuring ordinary room temperatures, 6 asphalt thermometers with metal case of the type in use for taking temperatures of asphalt mixtures on the street and with a range of from about 200 degrees Fahrenheit to 400 degrees Fahrenheit, 12 thermometers with a range of from 1 degree Fahrenheit to 600 degrees Fahrenheit, 50 quart size Mason fruit jars, with screw top, for bringing samples of liquid flux to the Engineer's laboratory, 500 seamless tin boxes with covers, of about 2-ounce capacity, for penetration and other samples, 1 roll (about 40 pounds) of good manila wrapping paper, of the kind used for making patent stain test, 100 sample bags of about one pound capacity, for taking miscellaneous samples.

All of the above apparatus and supplies to be subject to the approval of the City Engineer. As the conditions under which asphalt pavements are used may vary, and the ingredients used therein may change from time to time, other tests may be prescribed by the City Engineer; the apparatus for which must be furnished by the contractor free of cost to the City, upon the written request of the City Engineer.

Each plant must be provided with a suitable portable platform with a platform at least 30 inches by 42 inches, and a weighing capacity of at least 2,500 pounds, for the use of the yardman and kettlemen in making up kettle charges.

Each melting kettle must be provided with some efficient means of agitation, to be approved by the City Engineer.

The dipping kettle, or kettle from which it is customary to draw the heated asphaltic cement for the pavement mixture must be fitted with efficient mechanical agitation, of a kind to be approved by the City Engineer.

In the yard, and convenient to each plant, there shall be the following quantities of paving materials:

- (1) 200 cu. yds. of sand that has been tested and accepted.
- (2) 100 cu. yds. of binder material that has been tested and accepted.
- (3) 200 tons of refined asphalt that has been tested and accepted.
- (4) 20 tons of asphalt flux or residuum oil that has been tested and accepted.
- (5) 10 tons of inorganic dust that has been tested and accepted.

At the time of signing the contract, the contractor shall designate the plant or plants which he expects to use in the preparation of the asphalt mixture for this particular contract, and after such plant or plants are designated and after the Engineer's Office has certified as to the acceptability of the plant or plants for the work in question, a change to some other plant or plants will not be allowed except upon the written permission of the City Engineer.

There must be installed in the plant and yards such contrivances and machinery as will insure the plant being operated with the least amount of dust, noise, smoke and nuisance to the surrounding community; there must be installed, convenient for the use of the plant employees, a satisfactory sanitary closet; and the yard and plant must be provided with hose, water plugs and fire extinguishing apparatus

so as to reduce the fire risk to the plant and neighboring buildings to the least amount possible under the circumstances; and it shall be the duty of the contractor at all times to so maintain the plant or plants that he is operating in a clean, sanitary manner, and to produce the least amount of nuisance and procure the least amount of fire risk to the surrounding property, and to proceed at once to remedy such defects upon the written request of the City Engineer.

Before acceptance of the plant, a thorough inspection of all equipment and machinery will be made by the City Engineer, and certificate must be obtained from him showing that the testing room is satisfactory and that it contains the required apparatus. Any defects appearing after such certificate has been issued and permission given to proceed with the work shall be immediately removed. If not so removed, the permission to use the plant will be revoked.

Samples of asphaltic cement and of all materials used in its manufacture shall be supplied to the City Engineer in suitable tin boxes or cans, when required, and he shall have access to all branches of the work at any time.

Binder.—The binder course shall consist of suitable, clean, broken stone, or a clean, hard burned clinker, in every respect equal and similar to that produced by the burning of the city refuse at the Municipal Refuse Destructor No. 1, passing a one (1) inch screen, not less than five per cent. nor more than ten per cent. of which shall pass a No. 10 screen; to this may be added not more than ten per cent. of fine gravel that will pass a three-quarter ($\frac{3}{4}$) inch ring. The stone or clinker shall be heated by passing through revolving heaters to a temperature not exceeding 350 degrees Fahrenheit, and then thoroughly mixed by machinery with asphaltic cement of suitable temperature and consistency and in such proportions that the resulting binder will have life and gloss without an excess of asphaltic cement. Should the binder appear dull from overheating or lack of cement, it will be rejected.

The binder mixture, prepared as above, shall be hauled to the street when heated, and carefully spread upon the foundation (which shall be first thoroughly swept clean), with hot iron rakes and shovels to such depth that after having received its final compression it shall be at least one inch thick, and shall then be immediately rolled with a five-ton steam roller. Rolling shall be continued while the binder is in a hot plastic condition.

Such portions of the binder as it may be impossible to roll shall be thoroughly rammed with hot iron tampers.

Should the binder show rich patches after rolling, these patches must be removed and replaced with suitable material.

The upper surface of the binder course shall be made exactly parallel with the surface of the finished pavement, and the whole course when finished must be compact and particles bound firmly together.

Wearing Surface.—Upon the binder course, prepared and laid as above specified, and thoroughly swept free from rubbish, shall be laid an asphalt wearing surface. It shall be composed of asphaltic cement, prepared as above specified, sand, finely powdered mineral matter, mixed in such proportions as shall produce a tough, compact and durable pavement; but in no case shall the percentage of the bitumen in the wearing surface, soluble in carbon bi-sulphide, be less than twelve (12) per cent.

The sand and the asphaltic cement shall be heated separately by means of suitable apparatus to about 300 degrees

PAVING—Continued

Fahrenheit, and never above 350 degrees Fahrenheit. Special care must be taken that the sand be uniformly heated throughout. The finely powdered mineral matter, while cold, shall be thoroughly mixed with heated sand, in the necessary proportions, and the combined sand and finely powdered mineral matter then mixed with the asphaltic cement at the required temperature, in the proper proportions, and by suitable apparatus, to effect a thoroughly homogeneous composition.

The wearing surface, prepared as above indicated, shall be delivered on the work in suitable trucks or dump wagons, at a temperature, regardless of the length of haul or temperature of the air, of not less than 275 degrees Fahrenheit, nor more than 350 degrees Fahrenheit. The contractor will be required to make such provisions for transportation as will secure this condition.

It shall at once be spread uniformly over the binder course with hot shovels and rakes having teeth three and one-half (3½) inches long in such manner as to give a uniform and regular grade, and to such depth that after having received its final compression it will have a net thickness of not less than two (2) inches.

After having been spread, the mixture shall be compressed with hot hand rollers weighing at least two hundred and fifty pounds to the foot width of roller. It shall then be rolled with a steam roller weighing not less than five (5) tons, after which a small amount of hydraulic cement shall be swept over it. This shall be followed by a roller of not less than ten (10) pounds; the rolling to be continued as long as it makes any impression on the surface, and in no case for less than five hours for each thousand square yards of pavement.

All portions of the pavement surface not accessible to the roller shall be compressed by tamping and smothered with hot irons.

Special care shall be taken to thoroughly tamp the hot asphalt mixture around any projecting manhole or catch basin covers.

Special care must also be taken to prevent the iron rakes, shovels, tampers, rollers, etc., from becoming overheated.

The resulting pavement must show a close-grained, even and smooth surface, true to grade and cross-section, and free from all hollows or inequalities.

No binder or wearing surface shall be laid in rainy weather, nor unless the surface of the concrete or binder is perfectly dry.

Asphalt Gutters.—On all streets in this district where asphalt is used for gutters a strip not less than eighteen (18) inches in width along the gutter line shall be coated with a coat of asphaltic cement, and ironed in with hot irons.

Measurements will be the same as for other pavement.

Payment for same will be included in price bid for "Asphalt Pavement."

General Requirements.—Whatever the character of the asphalt used, or the method of manipulation and laying, the pavement shall conform to the following requirements:

The pavement, when laid down, shall be dense, fine grained, hard and durable, of smooth and even surface, and free from any depressions which will retain water. It shall contain no water nor any appreciable amount of light oils, nor matter volatile at a temperature of 250 degrees Fahrenheit. It shall yield, when extracted with carbon bi-sulphide, not less than twelve (12) per cent. of pure bituminous matter.

PAVING—Continued

The mineral matter shall be graded within the following limits:

All shall pass a No. 8 screen.

From 0% to 2% shall be retained on a No. 10 screen.

From 1% to 5% shall be retained on a No. 20 screen.

From 3% to 8% shall be retained on a No. 30 screen.

From 5% to 13% shall be retained on a No. 40 screen.

From 7% to 17% shall be retained on a No. 50 screen.

From 20% to 36% shall be retained on a No. 80 screen.

From 8% to 16% shall be retained on a No. 100 screen.

From 10% to 15% shall be retained on a No. 200 screen.

From 10% to 15% shall pass a No. 200 screen.

The proportions, and physical and chemical properties, of the oil and asphalt and the asphaltic cement, sand, and finely powdered mineral matter in the wearing surface, shall be such as to produce the above described results, and shall be in all respects satisfactory to the City Engineer.

All exposed surfaces of castings shall be cleaned and then painted with one coat of hot asphalt. All exposed surfaces of gutters and curbs that come in contact with asphalt pavement shall be painted one coat of hot asphalt, special care being taken in painting curbs not to paint above the top of the gutter. Payment for this work will be included in the price bid for asphalt pavement.

None but skilled workmen shall be employed in mixing and laying the asphalt pavement.

Payment.—Payment will include placing all materials, including the concrete base, binder course, wearing surface and all other labor and materials required by the plans and specifications.

STONE ALLEY CROSSINGS

Stone Alley Crossings including the concrete base shall conform in all respects to the foregoing specifications for stone pavements.

BRICK ALLEY CROSSINGS

Brick Alley Crossings, including concrete base shall conform in all respects to the foregoing specifications for brick pavements.

Measurement will be the same as for other pavement.

CONCRETE GUTTERS

The materials for the concrete base and the cement wearing surface shall be as specified herein for "Concrete Sidewalks." When concrete gutter is attached to concrete stairways, the steel rods shall extend into the gutter as shown on the standard plan for concrete stairways.

Measurement will be on the slope.

PAVEMENT RELAID


The standard specifications for paving shall apply as in new work. Payment for removing old pavement will be included in the price bid for "Pavement Relaid."

Measurements.—All pavement will be determined by horizontal measurement but no allowance will be made for curvature of cross-section.


Traffic.—All traffic of any kind, except on planks, shall be rigidly prohibited on completed pavement for ten (10) days after the grout is filled in or until in the opinion of the City Engineer the pavement has become thoroughly set.

GRANITE CURBING

Curb stones shall be set, made from the best quality of granite, of the dimensions shown on the plans. For straight curbing, blocks shall not be less than four (4) feet in length. Stones for the curved corners shall be of the length shown on the plans. The top surface and the outside face down to the surface of the gutter shall be line work, having four cuts to the inch. The face of the stones for a distance of five (5) inches below the surface of the gutter, and the back of the stone for a distance of four (4) inches below the top of the curb, shall be uniformly pointed to an even surface. The bottom of all curbs shall have a true setting bed, so that the curbs shall have a uniform depth throughout. The remaining portions of the stones shall be uniform, and shall be true to line and free from depressions. All cut surfaces shall be true and

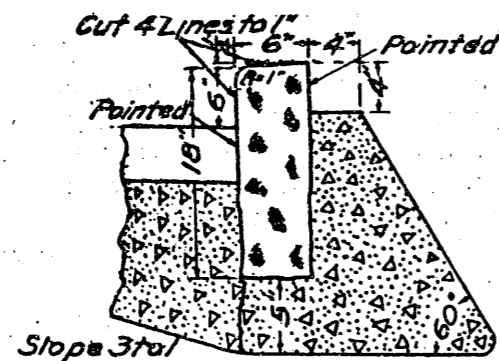

Granite

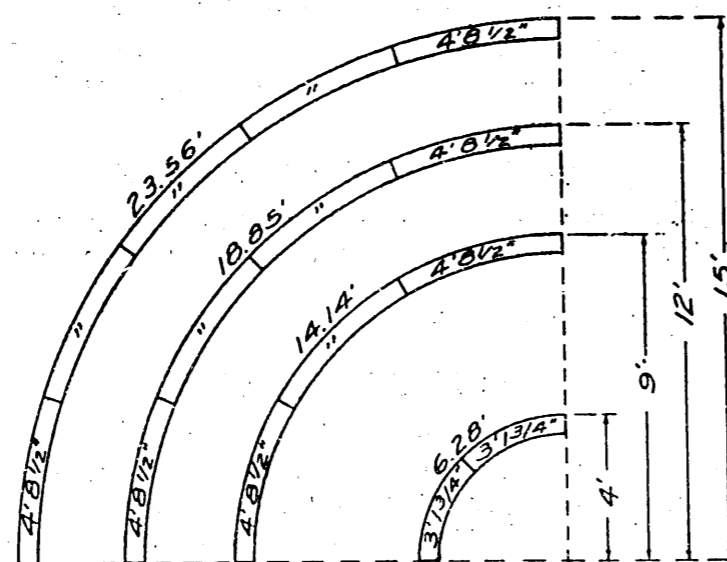


GRANITE RETURNS

out of wind. The top of all curb stones shall be cut with a slope of one-quarter ($\frac{1}{4}$) of an inch in six inches. The top angle of the street side shall be cut to a curve having a radius of one inch. The ends of all stones shall be full to square and shall make joints not exceeding one-quarter ($\frac{1}{4}$) of an inch in width. All joints must be thoroughly clean and free from dirt when set. All joints shall be filled with cement mortar, consisting of one (1) part Portland cement and two (2) parts clean sand. Trench for curb shall be carefully excavated at least five (5) inches below the bottom of the stone, and shall be wide enough to receive the concrete footing and backing shown on the plans. The concrete at the face of the stone shall be brought up and made continuous with the con-

crete in the pavement foundation. The amount of concrete back of the curb stone shall in all cases be not less than that shown on the standard plan. The concrete shall be uniform with that of the base.

CONCRETE CURBING

The concrete shall be composed of one part Portland cement, three parts sand and five parts gravel (1:3:5). The material for concrete shall conform to and be mixed in accordance with the standard specifications of the City of Seattle for Concrete Sidewalks, except that no gravel greater than one (1) inch in diameter shall be used. The material for forms shall be dressed on the edges and on the side next the concrete and shall be set securely so that the curbing, when completed, shall conform accurately to line and grade. After the concrete has been deposited, it shall be spaded back from the face of the form to a depth of not less than eight (8)

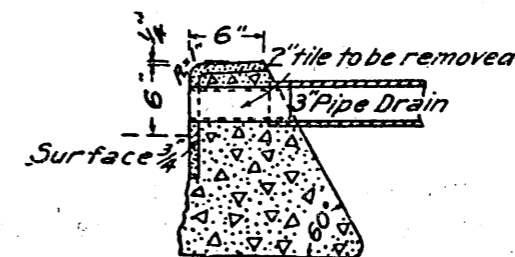

Concrete & Drain

inches and to a width of not less than three-fourths ($\frac{3}{4}$) of an inch at the top. The space thus formed shall be filled with Portland cement, mixed one part cement to one and one-half parts of sand. The concrete and mortar shall then be thoroughly spaded and tamped. The top layer, three-fourths ($\frac{3}{4}$) of an inch in thickness, consisting of a coat of cement mortar mixed as specified above, shall then be applied and thoroughly troweled down to a smooth and uniform finish, special care being taken to secure a perfect bond with the concrete.

After the forms have been removed, any defects on the top of the curbing must be corrected. Any faults or interstices shall be filled with cement mortar and smoothed so that the top and face of the curbing, for a depth of eight (8) inches, shall be free from defects. The contractor shall protect the curbing from all damage from traffic and from the weather. In hot, dry weather, he shall keep the curbing moist by sprinkling as often as the City Engineer may direct.

The contractor shall put in an expansion joint at each margin of the street and alley and at intervals not exceeding one hundred fifty (150) feet. This joint shall be made by putting in an iron sheeting one-eighth (1-8) of an inch in thickness, and the size of the cross-section of the curb, with a layer of gray felt one-quarter ($\frac{1}{4}$) of an inch in thickness and the size of a cross-section of the curb, on each side of the iron sheeting. After the concrete has set, the iron sheeting shall be removed. When this is done, care shall be taken to see that a free joint exists through the curb.


The extension of three (3) inch sewer pipes through the concrete curb shall be paid for as listed on the proposal.

Measurement.—All curbing will be measured along the curb line.

Payment.—Payment for concrete curbing will include the expansion joint.

ARMORED CONCRETE CURBING

Armored concrete curbing shall be constructed in precisely the same manner as specified for Concrete Curbing, except that proper provision shall be made for the insertion of the armor. The armor shall consist of a galvanized steel bar known as the Wainwright bar or any other bar of a pattern

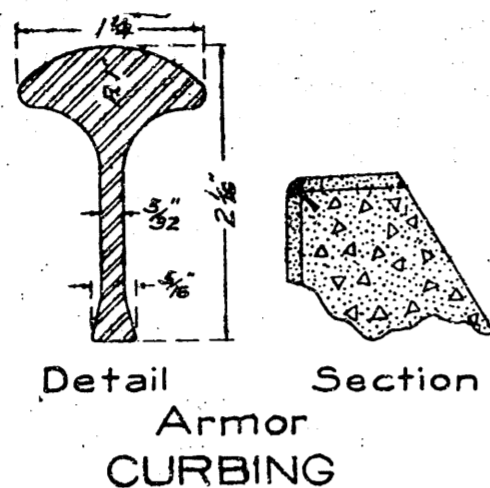

approved by the City Engineer. This armor shall be accurately placed on the edge of the curbing and shall connect smoothly with the top and sides. It shall extend not less than three feet beyond the point of curve on all curves, including alley returns. After the bar is set, the cement mortar top while still soft shall be thoroughly troweled and smoothed.

CONCRETE SIDEWALK REPAIRING


Where directed by the City Engineer, the existing concrete sidewalks shall be repaired or extended in accordance with the standard specifications of the City of Seattle for such work.

WOOD SIDEWALK REPAIRING

Where directed by the City Engineer any existing wooden sidewalks shall be carefully taken up and the lumber therein piled and protected until used. After the completion of the curbing, the sidewalks shall be rebuilt, using such old lumber as may be directed with such additional new lumber as may be required. All lumber shall be laid as provided in the standard specifications of the City of Seattle for Wooden Sidewalks.

WOOD STOPS

Wooden stops shall be placed along the edge of the pavement where the same is not otherwise protected. Said wooden stops shall consist of a continuous sound fir timber solidly bedded in concrete as shown by drawings, on which shall

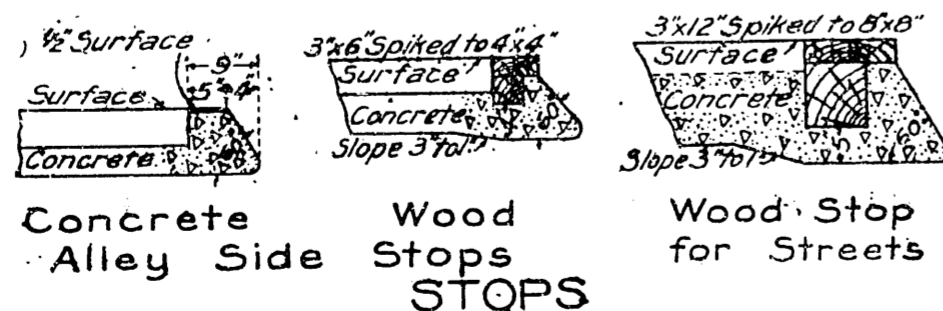

be spiked a continuous plank three (3) inches by twelve (12) inches, as shown. After the setting of the concrete, the earth surrounding such stops shall be properly surfaced and tamped to the level of the general surface.

WOOD ALLEY SIDE STOP


The timber shall be continuous, sound fir, of suitable lengths, solidly bedded in concrete. After the concrete sets, the earth adjoining the stops, shall be properly surfaced and tamped to a level of the general surface.

CONCRETE ALLEY SIDE STOP

The mixture shall be the same as the concrete base except that the facing shall be one (1) part Portland cement and one (1) part sand.

MONUMENT CASES

The material shall conform to the general requirements of these standard specifications for cast iron as specified under manhole covers.

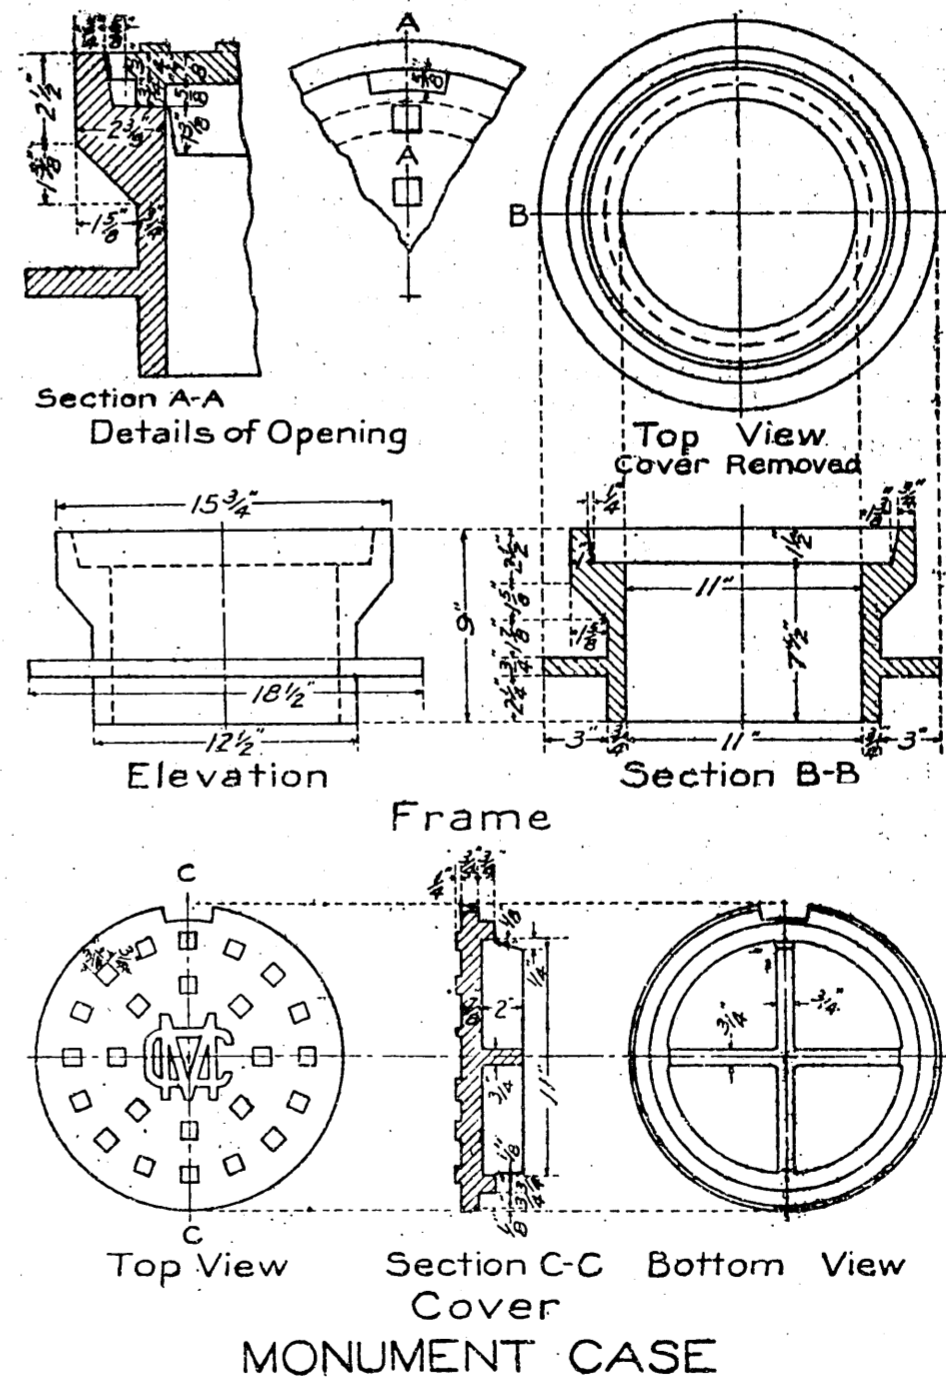

PAVING—Continued

ADJUSTMENT OF CAST IRON VALVE BOXES

Payment for adjusting cast iron valve boxes will be included in the price bid for pavement.

ADJUSTMENT OF MANHOLE, CATCH BASIN, ETC., COVERS

Manhole, catch basin, or similar covers, shall be adjusted to the proper grade in the manner as specified for setting covers in new work. Care should be taken that they are set to the grade and contour of the street in which they are placed, and that the pavement is brought up flush with the covers, especially in asphalt pavement.

ADJUSTING INLETS

Existing inlets shall be adjusted to the proper elevation. The contractor shall furnish all new material required and shall reset such inlets in the manner as specified for new work.

See Gravel Base for plan.

SUB-DRAINS—(Paving)

When all clearing and grubbing, excavating, rolling, etc., shall have been done to the satisfaction of the City Engineer, there shall be excavated trenches for tile drains where necessary. The excavations shall be made to a true line at least three (3) inches below the bottom of the tile pipe. Gravel or broken stone shall then be spread so as to form a bed for the pipe. The pipe shall be hard-burned tile drain without sockets. It shall be laid on a true grade line as given by the engineer, and shall be laid and connected to the inlet provided for it in the catch basin wall, or to such other pipe or outlet as the City Engineer may direct. The trench will then be filled with screened gravel to the surface, care being taken to have at least three (3) inches of gravel surrounding the pipe.

Payment will include the cost of making the connection to any pipe or catch basin.

OLD LUMBER RELAID

The surface of all connecting streets, roadways or walks, which by reason of this improvement fails to conform to the general surface of the finished improvement, shall be made to conform to such finished surface by filling with suitable material or by excavating, as the same may require, and all planking shall be neatly brought to grade and adjusted so as to form a continuous surface, to the satisfaction of the City Engineer. Such adjacent streets as may be designated by the City Engineer shall be planked with the lumber taken from the existing planking, curbs, gutters and crosswalks, which had been piled as directed under "Clearing and Grubbing."


GRAVEL SUB-BASE

Gravel shall be laid as directed by the City Engineer. It shall be screened and free from dirt and soil. The smallest stones shall not be less than one-quarter ($\frac{1}{4}$) of an inch in diameter, and the largest shall not exceed three (3) inches in any direction.


SIDEWALK REPAIRING—OLD LUMBER—NEW LUMBER

Whenever the present wooden sidewalks extend to the line of the proposed curb, such sidewalks, or such portions thereof

PAVING—Continued

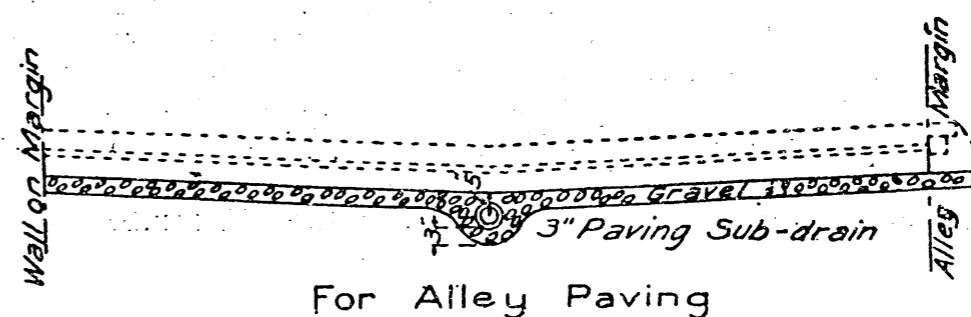

For Alley Paving

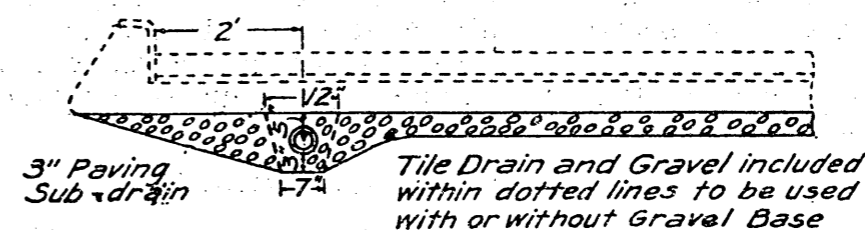

For Street Paving
GRAVEL BASE

as may be necessary, shall be taken up and all lumber found therein shall be neatly and carefully piled. Immediately after the setting of the curb, said sidewalks shall be rebuilt, using therein all old lumber which the City Engineer may consider suitable to remain in the structure, with the addition of such new lumber as may be necessary.


Where directed by the City Engineer, existing wooden sidewalks and landings shall be extended to the new curbs. The covering planks shall be two (2) inches by eight (8) inches, dressed on the upper side. All lumber shall be cut, fitted and nailed as provided in the standard specifications for wooden sidewalks.

The work of repairing, reconstructing, or extending, sidewalks will be paid for per M. ft. BM. of lumber in the finished structure, as hereinbefore stated, and bids shall be submitted for old and for new lumber.

CONCRETE ALLEY DRAINS

The outlet ends of these drains shall be neatly chiselled openings through the curb. The flow line and sides of the drains shall be smoothly finished.

A standard inlet shall be set in the manner hereinbefore

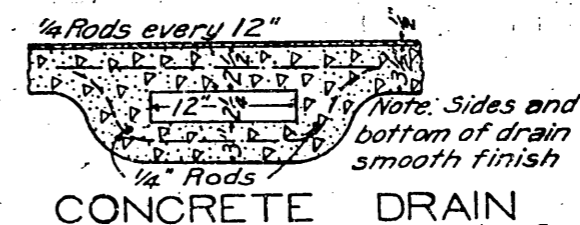

CONCRETE DRAIN

provided in these specifications and connected to this drain.

Payment will include furnishing and setting inlet, and making connections to drain, all concrete work, chiselling curb, steel and relaying concrete walks.

RELAYING OLD PLANKING

The existing planking shall be relaid in accordance with the standard plans and specifications for new planking, using

PLANKING

such of the old lumber as in the opinion of the City Engineer is suitable. The contractor shall pile up and protect all lumber to be relaid and will be held responsible for the safe keeping of the same. The lumber not to be relaid shall be piled and burned or disposed of as directed by the City Engineer.

Payment will include all handling of the old lumber.

EXTRA BINDER

Extra binder shall correspond to the standard specifications of the City of Seattle in all respects for binder as specified under asphalt pavement, except as to thickness, which shall be as shown on the improvement plan, or as designated by the City Engineer.

COAL FOR STEAM ROLLER

As directed by the City Engineer, the contractor shall furnish coal of a good quality for steam generating purposes for the operation of the city's steam roller if the same is used on this improvement.

PLANKING

Clearing and Grubbing. See page 1.
Sub-Grading. See page 5.

PLANKING OR REPLANKING

The stringers shall be of the sizes and spaced as indicated on the plan. They shall be solidly bedded in the prepared sub-grade so that their upper surface is uniformly the thickness of the planking below the grade prescribed for the finished surface except where otherwise specially directed by the Engineer. The earth must be thoroughly tamped under and around all stringers. In case of muddy or springy sub-grade the contractor shall furnish and lay suitable material such as cinders, to secure dry tamping.

The planks or pieces shall be sized on one side and of dimensions shown on the plan, except as hereinafter specified or shown on the plan at certain points where pieces of varying widths will be required. The lumber for planking shall be of uniform thickness, and shall be laid with that side of the lumber cut nearest the heart of the tree downward; provided that in case pieces with approximately square sections are specified instead of planks, such pieces shall be laid with the grain of the wood vertical. Where planks are specified, each plank shall be nailed to the stringer with wire nails of sufficient length to give at least four (4") inches penetration into the stringer, arranged two (2) nails over the stringers at the ends of each plank, and one nail at each intervening stringer "staggered."

All curb and gutter boards shown on the plan, with all necessary blocking and spiking, shall be furnished and laid in accordance with specifications for "Curbs and Gutters." The planking shall be shaped and fitted to the gutters and the edges bevelled.

At certain points in the district shown on plan where corners are to be turned or planking fitted to curves of the street railway portion, the planking shall be laid by the use of fan shaped pieces.

The contractor shall make all necessary adjustments to

PLANKING—Continued

existing cross-walks, planking, curbs and gutters, manhole, catch-basin and similar covers, in a neat and finished manner. Payment for which will be included in the price bid for lumber.

"Planking" shall be interpreted to mean the construction of a plank roadway on a street not previously so improved.

"Replanking" shall mean the replacing of wornout planking with new plank.

Measurements for planking or replanking shall be taken on the slope.

Payment for planking or replanking shall include the cost of sub-grading as specified under "Grading," page 5.

TIMBER TRESTLES

PILING

The contractor shall furnish, drive and cap all piles necessary to sustain the roadway, in accordance with detail plans or as directed by the City Engineer.

Bents shall be driven fifteen (15) feet six (6) inches between centers, and the position of each bent shall be located by the City Engineer.

All piles shall be fir, winter cut, straight and sound in every particular, free from large knots or other imperfections. They shall not be less than nine (9) inches nor more than fourteen (14) inches in diameter at the smaller end, nor less than fourteen (14) inches at cut-off. All dimensions shall be measured under the bark. They shall taper uniformly from end to end. Second growth piles shall not be used.

All piles shall be driven true and plumb at the points indicated. They must be driven until they will not penetrate more than two (2) inches under a fifteen (15) foot fall of thirty-five hundred (3500) pound hammer, and under no condition shall a pile have less than four-foot penetration. They shall be cut off at the elevations given by the City Engineer, said cut-offs being on a true line in order to give the caps a firm bearing. The tops of all piles shall be neatly chamfered so as not to project beyond the edge of the caps. All points of contact between timbers, such as tops of piles and posts and bearings of caps on piles and all stringers and caps, shall be thoroughly coated on both faces with hot Carbo-lineum Avernarius, hot creosote, or some other equally efficient preparation approved by the City Engineer.

Payment will be made for piling at the rate bid per linear foot of pile in completed structure, measurement to be made from point to cut-off, and shall include the furnishing, driving and cutting off of same as above specified. No payment will be allowed for that portion of the pile above the cut-off.

CREOSOTED PILING

Watersoaked.—The piling to be treated must be Douglas fir, conforming to the City of Seattle's specifications for this class of material, the cubical contents of each stick being determined by the satisfaction of the City Engineer of Seattle.

Each cylinder charge must be made up of piles which have been in water as nearly as possible the same length of time; nor must they have been so long therein as to cause deterioration or damage of any kind, but at the time of treating must be thoroughly sound, free from sea worm holes and limoria, also from barnacles and the like.

After the piles are placed in the cylinder, they must be

immersed in creosote oil of a temperature ranging between 160° and 170° F., and kept covered during the entire boiling period under at least four inches of oil at the shallowest place. The engineer on duty must from time to time during the boiling satisfy himself by bleeding the cylinder, that such is the case.

After filling the cylinder with oil, steam must then be regulated through the heating coils so that the temperature within the cylinder is kept gradually rising as fast as the condensation will permit until 220° F. is reached; after which the steam pressure must only be such as to maintain a regular and constant temperature within the cylinder with 220° as the minimum and 225° F. the maximum, until such time as the amount of condensation per cubic foot per hour collecting in the hot well of the condenser shows the interior of the wood to be thoroughly dry, when the steam pressure in the coils should be released, and the cylinder filled up with creosote oil from the storage or working tank, of a temperature ranging between 160° and 170° F., then pump pressure applied until the gauge shows 5 lbs. pressure in the cylinder (this to insure the fact of the cylinder being actually full), after which the connection between storage tank and cylinder should be closed and the connection between measuring tank and cylinder opened. Additional pressure must then be applied until the piling has taken the proper amount of oil, forced in under such conditions as will insure its complete retention in the wood after drip is over, and figured at the weight of the dry oil per gallon at 165° F., the cylinder doors may then be opened provided the temperature within is reduced below 200° F.

After treatment, the piling must be free from all heat checks, water bursts, and other defects due to inferior treatment which would impair usefulness or durability for the purposes intended. Piles when bored midway between the ends must show no moisture in to the center, and the borings beyond the oil penetration must retain their natural elasticity and strength. The penetration of black oil midway between the ends, for a 10 lb. treatment should be at least three-quarters of an inch in piles up to 40 ft. in length; 1 to 1½ inches for piles between 40 and 70 ft. in length; and 1¼ to 1½ inches for piles 70 ft. and over; with a correspondingly greater depth for an increased quantity of oil.

Green or Freshly Cut and Seasoned Piling.—Green, or freshly cut piles delivered at the treating plant on cars, or any which have not been lying in the water, must be treated in the manner prescribed for green or freshly sawed material.

Thoroughly seasoned piles must be treated in the manner prescribed for thoroughly seasoned sawed material.

No piling in these two classes shall be mixed together and treated in the same charge.

Fir Sawed Material.—Seasoned, and green or freshly sawed material must not be mixed together and treated in same charge, and none should be treated which is not at the time free from rot, and in proper condition for use after treatment so far as splits or breaks are concerned; if any such is received from the mills it should not be treated unless the Inspector directs it to be done.

Square timber must not be treated in the same charge with planking, nor ties with planking, and sufficient one inch strips must be placed between each tier, with from one-half to one inch space left between each piece, so that the oil can have free access to all surfaces.

After the material is placed in the cylinder, it must be

immersed in creosoted oil of a temperature ranging between 160° and 170° F. and kept covered during the entire boiling or heating period under at least 4 inches of oil in the shallowest place; the engineer on duty must from time to time during the boiling, satisfy himself by bleeding the cylinder that such is the case.

In the case of green or freshly sawed material, steam must thereafter be regulated through the heating coils so that the temperature within the cylinder is kept gradually rising as fast as the condensation will permit until 202° F. is reached, with 215° F. as the maximum; after which the steam pressure must only be such as to maintain a regular and constant temperature within the cylinder between these figures, until such time as the amount of condensation per cubic foot per hour collecting in the hot well of the condenser shows the interior of the wood to be thoroughly dry, when steam pressure in the coils should be released.

In the case of thoroughly seasoned material, the temperature of the oil in the cylinder must be allowed to rise slowly and steadily until 190° F. is reached, with 192° F. as the maximum; and kept between these figures until such time (dependent upon the dimensions), as the interior of the wood shall have become sufficiently warmed up to enable it to take the required amount of oil, when the steam pressure in the coils should be released.

The cylinder should then (in each case) be filled up with creosote oil from the storage or working tank, of a temperature ranging between 160° and 170° F.; and pressure from the pump applied until the gauge shows 5 lbs. pressure in the cylinder, to insure the fact of the cylinder being actually full, after which the connection between storage tank and cylinder should be closed, and the connection between measuring tank and cylinder opened. Additional pressure must then be applied slowly and steadily until the material has taken the proper amount of oil, forced in under such conditions as will insure its complete retention in the wood after the drip is over, and figured at the weight of the dry oil per gallon at 165° F.; the cylinder doors may then be opened, provided the temperature within is below 200° F.

After treatment, the material must be free from all heat checks, water bursts and other defects due to inferior treatment, which would impair usefulness or durability for the purposes intended. The penetration of black oil midway between the ends for a 10 lb. treatment should be at least ¾ of an inch deep on dimension timber, and on planking at least ½ inch deep, with a correspondingly greater depth for an increased quantity of oil.

General Conditions.—All material shall be treated to the entire satisfaction of the inspector of the City of Seattle, he being allowed full access at all times to the facilities used in the treatment while it is in progress; but the fact of an inspector being at the plant shall not relieve the Treating Company's officials from the responsibility of seeing that the treatment of all material is properly and carefully done, with the agreed penetration of oil in each case, based on the contract amount.

Before the cylinder charge is disposed of, the depth and character of the penetration must be ascertained by boring one or more auger holes after the wood has cooled, in as many pieces of each class of material as may be necessary for the purpose; and such pieces as are not found to be fully treated in accordance herewith must be returned to the cylinder with a subsequent charge for further treatment with-

PLANKING—Continued

out extra cost therefor; should more than 10% of the total number of pieces treated be found defective, the entire charge must be so returned. No material must be removed from the treating yard until all auger holes are tightly plugged with creosoted plugs.

The intent of these specifications is that the wood, when it comes out of the cylinder and after all drip is over, shall contain the full weight of oil to the cubic foot, forced in at such pressure and under such conditions, as to enable the wood cells, and fiber to retain it permanently; but as there is more or less rebound of oil out of the wood after pressure is released, a checking up of the oil on hand against the total contract absorption of the various charges shall be made each twenty-four hours, timber and piling being kept separately; and if any difference is found to exist, a co-efficient shall be established and used until the next checking shows the necessity for a different one.

The pressure gauges and thermometers must be compared and tested at frequent intervals with standard test appliances kept on hand for that purpose, and all differences corrected.

Competent and experienced engineers shall be in charge of the treatment night and day, and required to make frequent examinations of the temperature during the boiling, especially when a maximum heat is being applied; the thermometers being located so that they will correctly reflect heat conditions within the cylinders, and at the same time be convenient to get out. In handling material after treatment, sharp dog or cant hooks must not be used in any way whereby the full protection of the treatment is likely to be lessened; where it may be necessary, as in the case of piling they must be used within the spaces two feet from the large end and six feet from the point. Any material broken or otherwise damaged in treatment or by careless handling, while in the Treating Company's care until delivered to its destination as per contract, will be rejected and the Treating Company must submit new pieces therefor.

The oil must be pure dead oil of coal tar without adulteration, with a specific gravity of 1.04 to 1.10 at a temperature of 60° F.; it must be perfectly liquid at 100° F.; and remain so on cooling down to 90° F. The distillation must be conducted under the Von Schrenk or American method as published in Bulletin No. 65 of the American Railway Engineering and Maintenance of Way Association, and of the dry oil, the boiling points shall be: Up to 210° C. not more than 5%, and between 210° C. and 235° C. not more than 30% shall distill over, while at 355° C. at least 90% shall distill over. As a different method of distillation is used abroad, sufficient allowance must be made in these percentages, in case the oil is imported, so as to bring it within the specified limits when analyzed by the above method.

Before the first treatment begins, the Treating Company must furnish a gallon sample of the oil proposed to be used hereunder, same to be sent to the City Chemist for analysis; and in case a different oil is thereafter used, a new sample must be sent as above for further examination.

SUPERSTRUCTURE

Posts.—Where posts are to be used instead of piling they shall be of the dimensions and construction as shown on the plans.

Caps shall be placed upon piles in such manner as to give a true line to the ends thereof. They shall be drift-bolted to

PLANKING—Continued

each pile with drift bolts three-quarters (¾) inch by twenty-two (22) inches, driven one to each cap at each pile. They shall be countersunk at least one (1") inch and the hole filled with hot pitch or asphalt.

Stringers shall be furnished and laid on bents, erected as hereinafter specified, and of size and spaced as shown on plans. Each stringer shall not be less than thirty-two (32) feet in length, and shall be laid upon caps so as to make lap joints alternating upon succeeding caps, except the outer stringers, which shall have butt joints. All stringers shall be toe-nailed to the caps with forty (40) penny wire nails, two to each cap.


The planking shall be sized on one side and laid close. Each plank shall be nailed to the stringers with nine (9) inch wire nails, arranged two (2) nails in the stringer at the end of each plank and one nail at each intervening stringer, staggered.

Sidewalks shall be constructed as hereinbefore specified.

Payment will be made for lumber in the completed structure only and shall include all nails, spikes and drift-bolts.

RAILING

The lumber used for railings shall be sized four sides and shall, when in position, be painted with two coats of mineral paint mixed with linseed oil (and unless such railings are specially classified on the bid blanks for this improvement as furnished by the City Engineer, such railings shall be paid for at the rate of ten (10) cents per linear foot) and in all cases the price paid per linear foot of railings shall include all material and labor, such as lumber, painting, spikes, excavating for posts, cutting, fitting and painting; all work to be done as directed and to the satisfaction of the City Engineer.

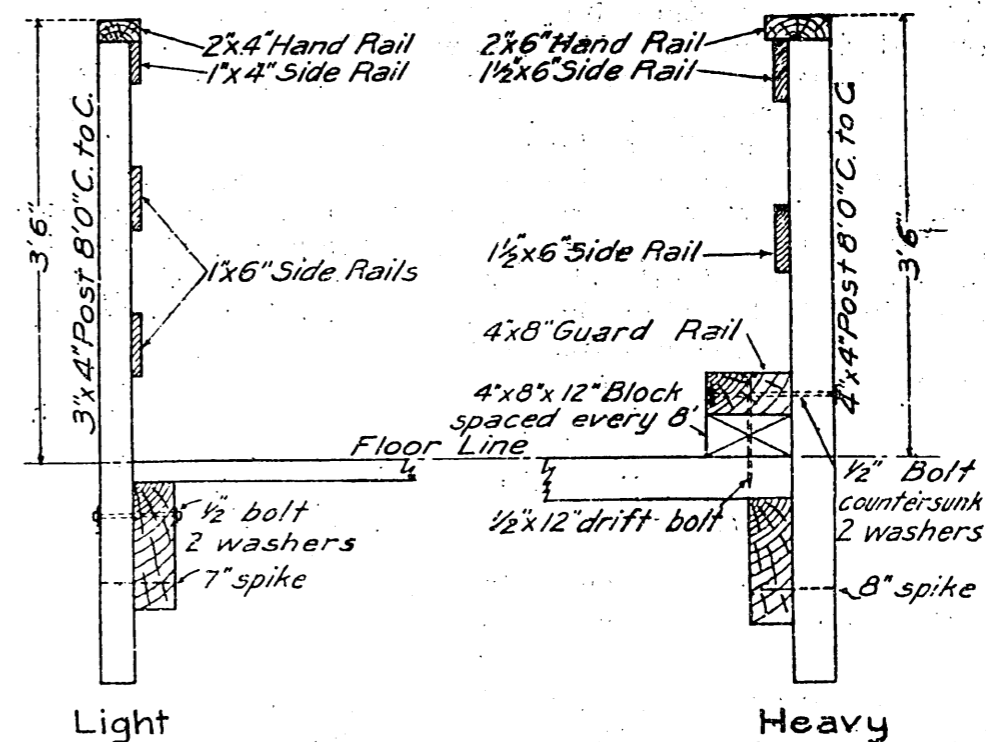

WOOD RAILING

GENERAL STIPULATIONS

TEMPORARY PLANKING

Temporary planking shall be laid where and in the manner as directed by the City Engineer.

Payment for temporary planking will include hauling away this plank to any part of the district as directed by the City Engineer.

MISCELLANEOUS ITEMS

CONCRETE

All concrete for general use, unless otherwise specified, shall be composed of one (1) part Portland cement, three (3) parts sand and six (6) parts gravel. The material used shall be of the same quality and mixed in the same manner as provided for under "Concrete Sidewalks."

Payment for concrete will include all necessary excavation for placing same.

EXTRA EXCAVATION

Extra excavation shall include all excavation not shown on the profiles and any excavation ordered by the City Engineer not otherwise covered by these specifications. In case it is necessary to abandon any work requiring excavation, the cost of which was included in the price bid for another item, the amount of such excavation will be paid for as "Extra Excavation."

Payment for extra excavation shall include all back-filling water settling or tamping.

LUMBER

All lumber used in this improvement shall be sound, live, yellow fir, free from loose, large or rotten knots, wind-shakes, pitch seams or other imperfections which may impair its strength or durability. No lumber shall be used which shows less than six annular rings of growth per inch, or which exposes the heart of the wood on the side of the timber. The City Engineer shall be the sole judge of the amount of sap which may be allowed. All dressed lumber shall not exceed or vary more than one-fourth ($\frac{1}{4}$) of an inch less than the specified dimension, and all rough lumber shall not vary more than one-eighth ($\frac{1}{8}$) of an inch from the specified dimension. All lumber shall meet the requirements as specified in this paragraph unless more particularly specified elsewhere.

GENERAL STIPULATIONS

It will be further expressly agreed between the parties to the contract for this improvement that the contract is made subject to the following conditions and stipulations:

1st. **Contractor's Responsibilities.** The contractor is required to furnish all necessary labor and materials, and to fully complete the said work in accordance with the plans and specifications, and to the satisfaction of the City Engineer, for the prices bid. Bidders must examine and judge for themselves as to the location of the proposed work, the

GENERAL STIPULATIONS—Continued

nature of the excavation to be made, and the work to be done. It is understood that the whole of the work to be performed under the contract for this improvement is to be done at the contractor's risk, and he is to assume the responsibility and risk of all damages to the work or to property on the line of said work which may be occasioned by floods, backwater, caving of the street, settling of the foundation of buildings, or for any cause whatever. The contractor shall have charge of and be responsible for the entire contract until its completion and acceptance. He shall also be liable for any defects which may appear on his work before the final payment specified herein.

2nd. **Begin Work.** The contractor shall commence the work at such points as the City Engineer may direct, and shall conform to his directions as to the order of time in which the different parts of the work shall be done.

3rd. **Directions—To Whom Given.** Whenever the contractor is not present on the work, orders will be given to the superintendent or overseer who may have immediate charge thereof, and shall by them be received and strictly obeyed. If any person employed on the work shall refuse or neglect to obey the directions of the City Engineer or Board of Public Works in anything relating to the work, or shall appear to be incompetent, disorderly or unfaithful, he shall, upon the requisition of the engineer be at once discharged, and not again employed upon any part of the work.

4th. **Protection of the Work.** The contractor will be required to observe all City Ordinances in relation to obstructing streets, keeping open passage ways and protecting the same where exposed, maintaining signals, and to obey all laws and ordinances controlling or limiting those engaged on the works. The said contractor expressly stipulates and agrees to erect and maintain good and sufficient guards, barricades and signals at all unsafe places on the works and to indemnify and save harmless the City of Seattle from all suits and actions, of every name and description brought against the City for, or on account of, any injuries or damages received or sustained by any party or parties by reason of the failure of said contractor to erect or maintain such guards, barricades, or signals, or by or in consequence of any negligence of said contractor or his or their agents or employes, in carrying on said work, or by or on account of any act or omission of said contractor in the performance of said work; and it is agreed by the contractor that so much of the money which shall be due to him under and by virtue of the contract for this improvement as shall be considered necessary by the Board of Public Works, may be retained by The City of Seattle until all suits or claims for damages as aforesaid shall have been settled, and evidence to that effect is furnished to the satisfaction of said Board of Public Works in addition to the percentage reserved as otherwise herein provided.

5th. **Disputes—How Settled.** To prevent all disputes and litigation it is further agreed by the contractor that the City Engineer shall in all cases determine the amount of work to be paid for under the contract for this improvement, and his estimates and decisions shall be final and conclusive, subject to the approval of the Board of Public Works.

6th. **Changes of Plans.** The City Engineer or Board of Public Works shall have the right to make changes in the location, construction, form, dimensions, grades and alignments, Y's, manholes, catch basins, ducts, cables, and other

GENERAL STIPULATIONS—Continued

connections and constructions, and make any variations in the quantity of the work to be done, as exhibited in the schedule of prices or bid for said work, and to entirely exclude any of the items of work relating to said quantities at any time, either before the commencement of the work, or during the progress, without thereby altering or invalidating any of the prices herein named; should such action diminish the amount of work that would otherwise be done, no claim shall be made for damages on the ground of loss of anticipated profits on work so dispensed with; and should such action be taken after the commencement of any particular piece of work, and result thereby in extra cost to the contractor, the City Engineer shall estimate the amount to be allowed therefor which he shall consider fair and equitable, and his decision shall be final and conclusive.

7th. Unnecessary Occupation of Streets. The contractor shall not be allowed to dig up or occupy with material any more of the street than is absolutely necessary for the prosecution of the work.

8th. Engineers—When Wanted. The contractor shall give forty-eight hours' notice, in writing, when he shall require the services of the Engineer for laying out any portion of the work. He shall dig all stake holes necessary to give grades. He shall furnish and keep on the work, at all times, a spirit-level and straight-edge, of such form and size as directed by the Engineer. He shall furnish all lumber for stakes, under direction of the Engineer, and shall carefully preserve all stakes when set. In case any stakes have to be replaced by the Engineer, the contractor shall be charged the expense thereof, and the same be deducted from his estimates.

9th. Monuments Not to be Disturbed. The contractor shall not disturb any monuments or stakes found on the line of the improvements until ordered by the Engineer. A penalty of twenty-five (\$25.00) dollars will be imposed for each monument disturbed without orders, and the amount deducted from the estimates.

10th. Provide for Flow of Water Courses, Etc. The contractor shall provide for the flow of all water courses, sewers or drains, intercepted during the progress of the work, and replace the same in as good condition as he found them, or shall make such final provisions for them into the sewer, or otherwise, as the Engineer shall direct. The use of any portion of the sewers shall not be construed as the acceptance of them by the Board of Public Works.

The contractor shall not obstruct the gutter of any street, but shall use all proper measures to provide for the free passage of surface water along the gutters.

11th. Protection to Public Utilities Owned by City. The contractor shall support and protect by timbers or otherwise, all water or sewer pipes, conduits, poles, wires or other apparatus owned by The City of Seattle which may be in any way affected by the work, and do everything necessary to support, sustain and protect the same, over, along or across said street. In case any of said water or sewer pipes, wires, poles or apparatus shall be damaged, they shall be repaired by the authorities having control of the same, and the expense of such repair shall be deducted from the amount due the contractor on his final estimate.

12th. Damage to Existing Improvements. All damage done to existing improvements during the progress of the work on this improvement shall be repaired by the contractor under

GENERAL STIPULATIONS—Continued

the directions of the City Engineer, using for such repairs materials conforming to the requirements of the standard specifications of the City of Seattle for the various items used. If the contractor fails to furnish the necessary labor and materials for such repairs when ordered, the City Engineer may cause said necessary labor and materials for such repairs to be furnished by other parties and the cost thereof shall be deducted from such money as may be due to the contractor by reason of work performed or materials furnished for any part of this improvement. No payment will be made for this work.

13th. Forfeiture of Contract. It is further especially agreed that if at any time the City Engineer is of the opinion that the work is unnecessarily delayed, and will not be finished within the prescribed time, he shall notify the contractor, in writing, to that effect. And if the said contractor shall not, within five days thereafter, take such measures as will, in the judgment of said Engineer, insure the satisfactory completion of the work, the Board of Public Works may then notify the said contractor to discontinue all work under the contract for this improvement; and it is hereby agreed that the said contractor shall immediately respect such notice and stop work and cease to have any rights to the possession of the grounds. The Board of Public Works may thereupon employ such force as they may deem advisable to complete the work, and charge the expense of all labor and materials necessary for such completion to the said contractor, and the expense so charged shall be deducted and paid by the City of Seattle out of such moneys as may be then due, or may afterward become due, to the said contractor under and by virtue of the contract for this improvement, and in case such expense is less than the sum which would have been payable under such contract if the same had been fulfilled by the said contractor, then said contractor shall be entitled to receive the difference; and in case such expense is greater the said contractor shall pay to the City the amount of such excess so due.

If the said contractor shall assign the contract for this improvement or abandon the work thereon, or shall neglect or refuse to comply with the instructions of the City Engineer relative thereto, or shall in any manner fail to comply with any of the specifications or stipulations herein contained, or with the requirements of the Charter, or Ordinances of the City, the Board of Public Works shall have the right to annul and cancel said contract, and to relet the work or any part thereof, and such annulment shall not entitle the said contractor to any claim for damages on account thereof, nor shall it affect the right of the City to recover damages which may arise from such failure.

14th. Claim for Extras. No claim for any extras under this contract will be considered by the Board of Public Works or City Engineer unless the same shall have been submitted previous to the final acceptance of the work and the passage of the final estimate. In case any extra work is required for which a price has not been included in the contract for this improvement, the same shall not be begun until a price therefor shall have been agreed upon, in writing, by the contractor and the City Engineer. If, for any reason, the said extra work cannot be performed at an agreed price, it will be paid for at the actual cost of all labor and material required, together with ten per cent. additional.

15th. Provision for Water and Gas Connections. The City of Seattle reserves the right to construct any sewer or sewers, or to lay any water mains, or to grant permits to the interested parties to lay gas mains, steam pipes, conduits, etc.,

GENERAL STIPULATIONS—Continued

or to build up and adjust or construct any manholes, or catch basins, or to reset or renew any frames or covers for manholes, catch basins, water or gas stop-cocks or gates or to grant permits for private connections with sewer, water or gas pipes, at any time during the progress of the work and the contractor shall not interfere with or place any impediment in the way of any person or persons who may be engaged in doing such work as has been mentioned. The Board of Public Works reserves the right to suspend the work on any part of this improvement at any time during the construction of the same for the purpose above stated, or if said work interferes with other improvements. In any such case the contractor shall not be entitled to any damages, either for the digging up of the street or for the delay, but he shall be allowed and paid for any material or labor made necessary on his part, such reasonable sum (to be determined at contract rates) as may be agreed upon between him and the City Engineer, and the time specified for the completion of his contract shall be extended as many days as he was thus delayed.

16th. **Payment of Wages.** The said contractor agrees to pay the wages of all persons and for assistance of every kind employed upon or about said work, and for all materials purchased therefor, and The City of Seattle may withhold any and all payments under this contract until satisfied that such wages, assistance and materials have been fully paid for.

17th. **Assignment of Contract.** The contract for this improvement shall take effect and be in force only upon its approval by the Board of Public Works of The City of Seattle, and shall be assigned only with the written consent of said Board, endorsed thereon. No assignment that may be made shall release the contractor therefor or his sureties, from any liabilities arising under said contract.

18th. **Hours of Labor.** And it is further agreed that said work shall be performed in workdays of not more than eight hours each, except in cases of extraordinary emergency; and that this contract may be canceled by the Board of Public Works in case such work is not performed in accordance with the provisions of this contract above specified, and no case of extraordinary emergency shall be construed to exist in any case where other labor can be found to take the place of labor which has already been employed for eight hours in any calendar day.

19th. **Excavated Material.** The material excavated from trenches shall be laid compactly on the sides of the trench and kept trimmed up so as to be of as little inconvenience as possible to the traveling public and to adjoining tenants.

20th. **Trenches Kept Free from Water.** The contractor shall keep all the trenches free from water during the progress of the work. No pipe or masonry shall be laid in water.

21st. **Protection of Private Property.** The contractor shall, at his own expense, shore up, protect and make good, as may be necessary, all buildings, walls, fences or other property injured, or liable to be injured, during the progress of the work; and the contractor will be held responsible for all damage which may happen to neighboring property or the street, or any improvements whatsoever, from neglect of this precaution, or from any other cause connected with the prosecution of the work.

22nd. **Fees and Royalties.** All fees, or royalties for any patented invention, article or arrangement, that may be used upon, or be in any manner connected with the work, or any part thereof, connected with these specifications, shall be in-

GENERAL STIPULATIONS—Continued

cluded in the price mentioned in the proposals, and the contractor shall protect and hold the City harmless against any and all demands for such fees or royalties. Before the final payment is made on the contract the contractor must furnish acceptable proof of proper and satisfactory release from all such claims.

23rd. **Charge for Water Settling Earth.** The City Water Department will charge the contractor for city water used in settling earth at the rate of one dollar and forty cents (\$1.40) for every one hundred (100) cubic yards of material water-settled.

24th. **Injunctions.** It is agreed that if the contractor for this improvement, or The City of Seattle, shall be unable to complete any portion or portions thereof by reason of court proceedings enjoining the construction or completion of any portion or portions thereof and it shall, in the discretion of the City Engineer, be impracticable to construct or complete any other portion or portions thereof, then, and in any such case, the contractor shall waive any and all claim or claims for damages by reason of such inability to construct such portion or portions of said improvement, and the City Engineer shall have the right to report such improvement, as completed, file his final estimate thereon as provided for in the full completion of other local improvements in The City of Seattle, and such contractor shall agree to accept in full payment of such improvement, and as a cancellation of his contract therefor a sum of money for his labor performed, and materials furnished in strict accordance with his bid for such contract, on the basis of the work actually performed or materials and labor actually furnished in said work to the date of stopping thereof. Should the court proceedings allow the work to be resumed prior to the issuance of the notice of completion on said work by the City Engineer, then the contractor on being ordered by the City Engineer shall proceed with the work immediately, carrying out the contract in full according to all original intents or modifications of the court, as the case may be, at the prices as specified in the original contract, and no extra payment will be allowed said contractor for change in price of material or labor or for any other reason whatsoever. Whatever time elapses after the contractor has been ordered to stop on the work and his being ordered to proceed again will not be considered as a part of the time allowed on the contract.

25th. **No Material to be Piled on Pavements.** Contractors shall not pile material on any asphalt pavement without first covering the asphalt with planks or in a manner satisfactory to the City Engineer and all material shall be compactly placed.

26th. **Inspection of Materials.** All materials shall be subject to inspection by the Engineer or his inspector, who will select samples in such numbers and quantities as he may deem necessary and subject the same to such tests as may be necessary to determine their qualities as herein specified, and he will accept or reject the materials in accordance with the results of such trials. Such tests may be repeated upon the arrival of different shipments, as frequently as may be necessary to insure the acceptance of only such materials as shall comply with the provisions of the plans and specifications to the satisfaction of the City Engineer. All materials rejected by the City Engineer or his inspector shall be removed from the premises and adjacent surroundings by the contractor within twenty-four (24) hours after he has been notified of their rejection. If this condition is not implicitly complied with, the City Engineer reserves the right

GENERAL STIPULATIONS—Continued

of causing such rejected materials to be removed by other parties, the cost of such removal to be deducted from any money then due or which may become due to the contractor.

27th. **Quality of Material and Labor.** Any material necessary for the construction of any part of the improvement not specified herein shall be of good quality. All workmen employed shall be skilled in the performance of the special work to which they are assigned and whenever in the judgment of the City Engineer any workman is deemed unskilful, incompetent or disobedient, he shall be at once discharged and not again employed on any portion of the work.

28th. **Removing and Repairing Pavements.** Whenever it is necessary to remove or repair any pavement the work shall be done to meet the requirements of Ordinances 16081, 17313 and 25150 of the City of Seattle. This work is under the supervision of the Department of Streets and Sewers.

The foregoing Standard Specifications of the City of Seattle were examined and approved by the Board of Public Works April 18, 1911.

Attest:

R. H. Thomson Chairman.

C. B. Bagley Secretary.

INDEX TO SPECIFICATIONS

	Page
Additional Base	75
Adjusting—Cast Iron Valve Boxes	90
Curbs and Gutters	7
Inlets	90
Manholes, C. B., etc., Covers	90
Adjustment of Water Mains	71
Alley Crossings—Brick	85
Concrete	22
Stone	85
Wood	23
Alley Drains—Concrete	91
Alley Sand Boxes	10
Alley Side Stops—Concrete	89
Wood	89
Armored Concrete Curbing	88
Asphalt Pavement	79
Asphaltic Cement	80
Asphalt Gutters	84
Binder	83
Filler	80
Flux	80
General Requirements	84
Payment	85
Refined Asphalt	79
Wearing Surface	83
Base—Additional Concrete	75
Base—Concrete	73
Binder—Extra	92
Box Drains	11
Box Drain Screens	11
Brick Alley Crossings	85
Block Pavement	79
Catch Basins	40
Flush Tanks	39
Gutters	79
Manholes	35
Pavement	76
Sewers	33
Valve Chambers	54
Brick Pavement	76
Brick	76
Brick Laying	77
Grout Filler	78
Payment	79
Brick Sewers	33
Back Filling	34
Brick Laying	34
Measurements	34
Payment	34
Quality of Brick	33
Bulkheads—Wooden	28
Cast Iron Pipe	49
Alignment and Grades	50
Back Filling	52
Coating	49
Jointing	51
Laying Pipe	51
Measurements	53
Payment	53
Quality of Metal	49
Special Castings	50
Standard Specials	50
Tests	52
Trenching	51
Weights and Dimensions	49
Cast Iron Valve Box	58
Adjusted	90

INDEX TO SPECIFICATIONS

	Page
Catch Basins—Brick	40
Concrete	44
Covers Adjusted	90
Moved	47
Rebuilt	47
Clearing and Grubbing	1
Coal for Steam Roller	92
Concrete	98
Alley Crossings	22
Alley Drains	91
Concrete Alley Side Stops	89
Base	73
Catch Basins	44
Curbing	87
Curbing—Armored	88
Flush Tanks	44
Gutters (stairs)	20
Gutters (paving)	85
Manholes	44
Concrete Retaining Walls	25
Back Filling	27
Concrete	26
Finish	27
Forms	25
Gravel	27
Joints	26
Measurements	27
Payment	27
Reinforcing Steel	28
Tile Drain	27
Waterproofing	27
Concrete Sidewalks	16
Cement Specifications	17
Corrugated	20
Grading for	4
Gravel Specifications	17
Replaced	19
Repairing	88
Sand Specifications	17
Concrete Stairways	20
Covers—M. H. C. B., etc., adj.	90
Creosoted Fir Sawed Material	94
Creosoted Piling	93
Green or Freshly Cut	94
Seasoned	94
Watersoaked	93
Crossings—Brick Alley	85
Concrete Alley	22
Stone Alley	85
Wood Alley	23
Cross Walks	8
Rebuilt	8
Curbing—Armored Concrete	88
Concrete	87
Granite	86
Curbs and Gutters—Adjusted	7
Curbs and Gutters—Wood	7
Curb Inlets	48
District Gate Valves	54
Drains—Box	11
Concrete Alley	91
Hydrant	65
Sewer Pipe	10
Sub	11
Sub (paving)	90
Sub Under Sewer	35
Three-inch Tile	24

INDEX TO SPECIFICATIONS

	Page
Drop Manholes	39
Earthwork	3
Embankment	4
Excavation	3
Measurement of	6
Payment for	6
Extensions—Hydrant	66
Wooden Manhole	47
Extra Binder	92
Extra Excavation	98
Fir Sawed Material—Creosoted	94
Flush Tanks—Brick	39
Concrete	44
Galvanized Iron Railing	20
Pipe	53
Gate Valves	53
District	54
Graded Streets—Maintenance of	6
Grading	1
For Concrete Sidewalks	4
Granite Curbing	86
Gravel in Concrete Sidewalks	17
Sub Base	90
Green Piling—Creosoted	94
Gutters—Asphalt	84
Brick	79
Concrete (stairs)	20
Concrete (paving)	85
Wooden	7
Hydrants	59
Hydrant Connections	65
Drains	65
Extensions	66
Reset	65
Inlets	47
Adjusted	90
Curb	48
Moved	47
Temporary	11
Iron—Bulkhead	28
Iron Railing—Galvanized	20
Lumber	98
Old Relaid	90
Wooden Bulkhead	28
Maintenance of Graded Streets	6
Manholes—Brick	35
Concrete	44
Drop	39
Rebuilt	47
Wood	45
Wooden Extension	47
Measurement of Earthwork	6
Measurement of Pavements	85
Miscellaneous Items	98
Monument Cases	89
Moving Catch Basins	47
Inlets	47
Old Lumber Relaid	90
Old Planking Relaid	91
Pavement—Asphalt	79
Brick	76
Brick Block	79
Measurement of	85
Relaid	85
Stone Block	75
Traffic on	85

INDEX TO SPECIFICATIONS

	Page
Paving	73
Sub-Drains	90
Sub-Grading for	4
Payment—(General)	1
For Earthwork	6
Piling	93
Creosoted	93
Green or Freshly Cut	94
General Conditions	95
Seasoned	94
Watersoaked	93
Pipe Sewers	31
Alignment and Grades	31
Back Filling	33
Cement Specifications	17
Pipe Laying	32
Payment	33
Quality of Pipe	31
Trenching	32
Tunnelling	32
Planking	92
Relaying Old	91
Sub-Grading for	5
Temporary	98
Plans and Specifications	1
Railing—Galvanized Iron	20
Wood	97
Rebuilding Catch Basins	47
Cross Walks	8
Manholes	47
Reinforcing Steel	28
Relaying Old Lumber	90
Planking	91
Pavement	85
Repairing Sidewalks	88
Replacing Concrete Sidewalks	19
Replanking	92
Repairing Concrete Sidewalks	88
Resetting Existing Hydrants	65
Resurfacing Streets	5
Retaining Walls	25
Rock Pockets	10
Roller—Coal for Steam Roller	92
Sand Boxes	8
Alley	10
Sand Catcher	10
Sand for Concrete Sidewalks	17
Screens for Box Drains	11
Sewers	31
Brick	33
Pipe	31
Side	34
Wooden Box	35
Sewer Pipe Drains	10
Sewer Pipe—Three-inch	24
Sewer Sub-Drain	35
Shear Boards	8
Side Sewers	34
Sidewalks	13
Concrete	16
Corrugated Concrete	20
Wood	13
Sidewalks Repaired—Concrete	88
Old Lumber	90
New Lumber	90
Wood	88
Specifications and Plans	1

INDEX TO SPECIFICATIONS

	Page
Stairways—Concrete	20
Wood	15
Steel Pipe	66
Additional Tests	67
Air Valves	70
Bidding Formalities	71
Caulking	69
Chemical and Physical Properties	66
Cleaning	69
Coating	69
Drifting	69
Drifting Tests	67
Field Riveting	70
Formation of Angles and Curves	69
Hydrostatic Tests	70
Inspection of Manufacture	68
Manholes	70
Manufacture of Pipe	68
Perfect Plates	68
Protection of Metal	68
Punching Tests	67
Rejection	68
Shop Riveting	69
Steel for Lock Bars	67
Testing	69
Transportation	70
Trenching and Back Filling	71
Steel—Reinforcing	28
Stone—Alley Crossings	85
Block Pavement	75
Stops—Concrete Alley Side	89
Wood	88
Wood Alley Side	89
Sub-Base—Gravel	90
Sub-Drains	11
Paving	90
Under Sewer	35
Sub-Grading for Paving	4
For Planking	5
Superintendence	1
Surfacing Streets	5
Temporary Inlet	11
Planking	98
Wood Walks	13
Three-Inch Tile Drains	24
Sewer Pipe	24
Tile Drain—Three-Inch	24
Timber Trestles	93
Superstructure	96
Traffic on Pavements	85
Trestles—Timber	93
Valve Box—Cast Iron	58
Cast Iron Adjusted	90
Wooden	58
Valves—Gate	53
District Gate	54
Valve Chambers—Brick	54
Walls—Concrete Retaining	25
Watermains	49
Adjusted	71
Cast Iron Pipe	49
Connections to Existing Mains	72
Maintenance of Roadway	73
Removal of Old Pipe	72
Service Connections	72
Steel Pipe	66
Watersoaked Creosoted Piling	93

INDEX TO GENERAL STIPULATIONS

	Page
Wood Alley Crossings	23
Side Stops	89
Wooden Box Sewers	35
Wooden Bulkheads—Iron	28
Wooden Bulkheads—Lumber	28
Wooden Gutters	7
Wooden Valve Box	58
Wood Cross Walks	8
Wood Curbs and Gutters	7
Wood Manholes	45
Manhole Extensions	47
Wood Railing	97
Wood Sidewalks	13
Sidewalks Relaid	15
Walks—Temporary	13
Wood Stairway	15
Wood Stops	88
Alley Side	89

INDEX TO GENERAL STIPULATIONS

Assignment of Contract	102
Begin Work	99
Claim for Extras	101
Changes of Plans	99
Charge for Water Settling Earth	103
Connections for Water and Gas	101
Contractor's Responsibilities	98
Damage to Existing Improvements	100
Disputes—To Whom Given	99
Disputes—How Settled	99
Engineers—When Wanted	100
Excavated Material	102
Fees and Royalties	102
Flow of Water Courses—Provide for	100
Forfeiture of Contract	101
Hours of Labor	102
Injunctions	103
Inspection of Materials	103
Material and Labor—Quality of	104
Material Not to Be Piled on Pavements	103
Monuments—Not to Be Disturbed	100
Occupation of Streets—Unnecessary	100
Pavements—Removing and Repairing	104
Payment of Wages	102
Protection of Private Property	102
Protection to Public Utilities Owned by City	100
Protection of Work	99
Provide for Flow of Water Courses, etc.	100
Provision for Water and Gas Connection	101
Quality of Labor and Material	104
Removing and Repairing Pavements	104
Trenches Kept Free From Water	102
Unnecessary Occupation of Streets	100
Water Courses—Provide for Flow	100

INDEX TO PLANS

Alley Paving—Brick	74
Asphalt	74
Alley Crossings—Brick	74
Concrete	22
Stone	74
Wood	24
For Unpaved Streets	23
Alley Grading—Half Section	2
Alley Grading and Curbing—Half Section	2

INDEX TO PLANS

	Page
Alley Sand Box	10
Aprons—To Cross Walks	7
Arrangement of Hydrants and Auxilliary Gate	64
Box Drain	12
Screen	12
Section and Bill of Material	12
Special	12
Brick Block	79
Brick Catch Basin	40
Brick Flush Tank	39
Brick Manhole	36
Modified Form	37
Brick Valve Chamber—Large	56
Small	58
Bulkhead—Wood	29-30
Catch Basin—Brick	40
Catch Basin—Cover	43
Inlet Top	41
Catch Basin Location	42
Catch Basin Trap	42
Concrete Alley Crossings	22
Concrete Drain	91
Concrete Manhole	44
Concrete Retaining Wall	25
Concrete Stairways	21
Concrete Stops	81
Concrete Walks	16
Corrugated	20
Cover for C. B. M. H. and F. T.	43
For Valve Chamber (large)	54-55
For Valve Chamber (small)	57
Crosswalks	7
Crown of Roadway	2
Curbs and Gutters	2
Alley Gutter and Returns	6
Method of Cutting Brackets	6
Methods of Cutting Gutter Boards	6
Curb Inlets	48
Curbing—Armored Concrete	88
Concrete	87
Concrete and Drain	87
Granite	86
Drop Manhole	38
Double Sand Box	9
Drain—Box	12
Concrete	91
Open	12
Three-Inch Tile	24
Extension to Wood Manhole	45
Flush Tank—Brick	39
Cover	43
Grading—Half Section	2
Grading and Curbing—Half Section	2
Grading Alley—Half Section	2
Granite Curbing	86
Gravel Base	91
Half Section—Grading	2
Alley Grading	2
Grading and Curbing	2
Hydrant Shackle	60
Hydrant and Auxilliary Gate	64
Hub and Flange Casting—6"	61
Hub and Flange Casting—8"	62
Inlets	46
Curb	48
Inlet Location	47
Inlet—Temporary	12

INDEX TO PLANS

	Page
Inlet Top—Catch Basin Cover	41
Large Brick Valve Chamber	56
Location of Catch Basin	42
Location of Inlet	47
Lugs with 6" or 8" Outlet	63
Manhole—Brick	36
Concrete	44
Cover	43
Drop	38
Modified Form	37
Wood	45
Wood Extension	45
Monument Case	89
Open Drain	12
Pavements—Roadway	74
" Asphalt	74
" Brick	74
" Stone	74
Pavements—Alleys	74
" Asphalt	74
" Brick	74
Pavements—Alley Crossings	74
" " Brick	74
" " Stone	74
Roadway Crown	2
Retaining Walls—Concrete	25
Railing—Wood	97
Galvanized Iron	21
Sand Box—Alley	10
Double	9
Single	9
Sand Catcher	11
Screen—Box Drain	12
Sewer Pipe—Three-Inch	24
Sewer Support in Quick Sand	33
Sewer—Sub-Drains	35
Shear Boards	8
Special Box Drain	12
Stairways—Wood	15
Concrete	21
Steel Test Bars	67
Stops—Wood	88
Concrete Alley Side Stop	88
Sub-Drains	12
Temporary Inlet	12
Tile Drain—Three-Inch	24
Three-Inch Sewer Pipe	24
Trap for Catch Basin	42
Test Bars for Steel	67
Valve Box—Wooden	59
Valve Chamber—Brick (large)	56
(Small)	58
Valve Chamber Cover (large)	54-55
(Small)	57
Wood Alley Crossings	24
Wood Bulkhead	29-30
Wood Cross Walks and Aprons	7
Wood Curbs and Gutters	2
Wood Manhole	45
Extension	45
Wood Railing	97
Wood Stairway	15
Wood Stops	88
Wood Valve Box	59
Wood Walks	13-14